
*BALANCE VALVE "A" AND "B" TO MAINTAIN MINIMUM ☐°F INLET TEMPERATURE
BOILER MUST BE SET FOR ON/OFF FIRING MODE ONLY

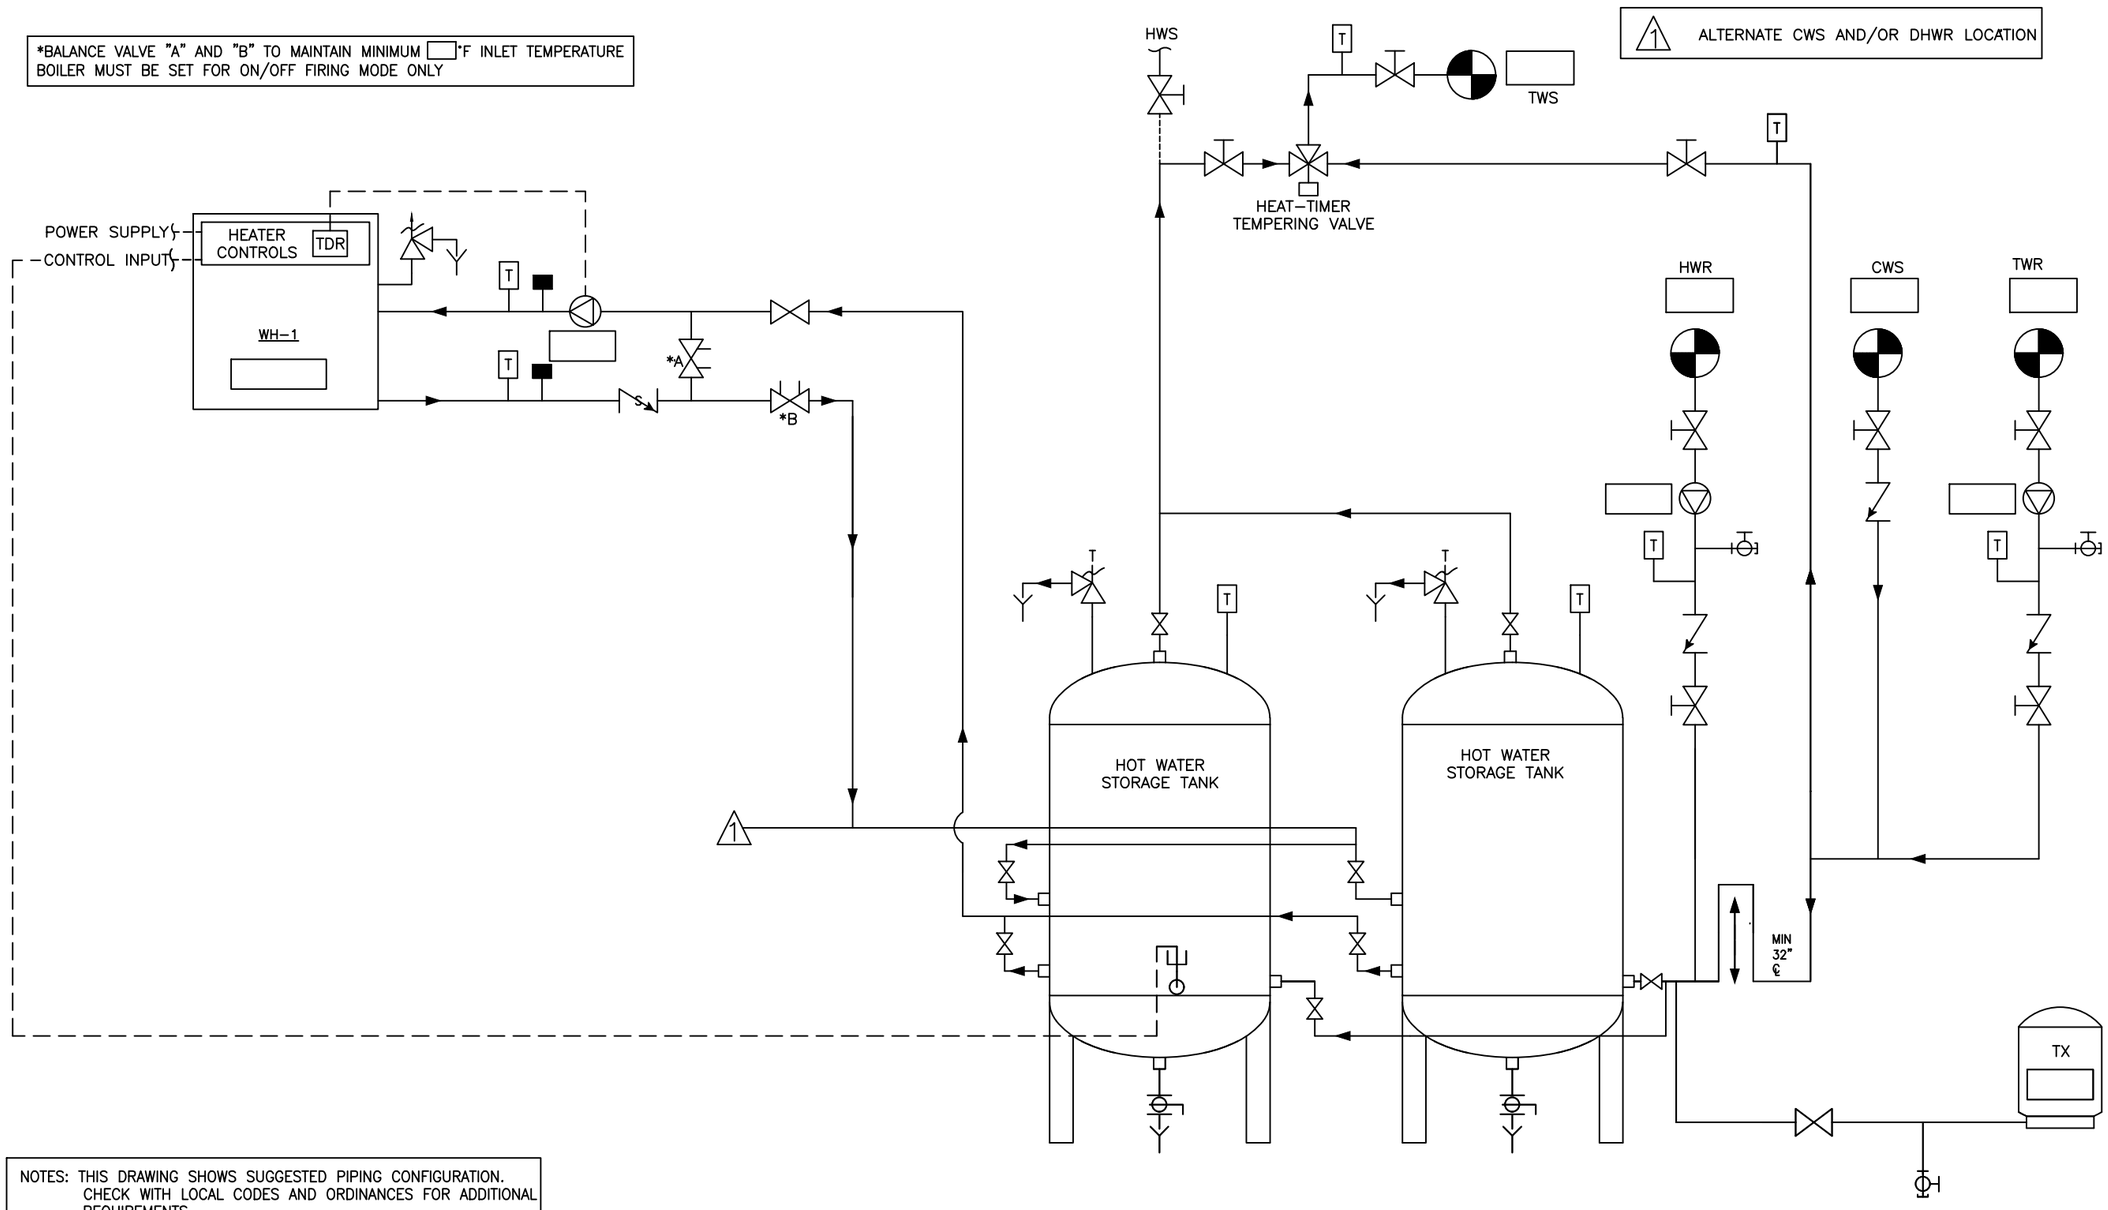

1 ALTERNATE CWS AND/OR DHWR LOCATION

NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

REV	DESCRIPTION	BY	DATE

THIS DRAWING AND THE INFORMATION DEPICTED THEREIN IS THE PROPERTY OF FLOWTHERM SYSTEMS, A DIVISION OF CHC, CALIFORNIA HYDRONICS CORP., COPIES ARE ISSUED IN STRICT CONFIDENCE AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS THE BASIS FOR THE MANUFACTURING, INSTALLATION OR SALE OF PRODUCT WITHOUT PRIOR WRITTEN PERMISSION OF CHC.

PROJECT NAME:

PROJECT LOCATION:

ENGINEER:

CUSTOMER:

DRAWING TITLE:
DOMESTIC HOT WATER FOR 140-160 STORAGE TWO TEMP SYSTEM W/ TEMPERING VALVE USING ONE SEALED COMBUSTION HEATER AND TWO VERTICAL STORAGE TANKS. CIRCUIT SETTER TEMPERATURE PROTECTION TO HEATERS

DRAWING No. D-140-160-T1-200-2V-CS | REV A

TOLERANCES UNLESS OTHERWISE SPECIFIED

DRAWN BY	DATE	CHECKED	APPROVED	DEC.	ANGLE	SIZE	SCALE
DK	04/06/09			.500"	5'	D	NTS

CHC