


1/ ALTERNATE CWS AND/OR DHWR LOCATION

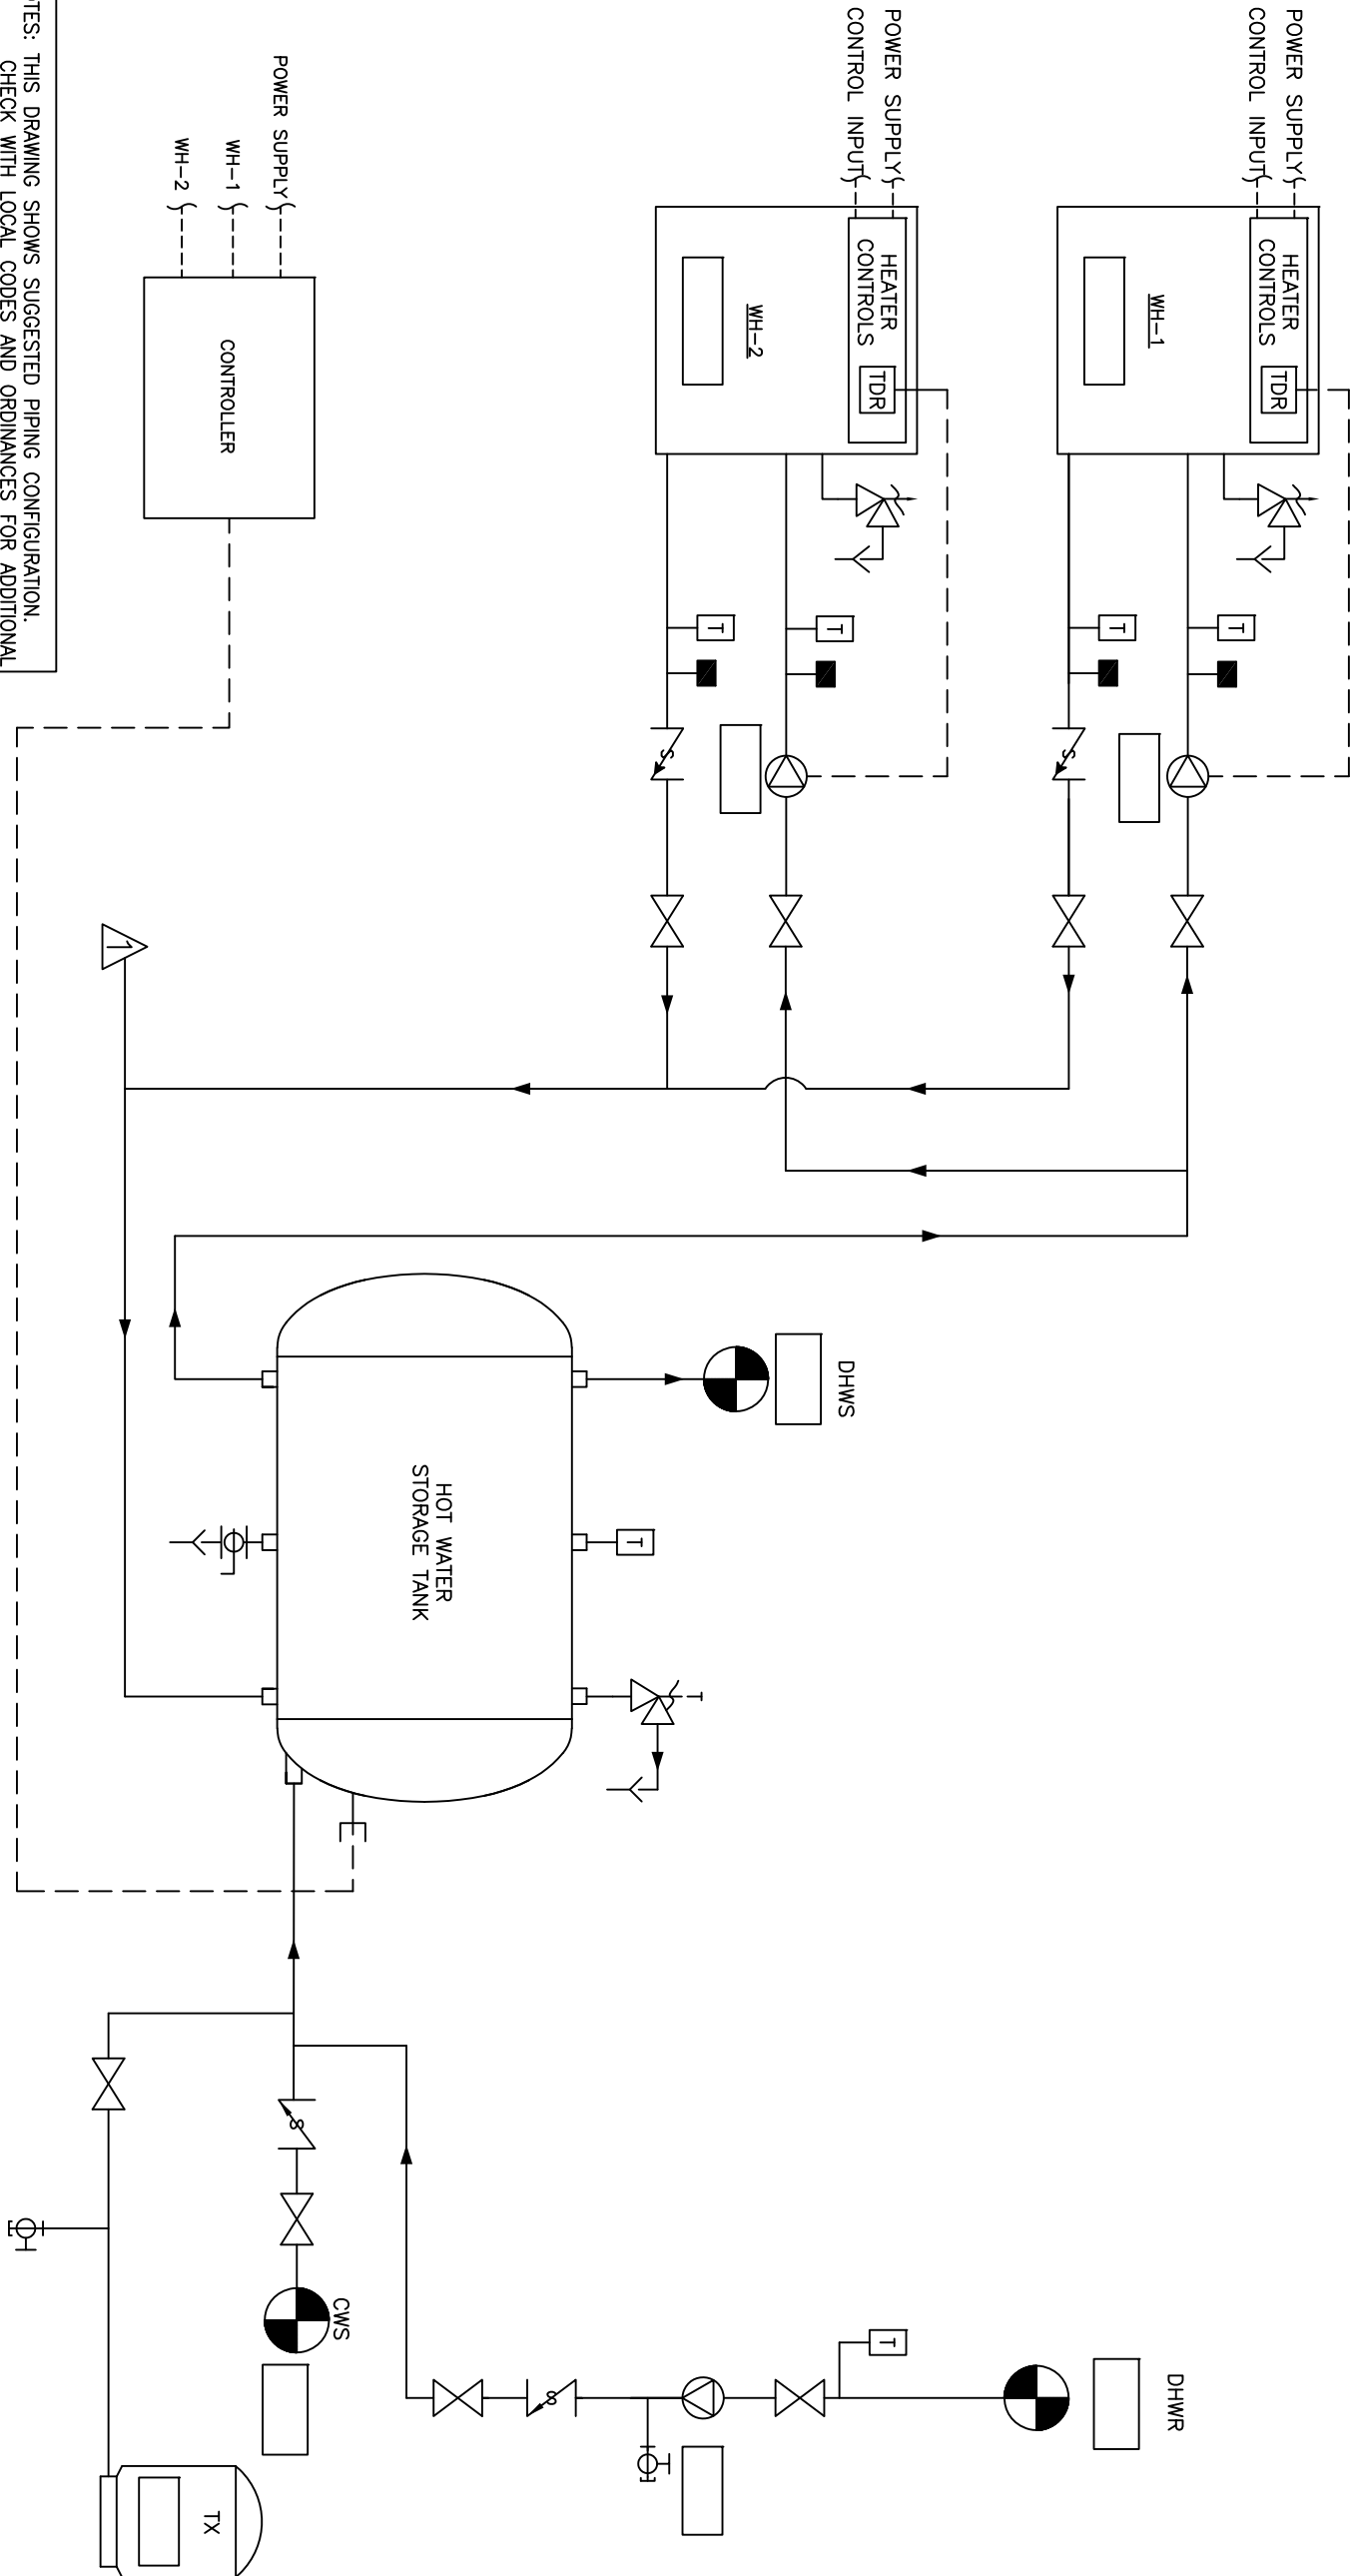

NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

					THIS DRAWING AND THE INFORMATION OF DEPICTED THEREIN IS THE PROPERTY OF FLUORIDAL SYSTEMS, A DIVISION OF FLUORIDAL CORPORATION., AND IS NOT TO BE REPRODUCED OR COPIES ARE ISSUED IN STRICT CONFIDENCE AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS A BASIS FOR ANY OTHER DRAWING, INSTALLATION OR SALE OF PRODUCT, WITHOUT PRIOR WRITTEN PERMISSION OF CHC.									
					PROJECT NAME:									
					PROJECT LOCATION:									
					ENGINEER:									
					CUSTOMER:									
					DRAWING No. D125-S2-100-1H-XX									
					TOLERANCES UNLESS OTHERWISE SPECIFIED									
					DRAWN BY/DATE DK 04/06/09									
					CHECKED APPROVED DEC 5.00" 5" D SCALE NTS									
					ALASKA • IDAHO • MONTANA									
					WASHINGTON • OREGON									
					888.690.0090									
					CALIFORNIA • RENO									
					800.486.4858									