


*BALANCE VALVE "A" AND "B" TO MAINTAIN MINIMUM °F INLET TEMPERATURE
BOILER MUST BE SET FOR ON/OFF FIRING MODE ONLY

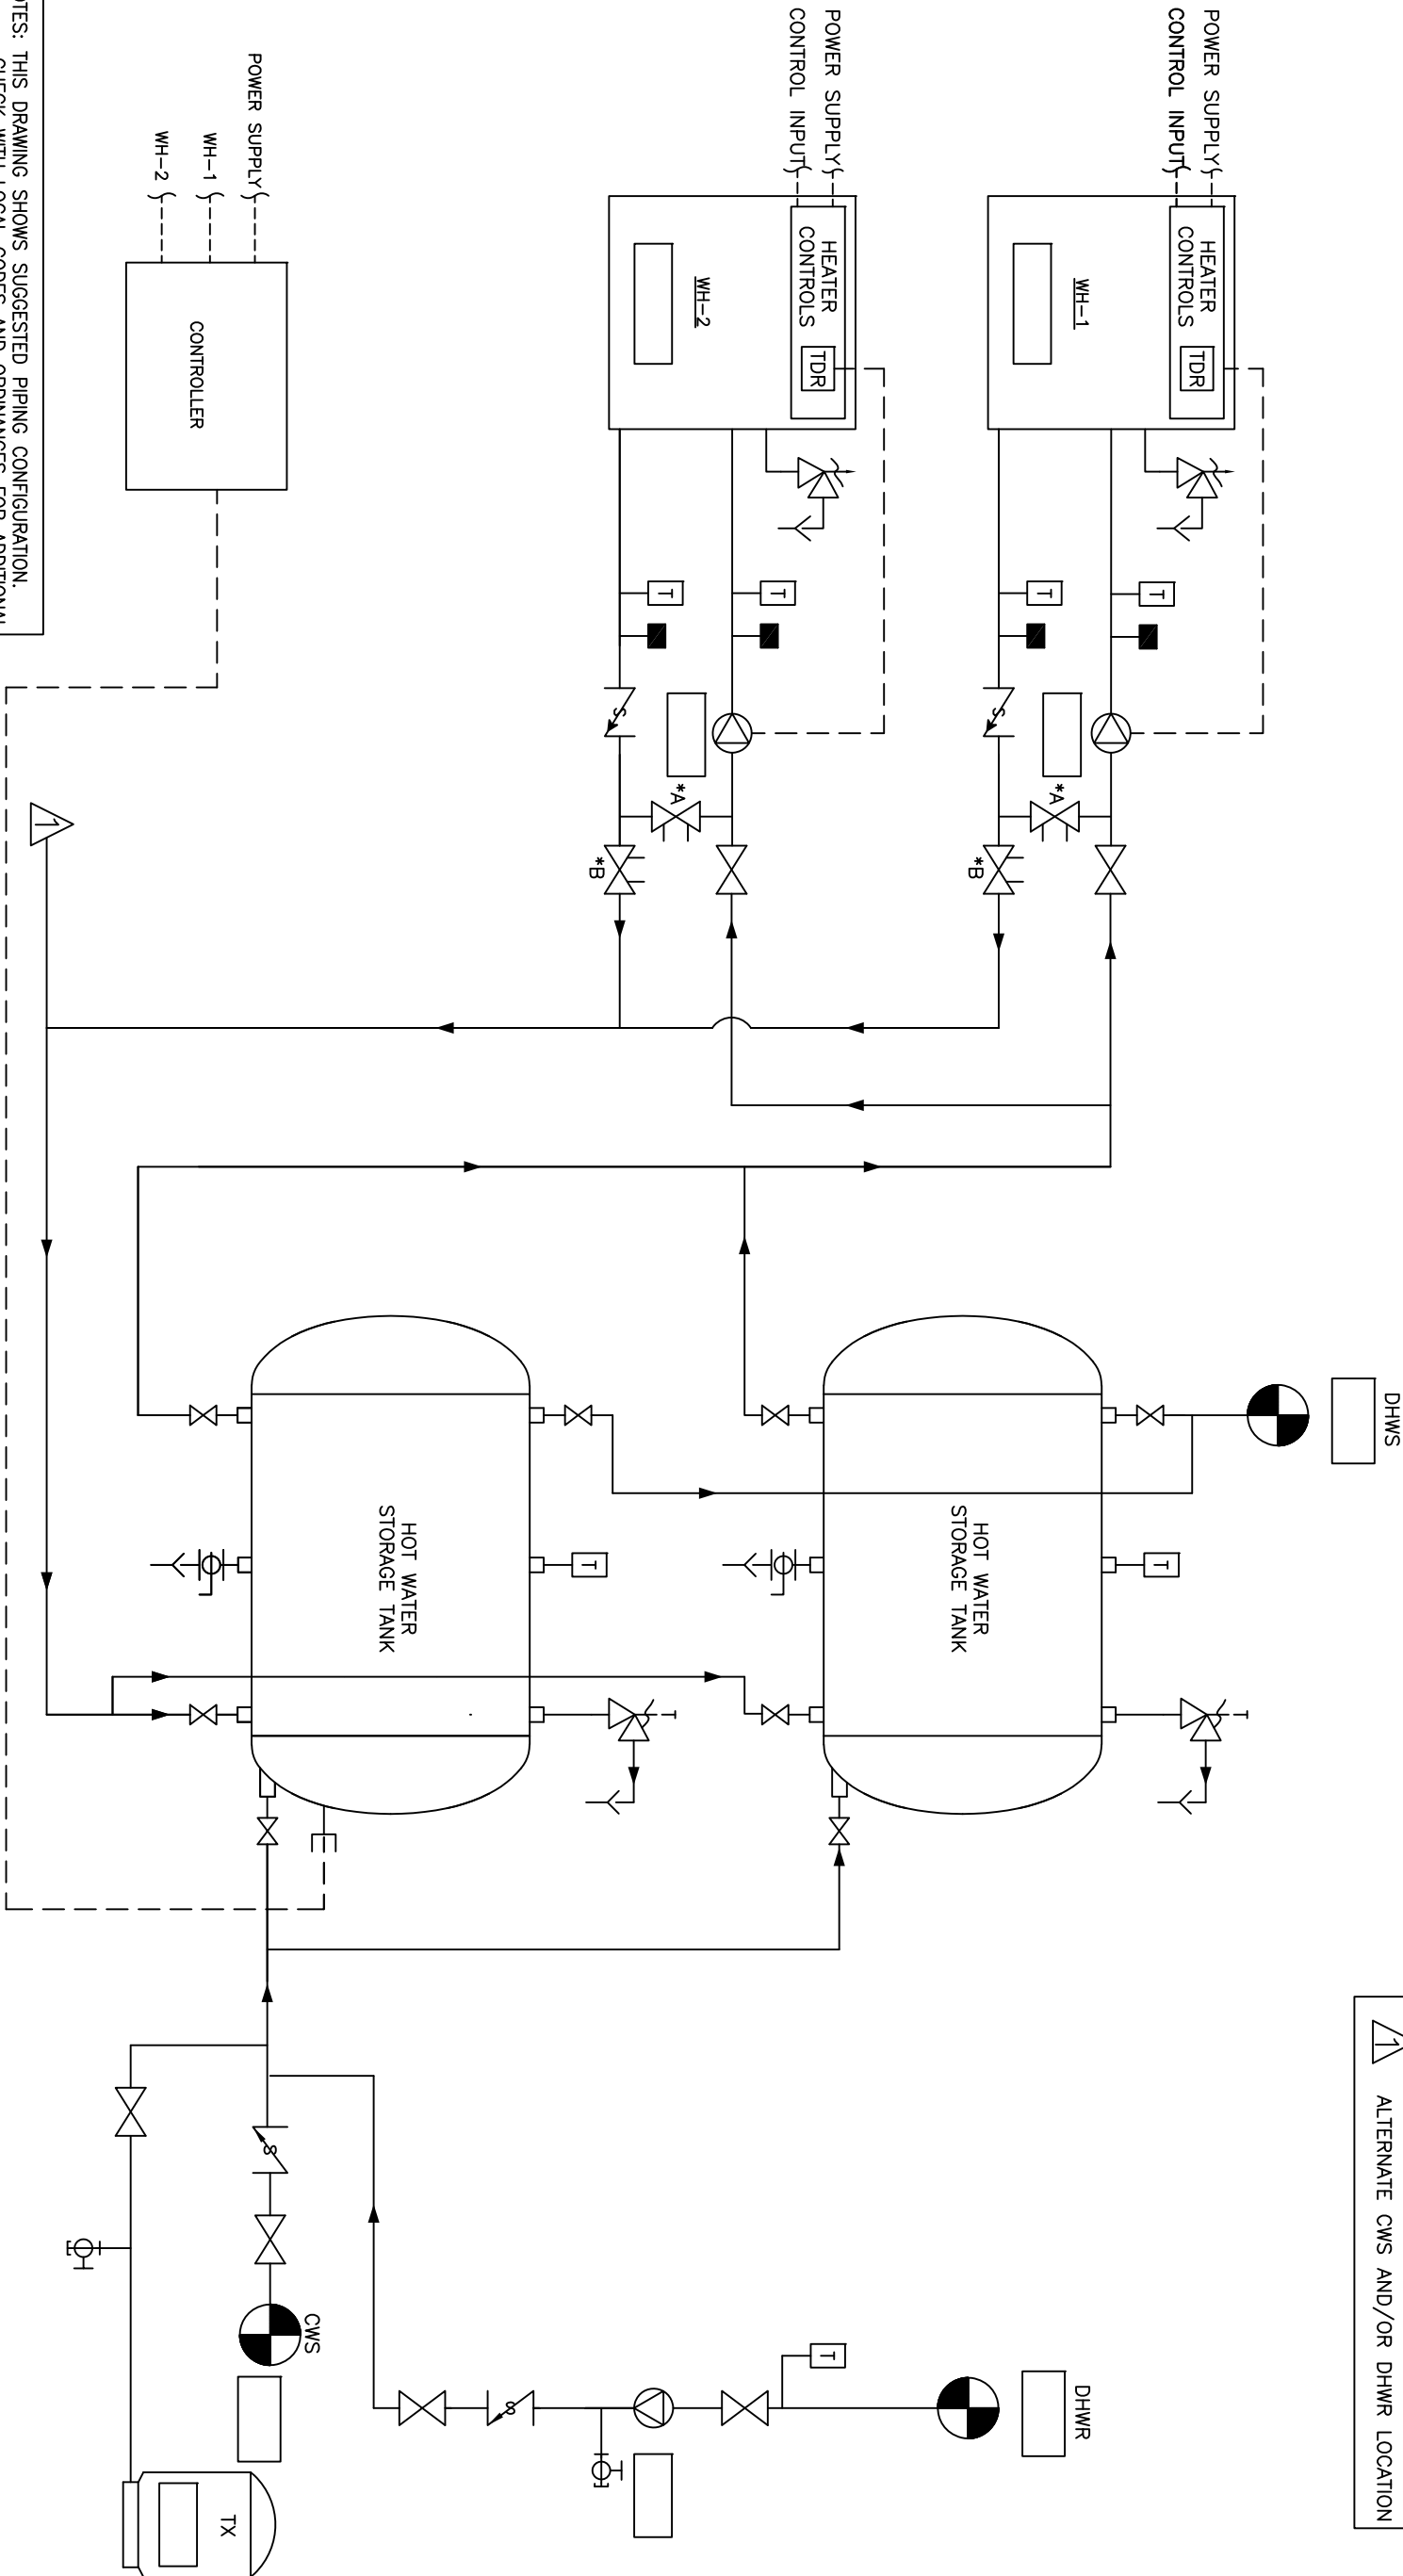

NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

THIS DRAWING AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF CHC, CALIFORNIA HYDRONICS CORP. - CONFERENCE AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT PRIOR WRITTEN PERMISSION OF CHC.		PROJECT NAME: DOMESTIC HOT WATER FOR 125 STORAGE SINGLE TEMP SYSTEM USING TWO SEALED COMBUSTION HEATERS AND TWO HORIZONTAL STORAGE TANK. CIRCUIT SETTER TEMPERATURE PROTECTION TO HEATERS		DRAWING No. D125-S2-200-2H-CS		REV A	
PROJECT LOCATION:		ENGINEER:		DRAWN BY/DATE DK 04/06/09		CHECKED/DATE	
DESCRIPTION		BY		DATE		SCALE	
REV		DESCRIPTION		BY		DATE	