


*BALANCE VALVE "A" AND "B" TO MAINTAIN MINIMUM °F INLET TEMPERATURE
BOILER MUST BE SET FOR ON/OFF FIRING MODE ONLY

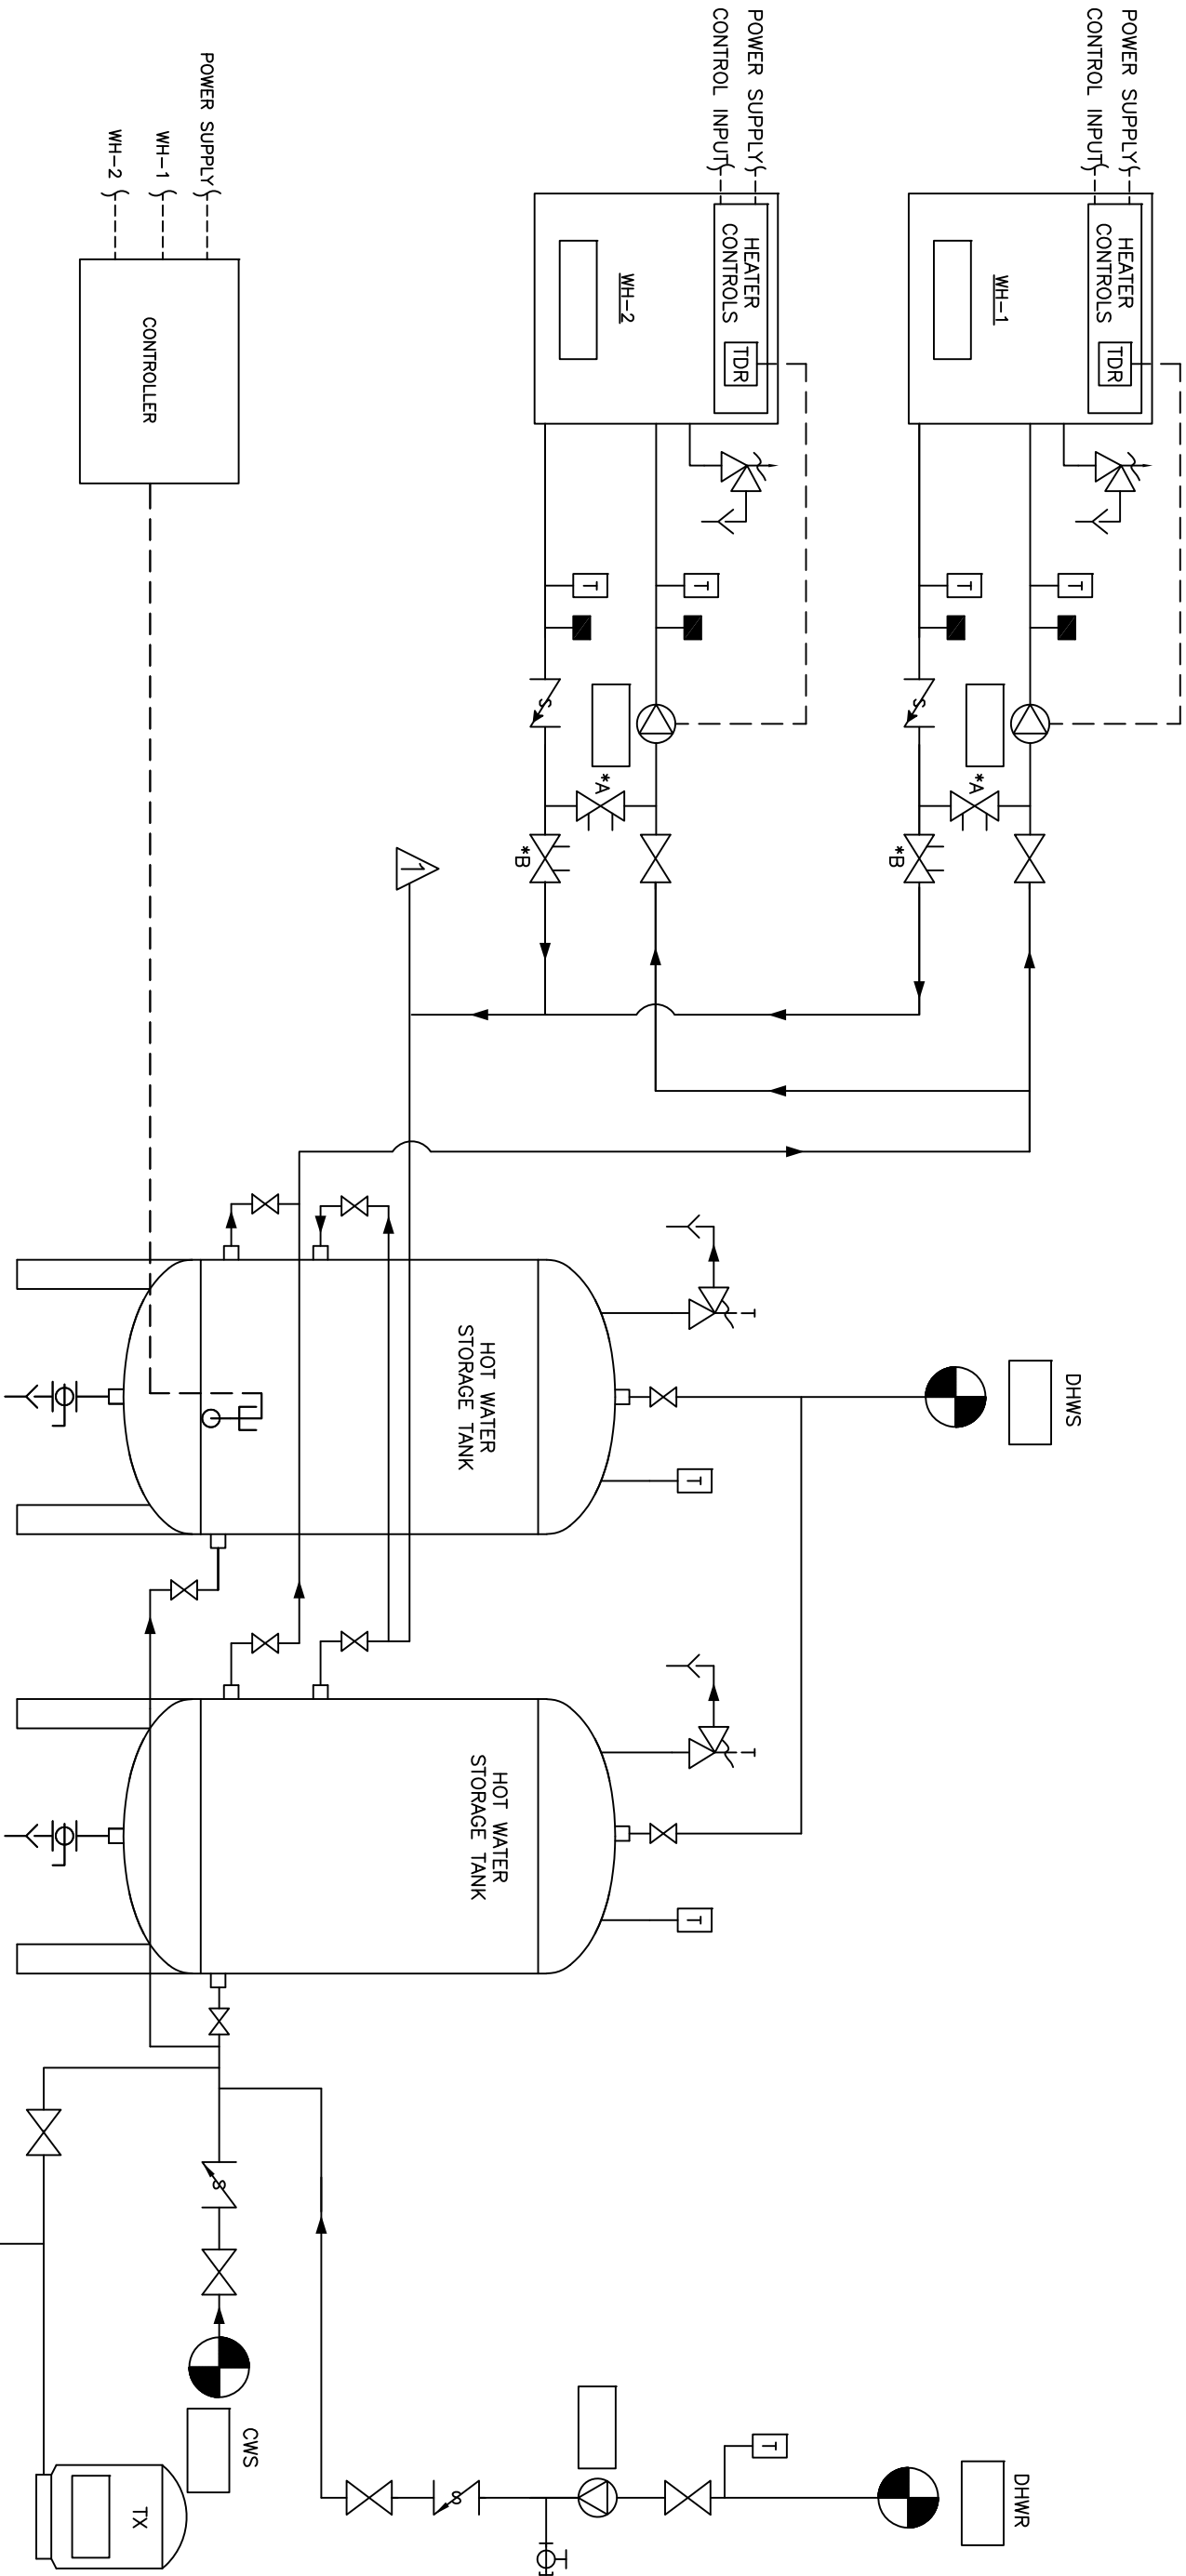

NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

PROJECT NAME:		DRAWING TITLE:	
PROJECT LOCATION:		DOMESTIC HOT WATER FOR 125 STORAGE SINGLE TEMP SYSTEM USING TWO SEATED COMBUSTION HEATERS AND TWO VERTICAL STORAGE TANKS. CIRCUIT SETTER TEMPERATURE PROTECTION TO HEATERS	
ENGINEER:		DRAWING No. D125-SZ-200-2V-CS	
CUSTOMER:		TOLERANCES UNLESS OTHERWISE SPECIFIED	
BY		DATE	
DESCRIPTION		SCALE	
REV		NTS	

CHC

CALIFORNIA • RENO
WASHINGTON • OREGON
ALASKA • IDAHO • MONTANA
888.690.0090