




1 ALTERNATE CWS AND/OR DHWR LOCATION

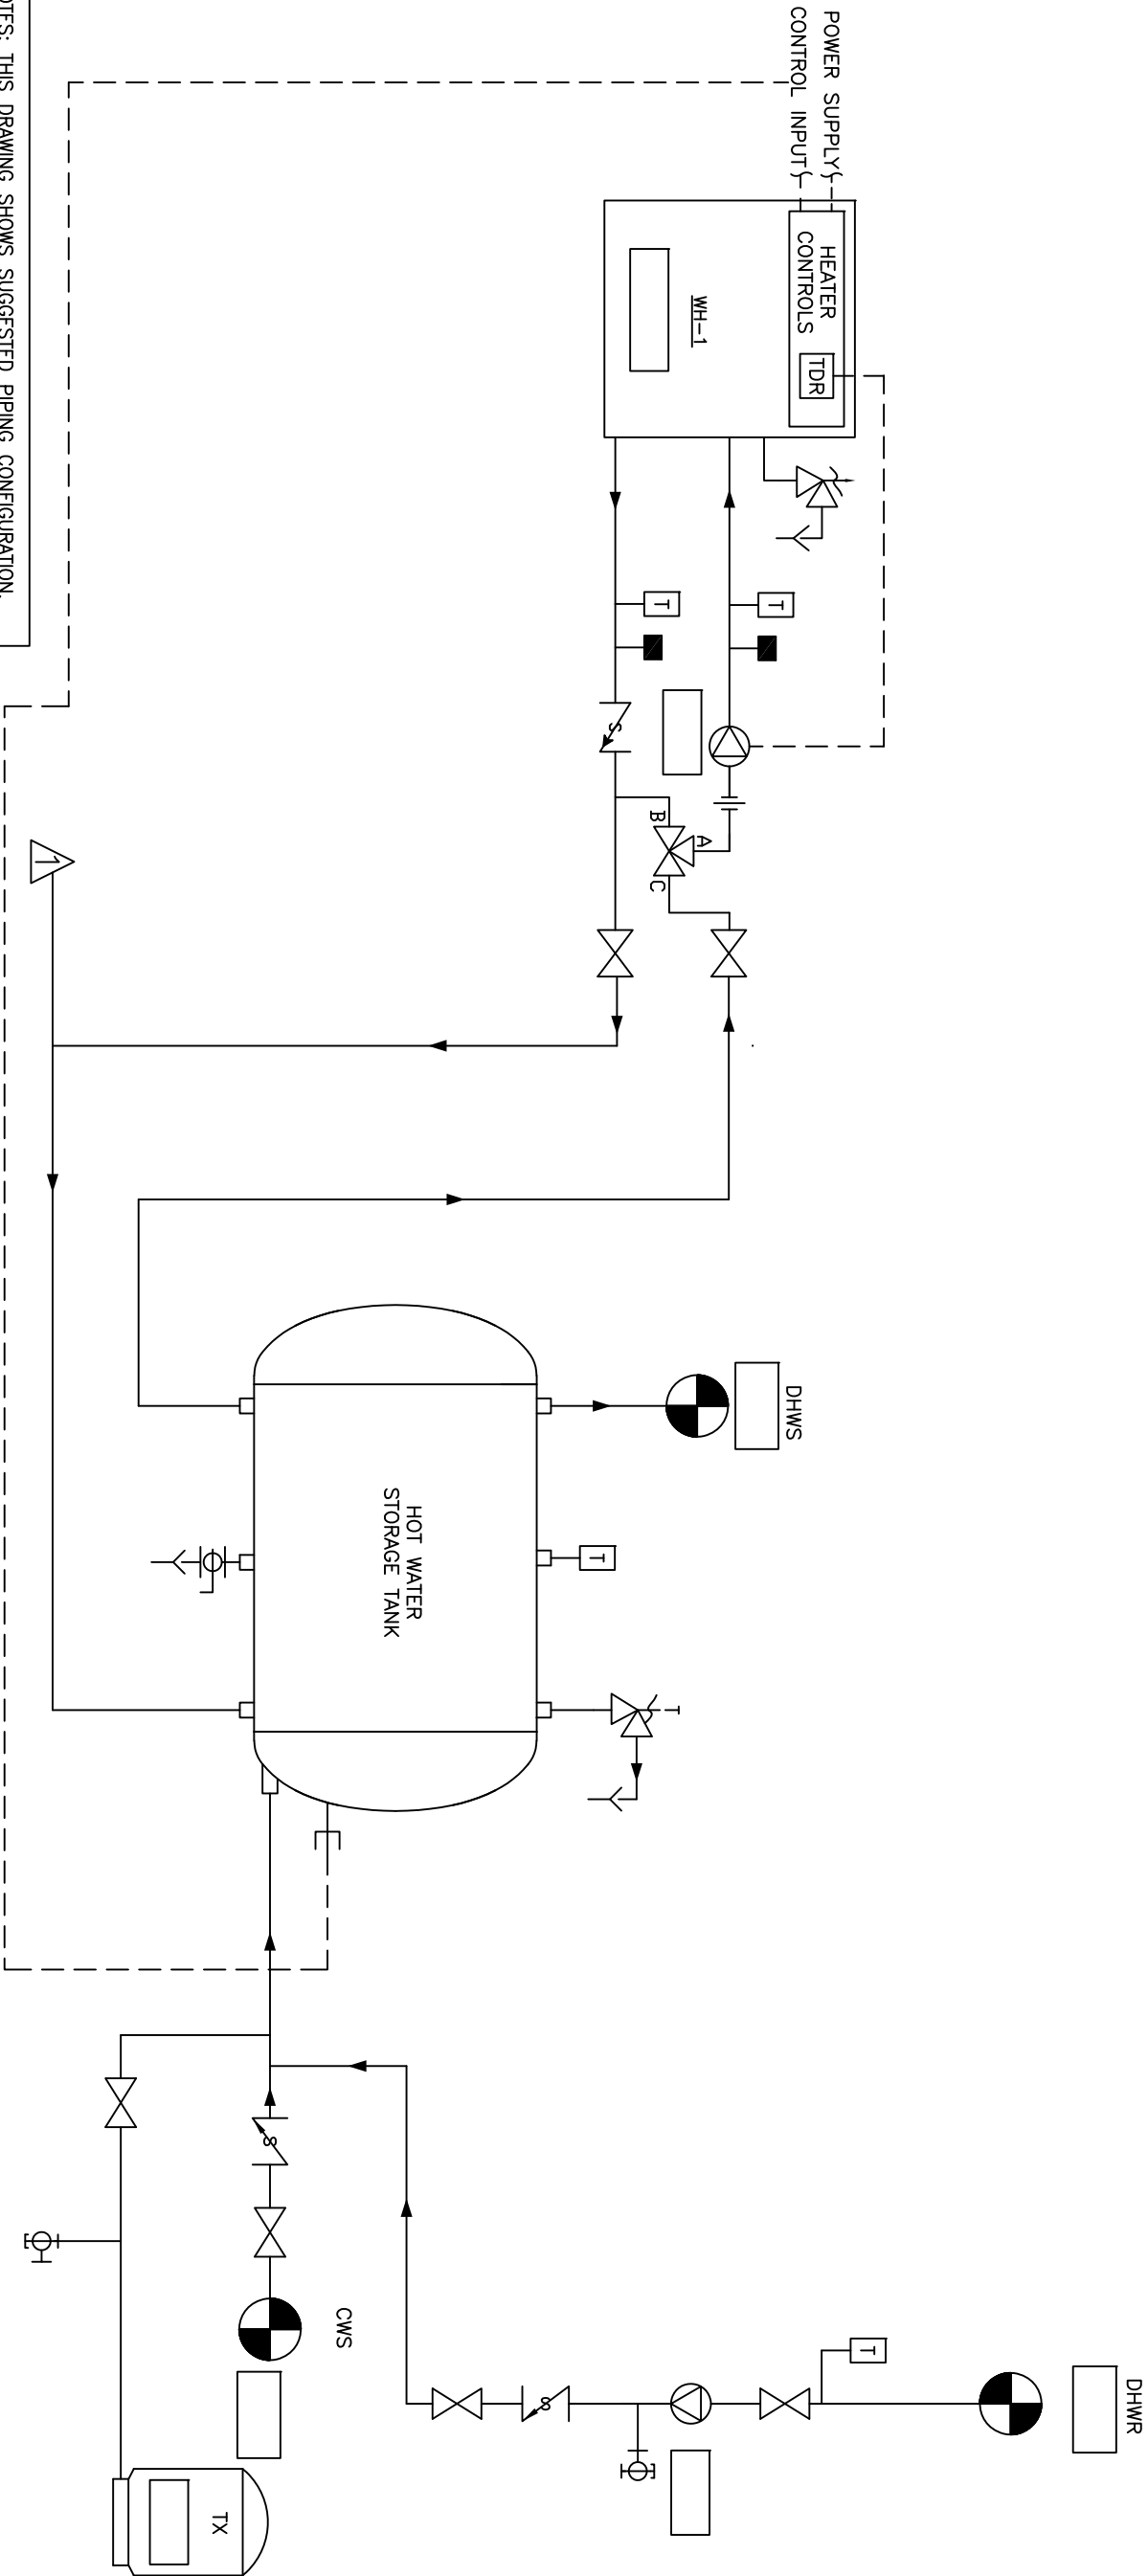

NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.  
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

					THIS DRAWING AND THE INFORMATION DEPICTED THEREIN IS THE PROPERTY OF FLOWTHERM SYSTEMS, A DIVISION OF FLOWTHERM INDUSTRIES, INCORP., AND IS TO BE KEPT IN STRICT CONFIDENCE AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS THE BASIS OF ANY DESIGN, MANUFACTURING, INSTALLATION OR SALE OF PRODUCT, WITHOUT PRIOR WRITTEN PERMISSION OF CHC.									
					PROJECT NAME:									
					DRAWING TITLE:									
					DOMESTIC HOT WATER FOR 125 STORAGE SINGLE TEMP SYSTEM USING ONE SEALED COMBUSTION HEATERS AND ONE HORIZONTAL STORAGE TANK.									
					PROJECT LOCATION:									
					INDEPENDENT FPE TEMPERATURE PROTECTION TO HEATERS									
					ENGINEER:									
					DRAWING No. D125-S1-200-1H-1F									
					REV A									
					CUSTOMER:									
					DRAWN BY/DATE DK 04/06/09									
					CHECKED APPROVED DEC. 500"									
					ANGLE 5"									
					SIZE D									
					SCALE NTS									
REV	DESCRIPTION	BY	DATE											



CALIFORNIA • RENO

WASHINGTON • OREGON

ALASKA • IDAHO • MONTANA

800.486.4358

888.690.0090