


1 ALTERNATE CWS AND/OR DHWR LOCATION

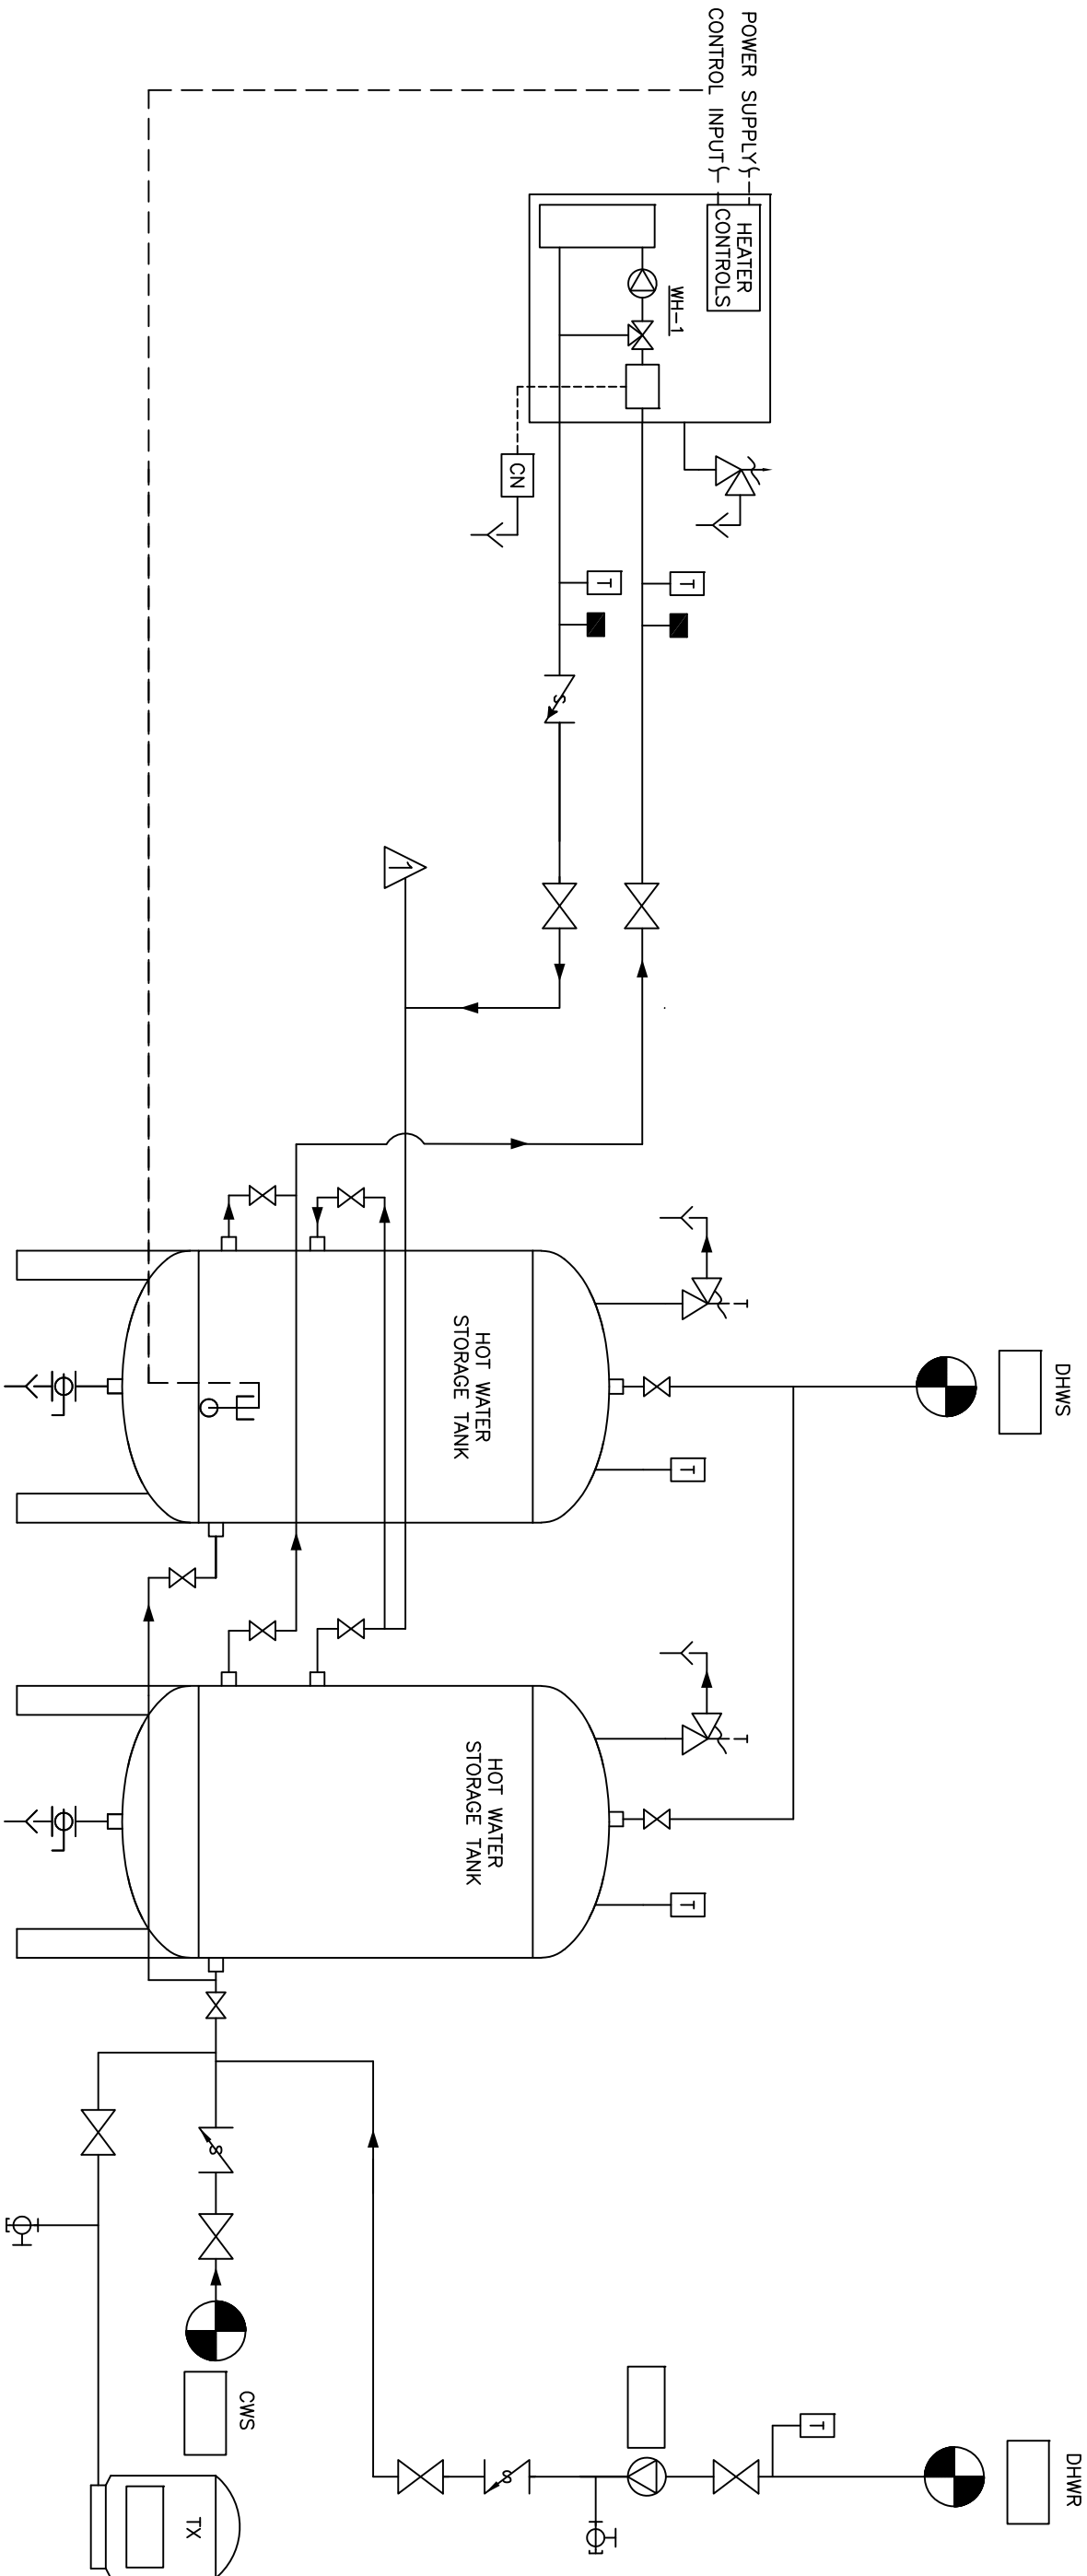

NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

					PROJECT NAME:									
					DRAWING TITLE:									
					DOMESTIC HOT WATER FOR 125 STORAGE SINGLE TEMP SYSTEM USING ONE									
					ELECTRIC HEATING SYSTEM WITH TWO VERTICAL STORAGE TANKS. BUILT IN									
					TEMPERATURE PROTECTION TO HEATERS									
					PROJECT LOCATION:									
					ENGINEER:									
					DRAWING No. D125-S1 300-2V-B1									
					TOLERANCES UNLESS OTHERWISE SPECIFIED									
					DRAIN BY/DL: 1/4" / 06 / 08									
					CHECKED: 5.00"									
					APPROVED: DEC. 5"									
					ANGLE: 5"									
					SIZE: D									
					SCALE: NTS									
					REV: A									
					DESCRIPTION									
					BY: DATE									
					REVISIONS									
					CUSTOMER:									
					CHC									
					WASHINGTON • OREGON									
					ALASKA • IDAHO • MONTANA									
					888.690.0090									
					CALIFORNIA • RENO									
					800.486.4858									