



1 ALTERNATE CWS AND/OR DHWR LOCATION

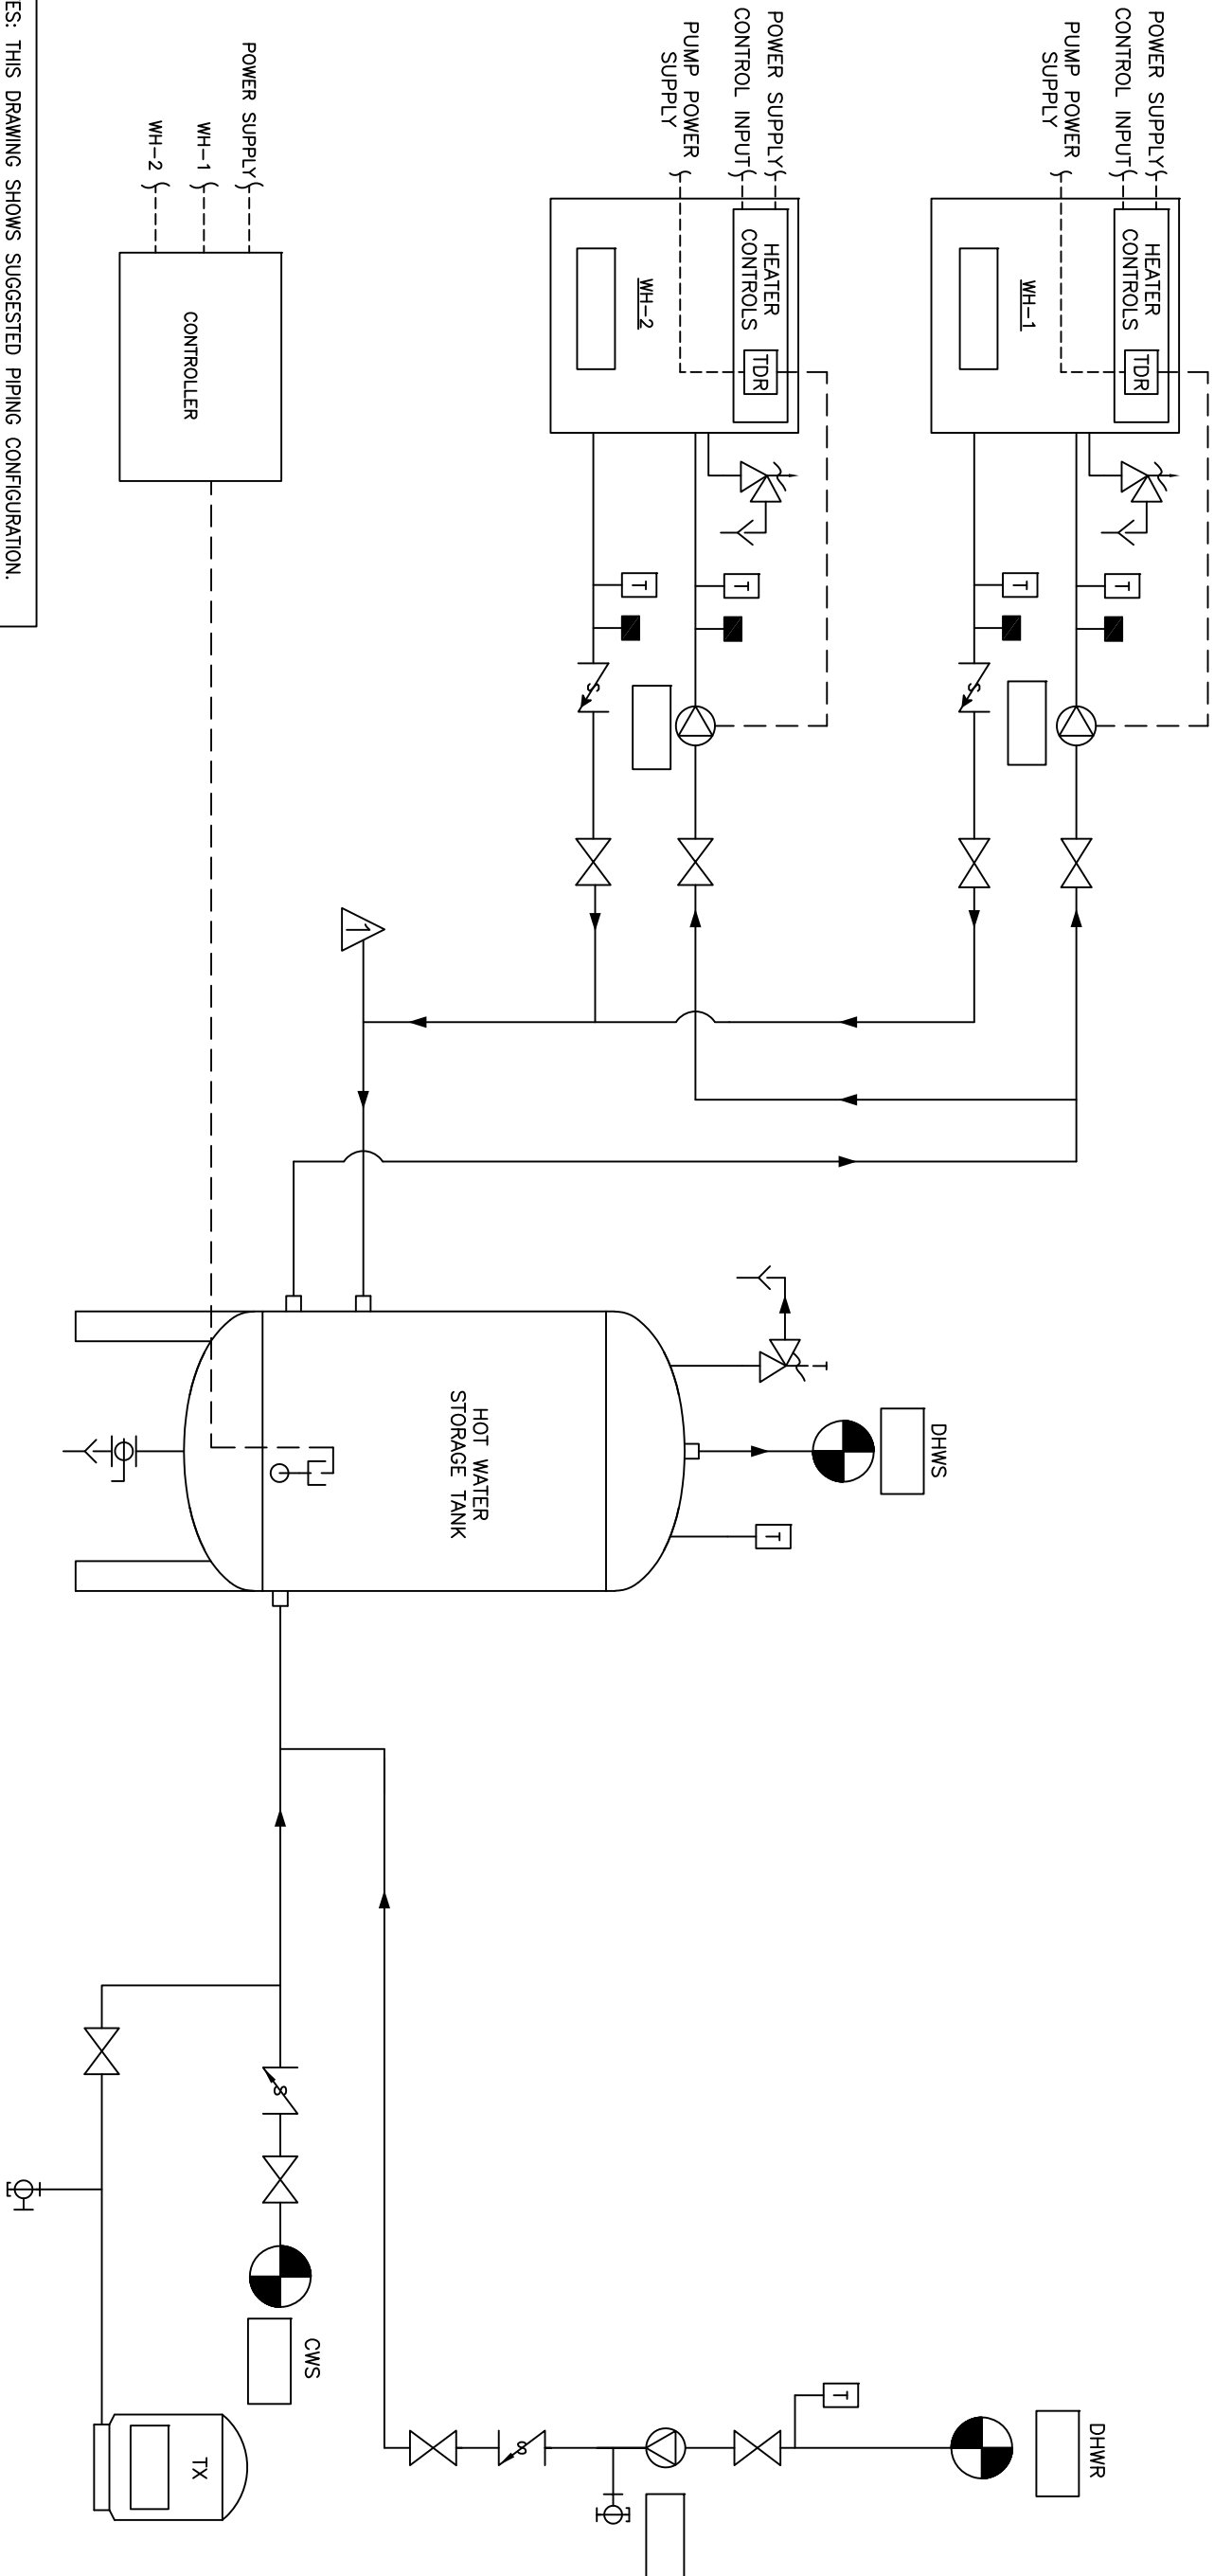

NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL
REQUIREMENTS.

				THIS DRAWING AND THE INFORMATION DEPICTED THEREIN IS THE PROPERTY OF CHC. IT IS TO BE USED ONLY FOR THE PROJECT AND FOR THE PERSON OR COMPANY FOR WHOM IT WAS PREPARED. COPIES ARE ISSUED IN STRICT CONFIDENCE AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS THE BASIS FOR THE EXECUTION OF, OR THE PREPARATION OF, ANY DRAWING OR FILE OF RECORD, WITHOUT PRIOR WRITTEN PERMISSION OF CHC.	PROJECT NAME:	DRAWING TITLE:	 CHC WASHINGTON • OREGON ALASKA • IDAHO • MONTANA 888.690.0090
				PROJECT LOCATION:	DOMESTIC HOT WATER FOR 140-160 STORAGE SINGLE TEMP SYSTEM USING TWO ATMOSPHERIC HEATERS AND ONE VERTICAL STORAGE TANK. NO TEMPERATURE PROTECTION TO HEATERS AND REQUIRES A SEPARATE POWER SUPPLY FOR THE HEATER PUMP TDR		
				ENGINEER:	DRAWING No. D140-160-S2-101-1V-XX		
				CUSTOMER:	TOLERANCES UNLESS OTHERWISE SPECIFIED DRAWN BY/DATE: [] []/06/09 CHECKED: [] APPROVED: [] SCALE: 500' 5" D NTS		
REV	DESCRIPTION	BY	DATE				