


*BALANCE VALVE "A" AND "B" TO MAINTAIN MINIMUM 110°F INLET TEMPERATURE
BOILER MUST BE SET FOR ON/OFF FIRING MODE ONLY

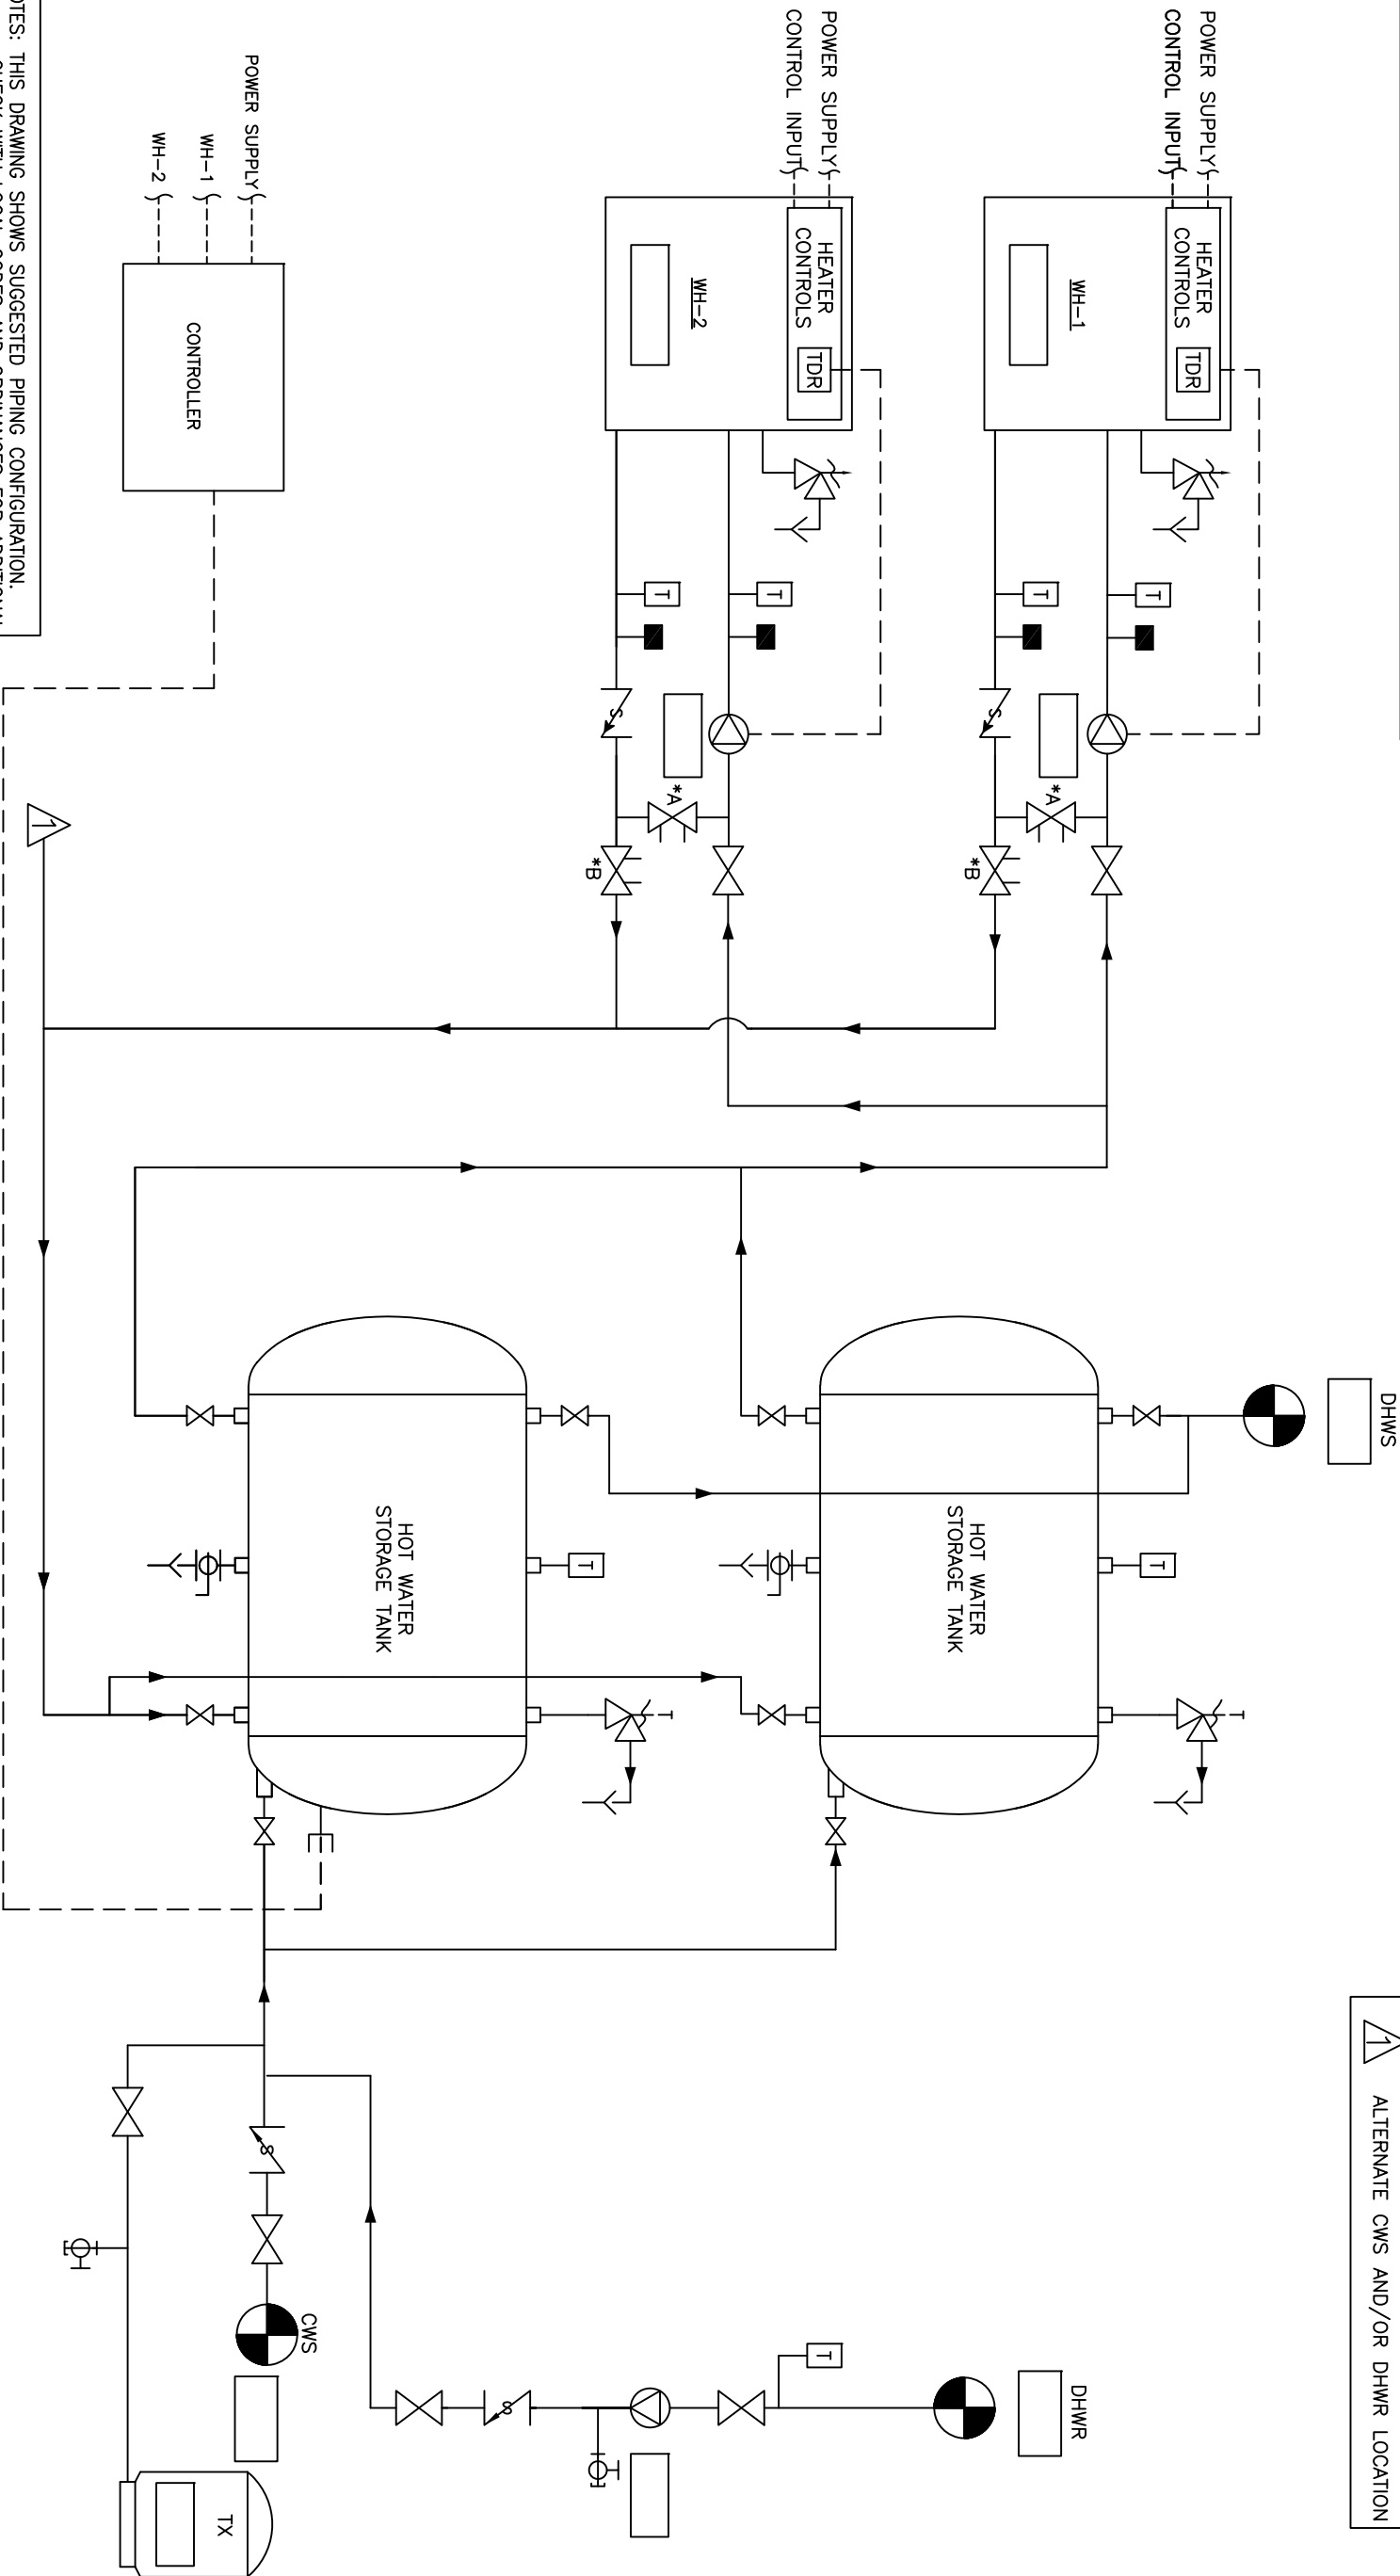

NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

			PROJECT NAME:			DRAWING TITLE:			CALIFORNIA • RENO 800.486.4358		
			PROJECT LOCATION:			DOMESTIC HOT WATER FOR 140-160 STORAGE SINGLE TEMP SYSTEM W/ TEMPERING VALVE USING TWO SEALED COMBUSTION HEATERS AND TWO HORIZONTAL STORAGE TANKS. CIRCUIT SETTER TEMPERATURE PROTECTION TO HEATERS			WASHINGTON • OREGON ALASKA • IDAHO • MONTANA 888.690.0090		
			ENGINEER:			DRAWING No. D140-160-S2-200-2H-CS			REV A		
			CUSTOMER:			DRAWN BY/DAT DK 02/23/09			CHECKED/ APPROVED/DEC. 500"		
			DESCRIPTION			BY			DATE		
REV											