


*BALANCE VALVE "A" AND "B" TO MAINTAIN MINIMUM °F INLET TEMPERATURE
BOILER MUST BE SET FOR ON/OFF FIRING MODE ONLY

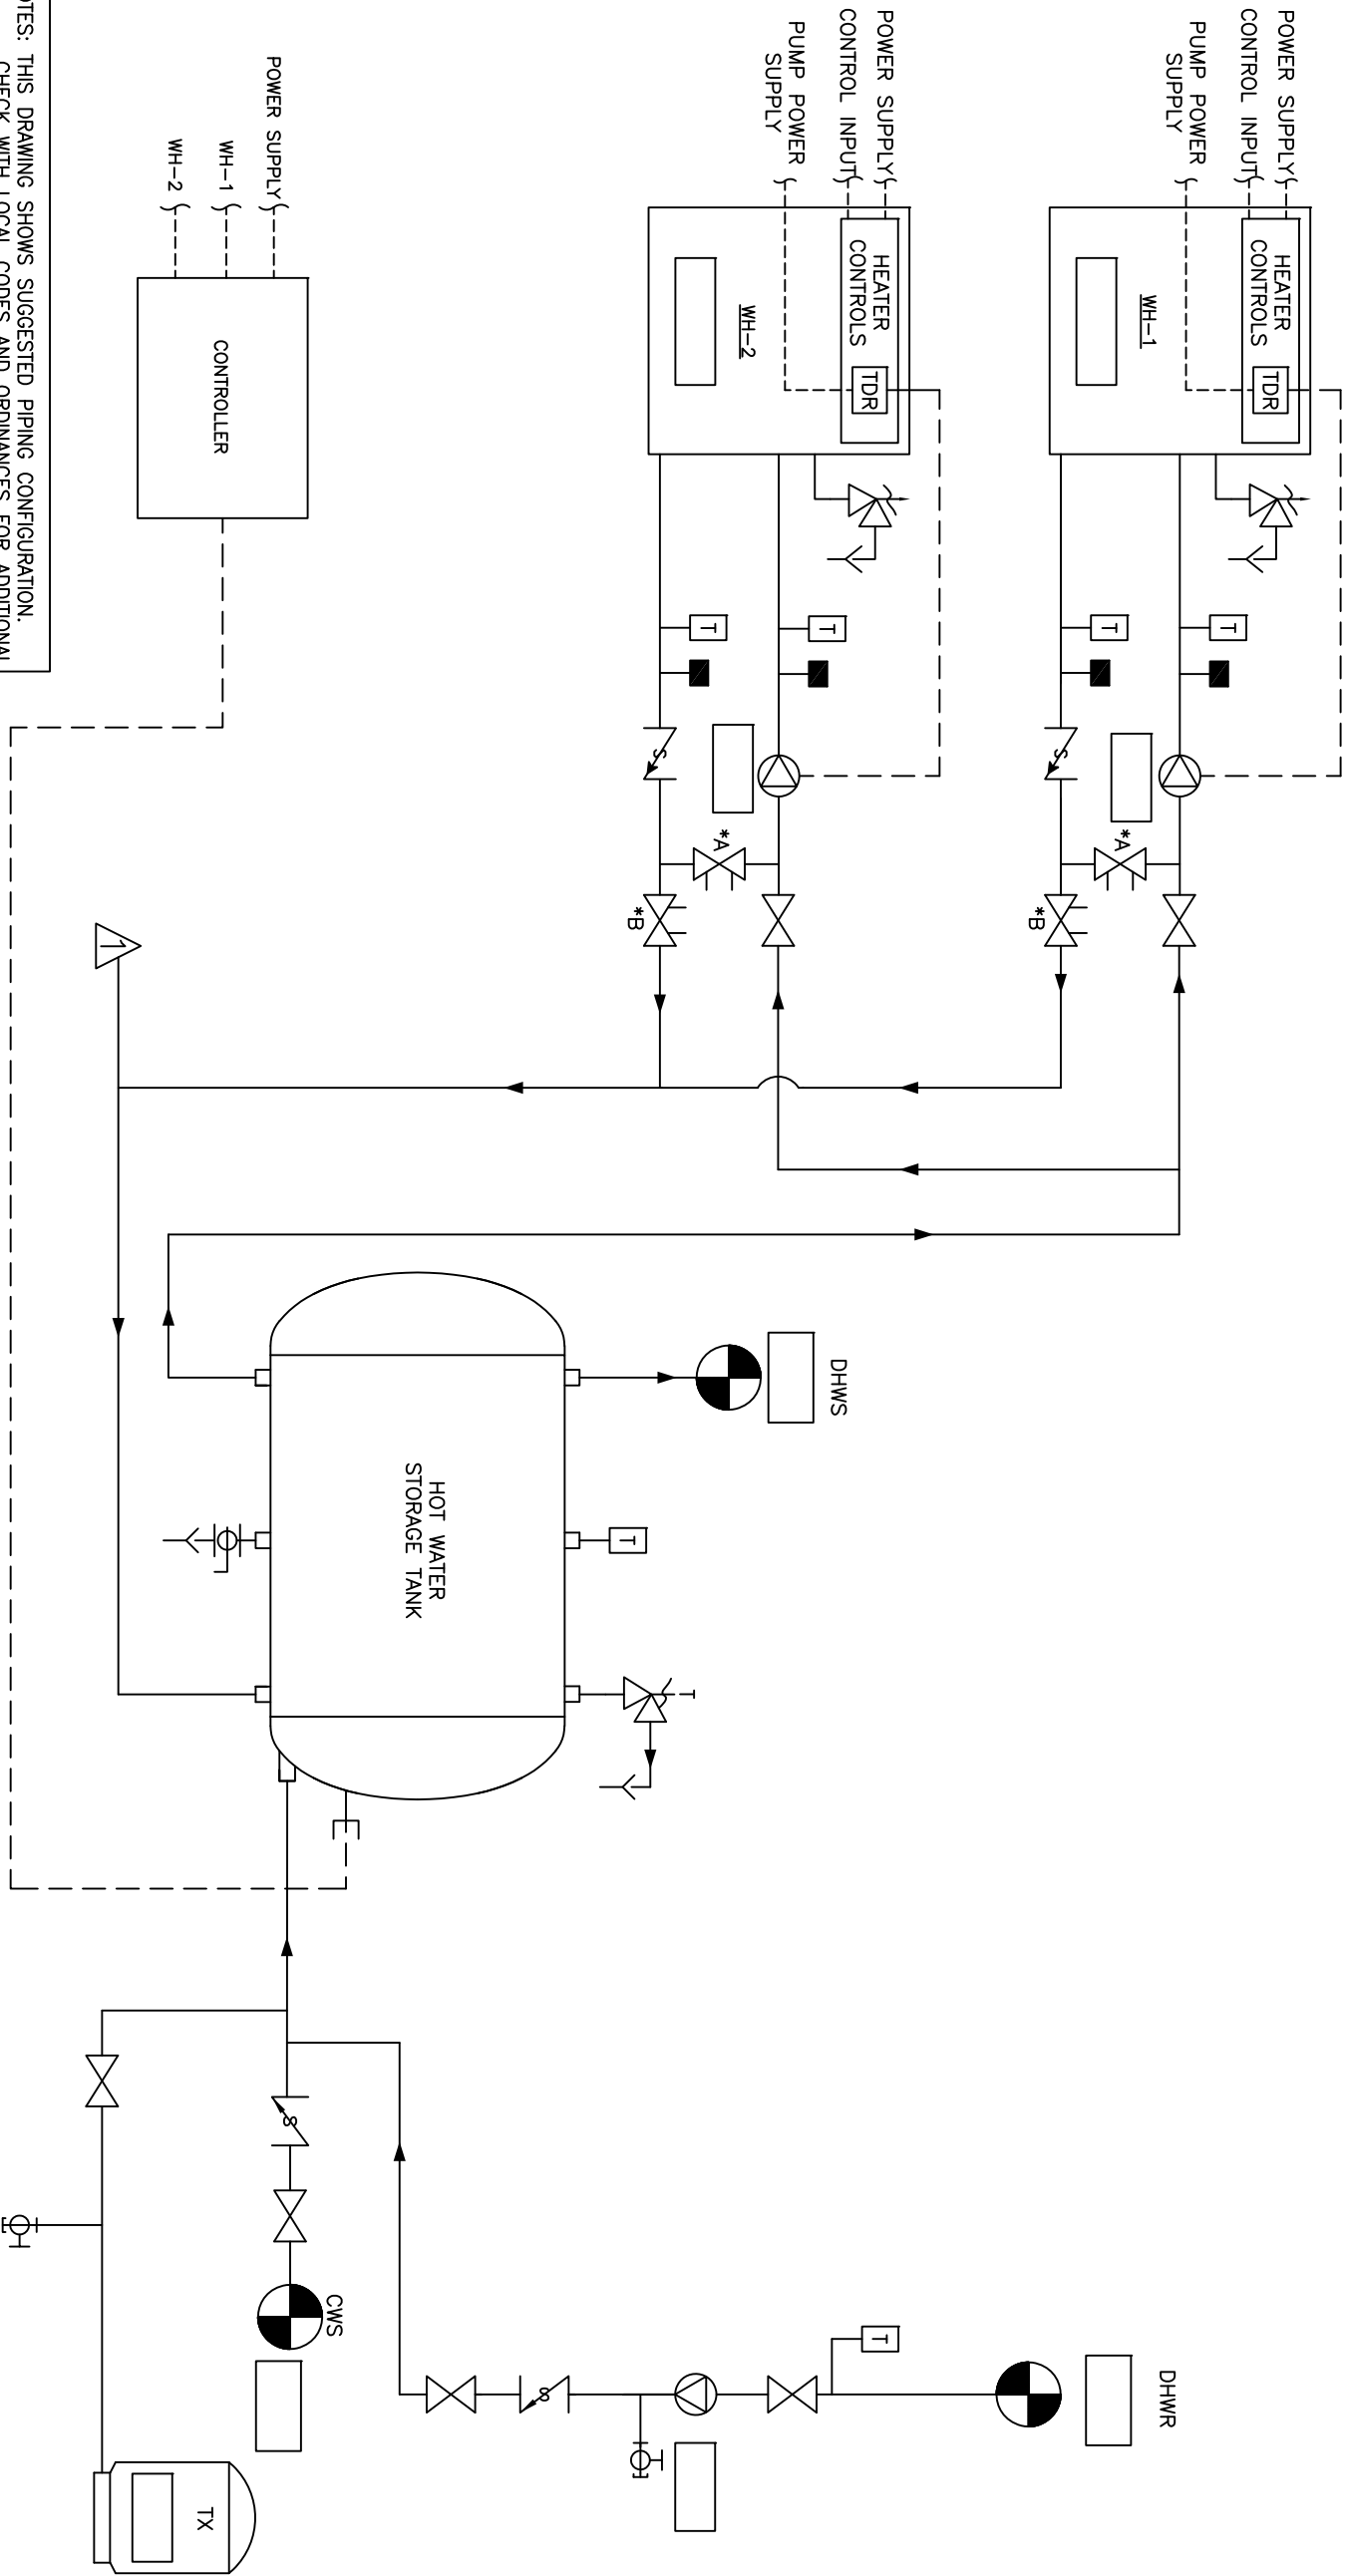

NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

1 ALTERNATE CWS AND/OR DHWR LOCATION

PROJECT NAME:		DRAWING TITLE:	
PROJECT LOCATION:		DOMESTIC HOT WATER FOR 140-160 STORAGE SINGLE TEMP SYSTEM USING TWO SEPARATE HEATERS AND ONE HORIZONTAL STORAGE TANK. CIRCUIT POWER SUPPLY FOR THE HEATERS PUMP TDR	
ENGINEER:		DRAWING No.	
CUSTOMER:		D140-160-S2-201-1H-CS	
BY		CHECKED	
DATE		APPROVED	
DESCRIPTION		TOLERANCES UNLESS OTHERWISE SPECIFIED	
		300"	
		5"	
		D	
		SCALE	
		NTS	
		REV	
		A	
		CALIFORNIA • RENO	
		800.486.4858	
		WASHINGTON • OREGON	
		ALASKA • IDAHO • MONTANA	
		888.690.0090	