


1 ALTERNATE CWS AND/OR DHWR LOCATION



NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.  
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

			THIS DRAWING AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF CHC, CALIFORNIA HYDROTECHNICS CORP. - CONFERENCE AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT PRIOR WRITTEN PERMISSION OF CHC.									
			PROJECT NAME:									
			PROJECT LOCATION:									
			ENGINEER:									
			CUSTOMER:									
			DRAWING No. D140-160-S1-400-1V-BI									
			TOLERANCES UNLESS OTHERWISE SPECIFIED									
			DRAWN BY/DATE: 14/06/09									
			CHECKED/DATE: 14/06/09									
			300"									
			5"									
			D									
			SCALE									
			NTS									
			REV									
			A									
			DESCRIPTION									
			BY									
			DATE									
			THIS DRAWING AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF CHC, CALIFORNIA HYDROTECHNICS CORP. - CONFERENCE AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT PRIOR WRITTEN PERMISSION OF CHC.									

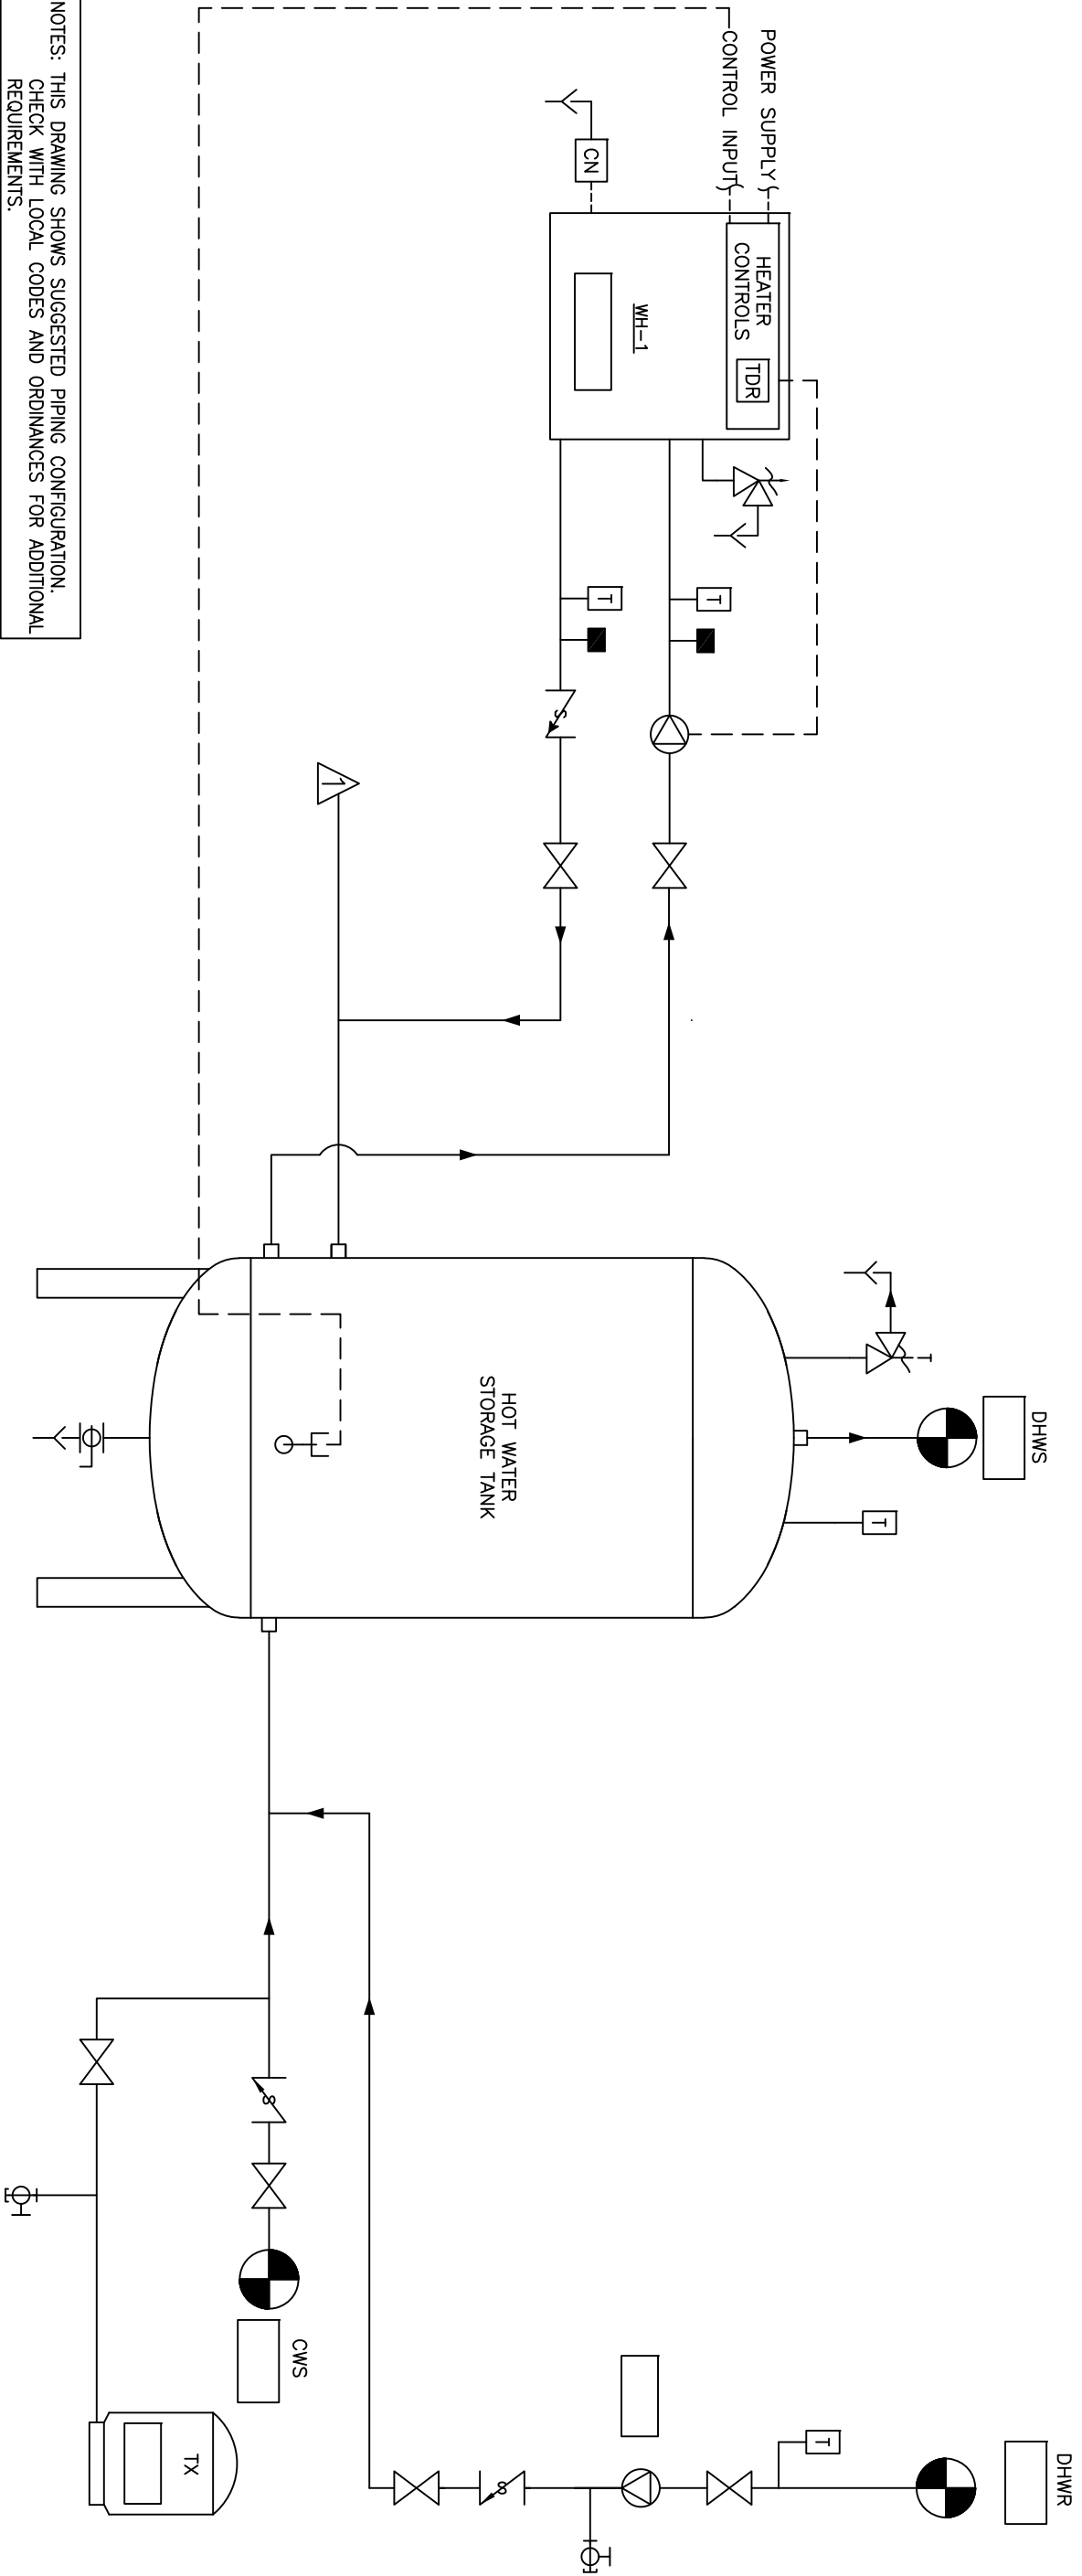

CHC

CALIFORNIA • RENO  
800.486.4858  
WASHINGTON • OREGON  
ALASKA • IDAHO • MONTANA  
888.690.0090