


ALTERNATE CWS AND/OR DHWR LOCATION



NOTES: THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION.
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

PROJECT NAME:		THIS DRAWING AND THE INFORMATION DEPICTED THEREIN IS THE PROPERTY OF CHC. IT IS TO BE USED FOR THE PROJECT ONLY. NO PARTS OF THIS DRAWING ARE TO BE REPRODUCED OR COPIED, OR USED AS THE BASIS FOR THE MANUFACTURING, INSTALLATION, OR MAINTENANCE OF ANY SYSTEM WITHOUT PRIOR WRITTEN PERMISSION OF CHC.	
PROJECT LOCATION:		DRAWING TITLE: DOMESTIC HOT WATER FOR 160-190 STORAGE SINGLE TEMP SYSTEM USING TWO ATMOSPHERIC HEATERS AND TWO VERTICAL STORAGE TANKS. NO TEMPERATURE PROTECTION TO HEATERS AND REQUIRES A SEPARATE POWER SUPPLY FOR THE HEATER PUMP TDR	
ENGINEER:		DRAWING No. D160-190-S2-101-2V-XX	
CUSTOMER:		DRAWN BY/DATE: [blank] / 06/09 CHECKED/REVIEWED/DATE: [blank] 500' SCALE: 1"=500'	
BY		DATE	
DESCRIPTION		REV	
REV		DESCRIPTION	

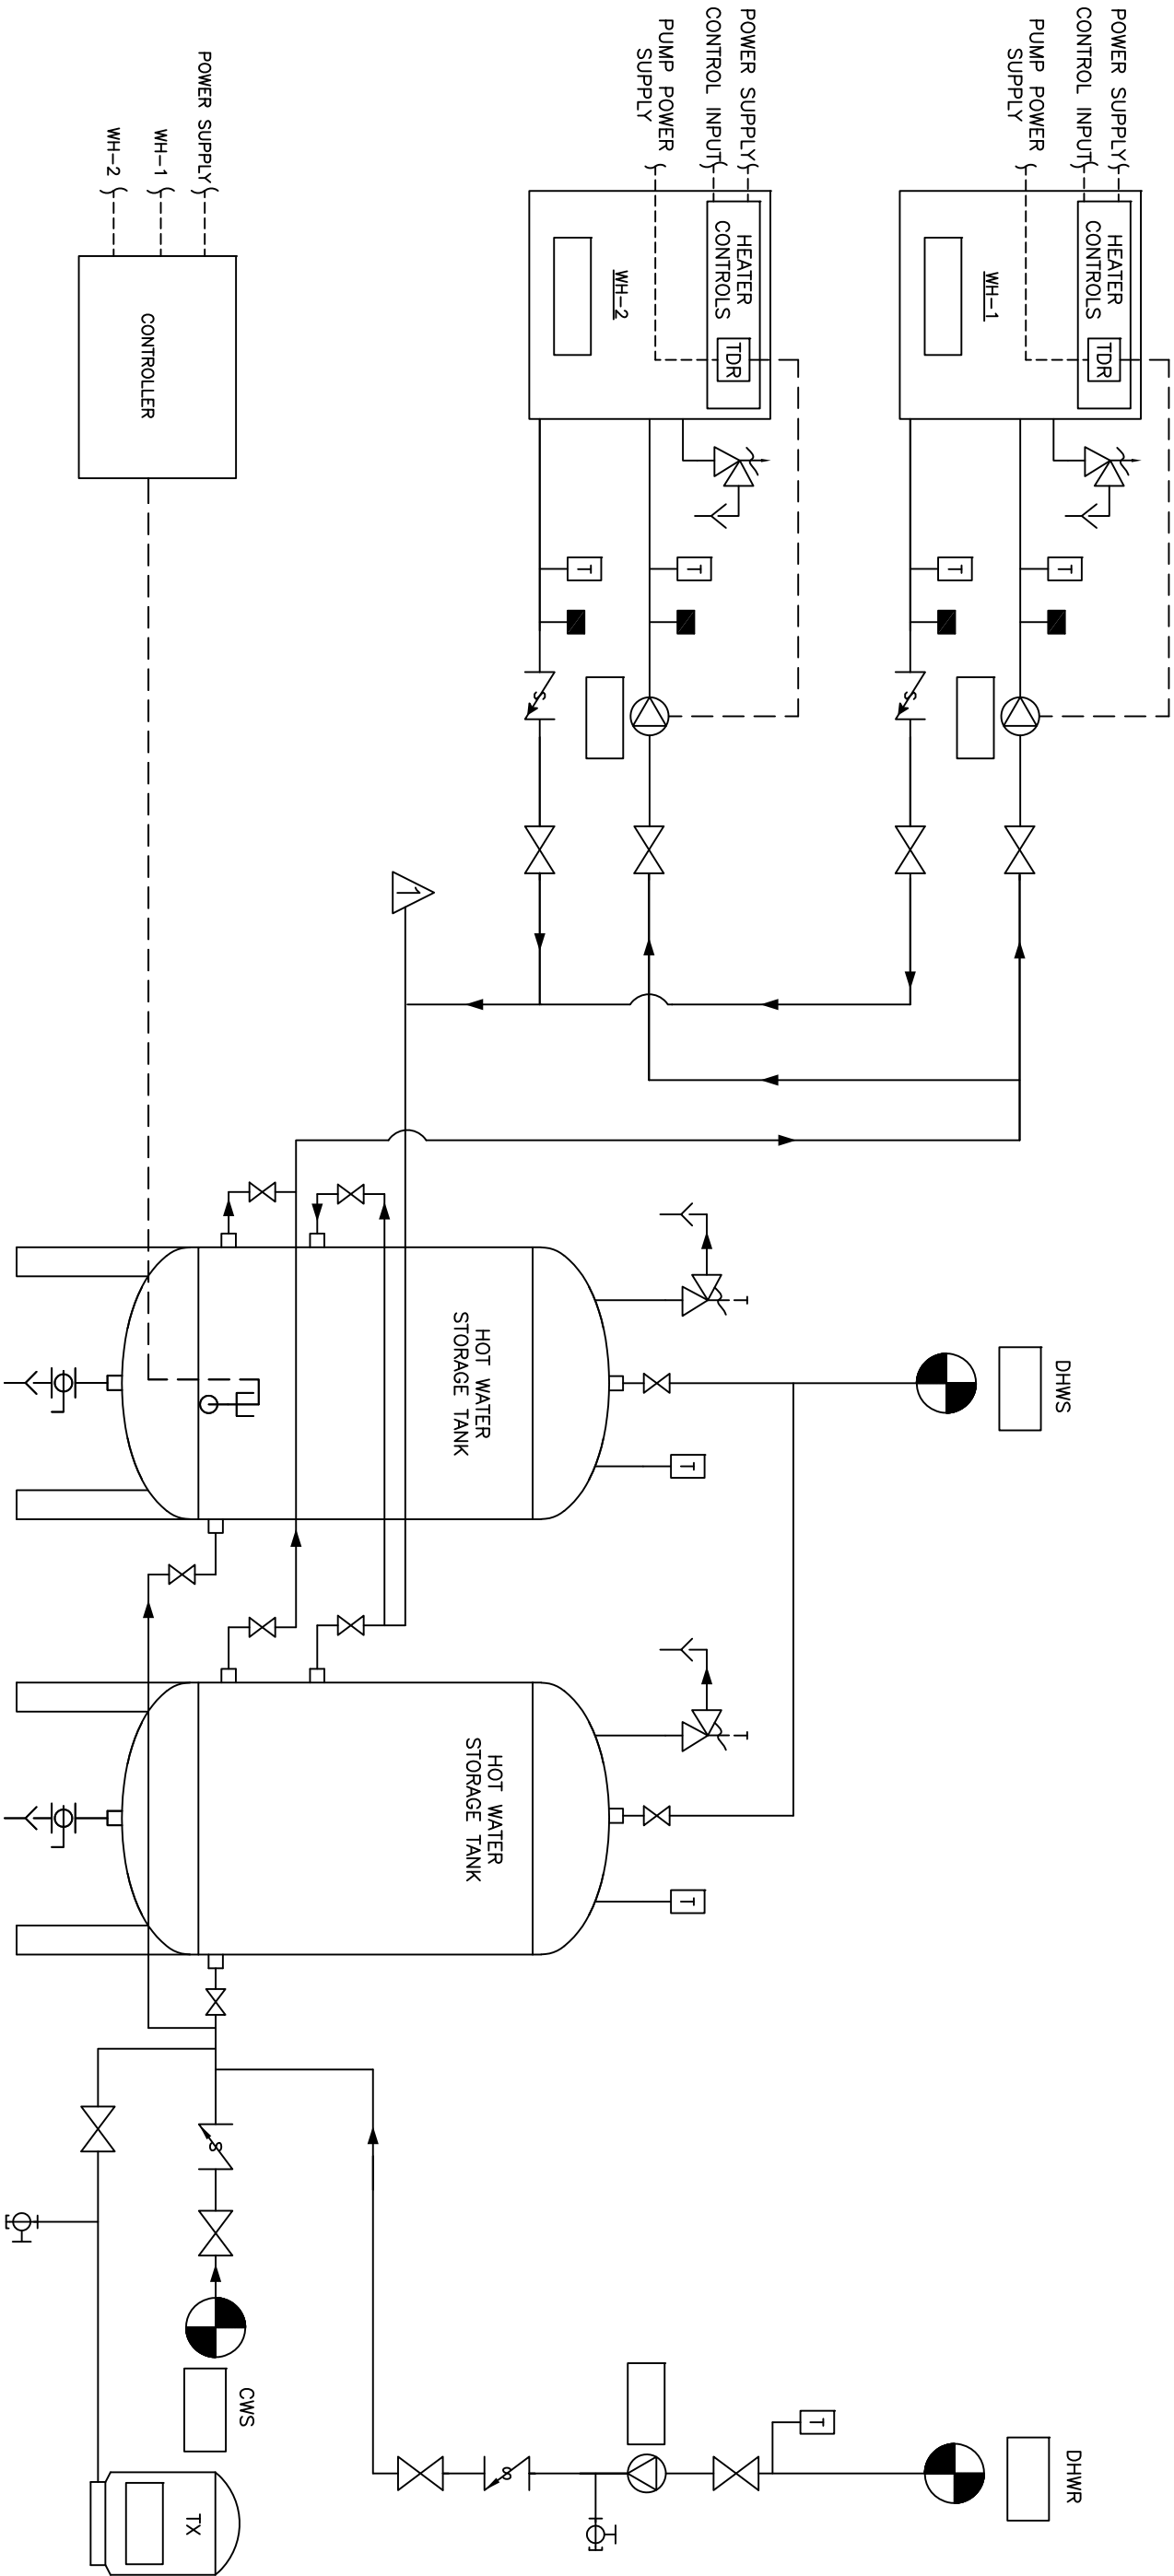

CHC

CALIFORNIA • RENO
800.486.4858
WASHINGTON • OREGON
ALASKA • IDAHO • MONTANA
888.690.0090