


Recs all piping to be sized per ASHRAE F36.

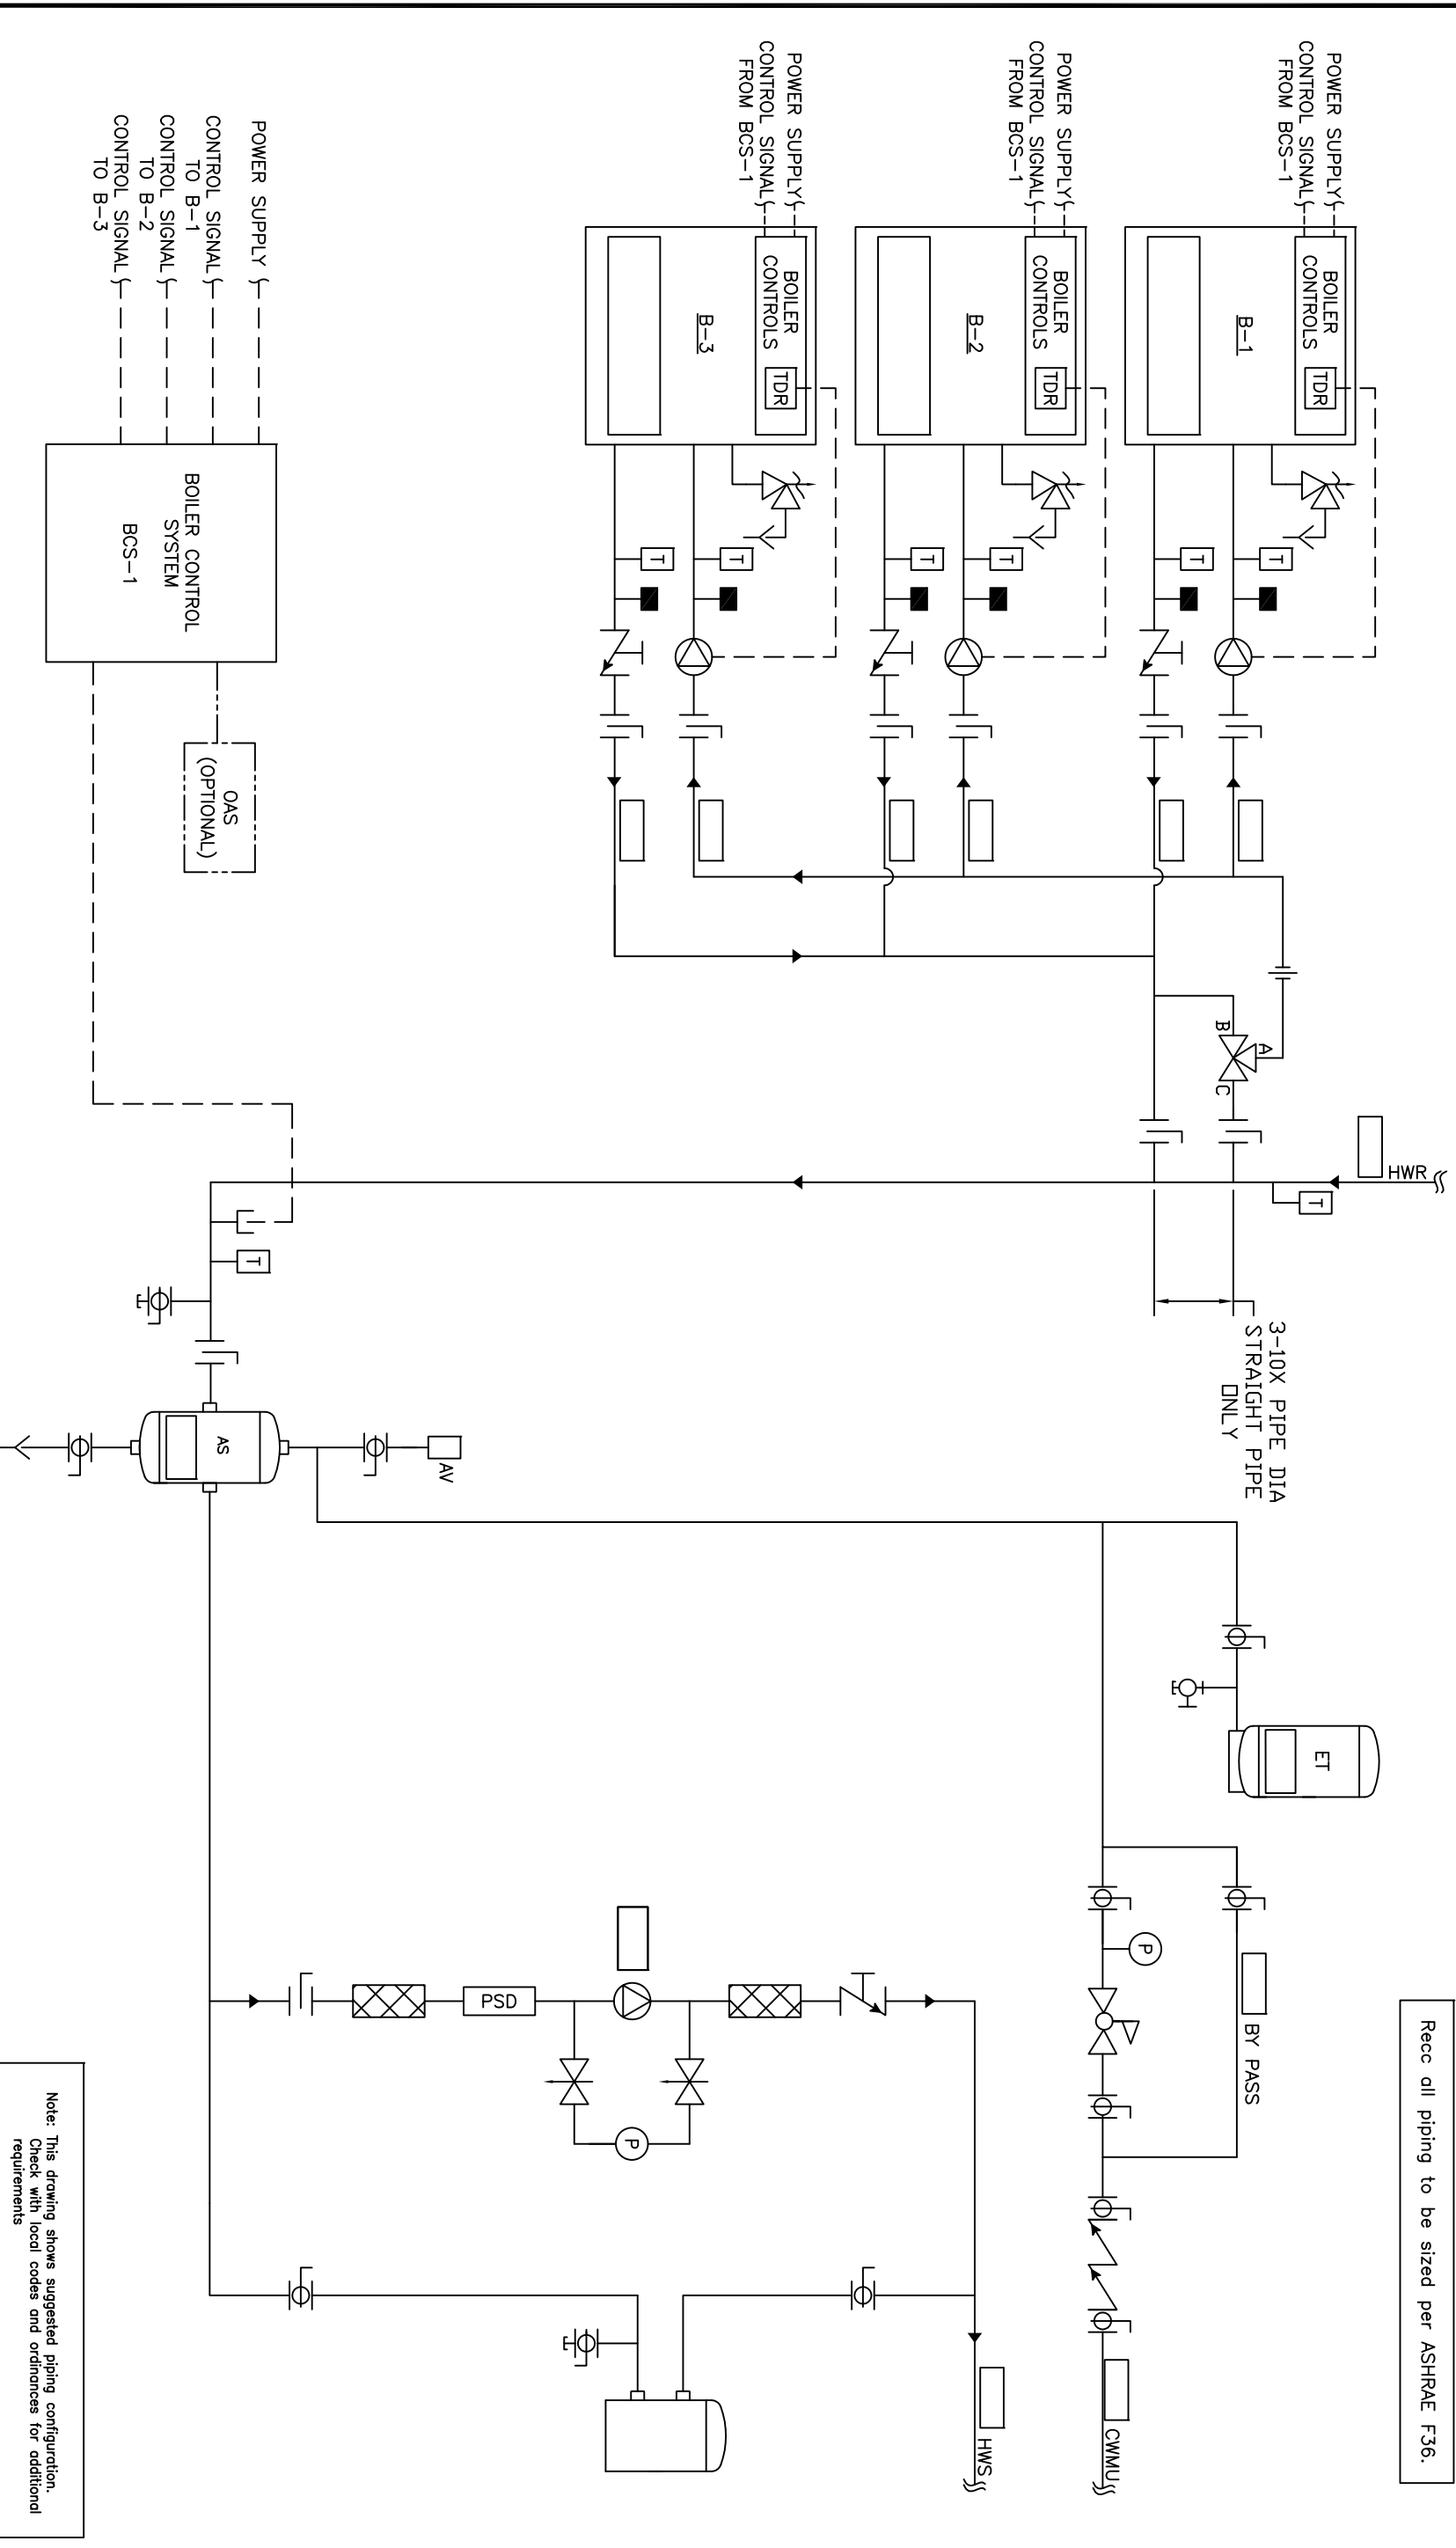

Note: This drawing shows suggested piping configuration. Check with local codes and ordinances for additional requirements.

<p>THIS DRAWING AND THE INFORMATION DEPICTED THEREIN IS THE PROPERTY OF CHC, CALIFORNIA HYDRONICS CORP., AND SHALL NOT BE REPRODUCED OR USED AS THE BASIS FOR THE MANUFACTURING, INSTALLATION OR SALE OF PRODUCT WITHOUT WRITTEN PERMISSION OF CHC.</p>	
PROJECT NAME:	HYDRONIC PRIMARY/SECONDARY - 3 SEALED COMBUSTION BOILERS, COMMON FPE VALVE, WITH SYSTEM PUMP
PROJECT LOCATION:	
ENGINEER:	RSG 05/28/08
CUSTOMER:	
BY:	
DATE:	
REV	DESCRIPTION
A	RELEASED

CHC
 CALIFORNIA • RENO
 800.486.4858
 WASHINGTON • OREGON
 ALASKA • IDAHO • MONTANA
 888.690.0090

DRAWING TITLE:	HYDRONIC PRIMARY/SECONDARY - 3 SEALED COMBUSTION BOILERS, COMMON FPE VALVE, WITH SYSTEM PUMP
DRAWING No.	H-PS-200-3CF-1
DESIGNED BY:	RSG
CHECKED BY:	
DATE:	05/23/08
TOLERANCES UNLESS OTHERWISE SPECIFIED:	SIZE D
SCALE:	AS SHOWN