


Rec all piping to be sized per ASHRAE F36.



Note: This drawing shows suggested piping configuration. Check with local codes and ordinances for additional requirements.

| | | | |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|
| <p>THIS DRAWING AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF CHC, CALIFORNIA HYDRAONICS CORP. NO PARTS OF THIS DRAWING OR INFORMATION CONTAINED HEREIN ARE TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT PRIOR WRITTEN PERMISSION OF CHC.</p> | | <p>PROJECT NAME: HYDROVIC PRIMARY/SECONDARY - 3 SEALED COMBUSTION BOILERS WITH SEPARATE PRIMARY PUMP POWER, COMMON FPE VALVE, WITH SYSTEM PUMP</p> | |
| <p>PROJECT LOCATION: ENGINEER: CUSTOMER:</p> | | <p>DRAWING No. H-PS-201-3CF-1 TOLERANCES UNLESS OTHERWISE SPECIFIED DRAWN BY/DATE: [blank]/05/29/08 CHECKED/DATE: [blank]/[blank]/[blank] 500" 5" 0" SCALE NTS</p> | |
| <p>REV A RELEASED</p> | | <p>REV A DATE: RSG 05/28/08</p> | |
| <p>DESCRIPTION</p> | | <p>BY</p> | |

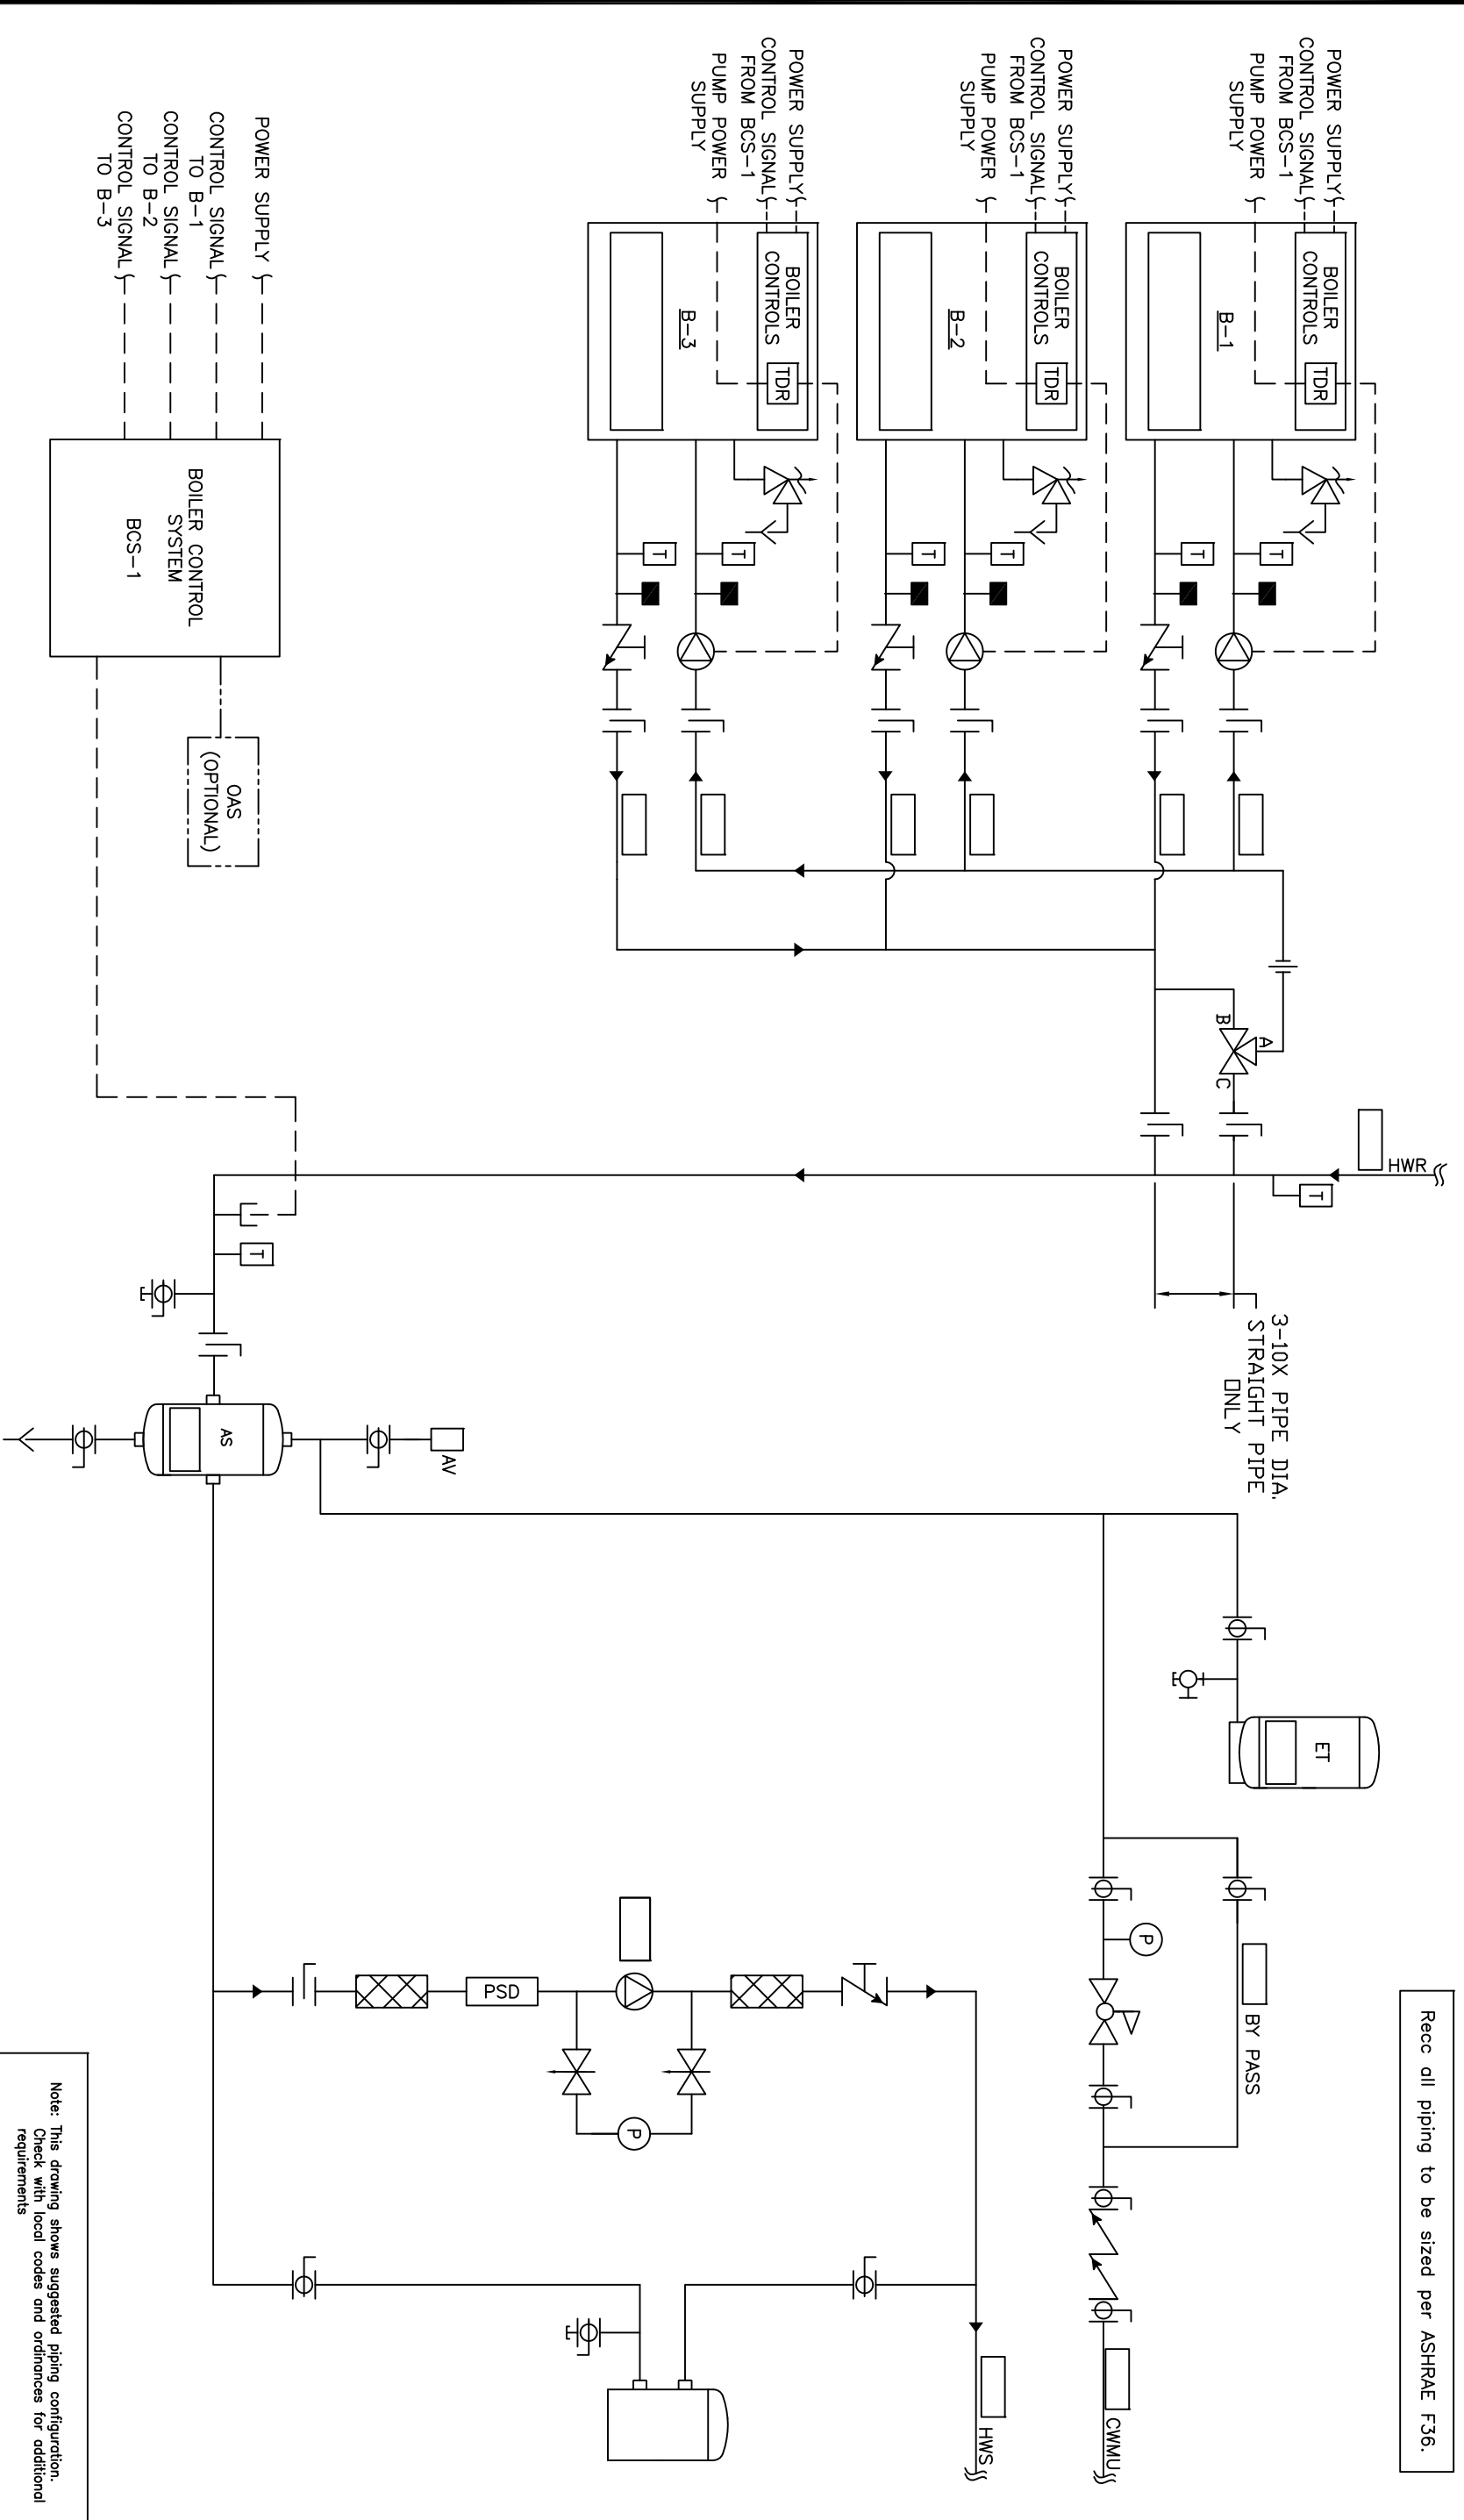