



Recc all piping to be sized per ASHRAE F36.

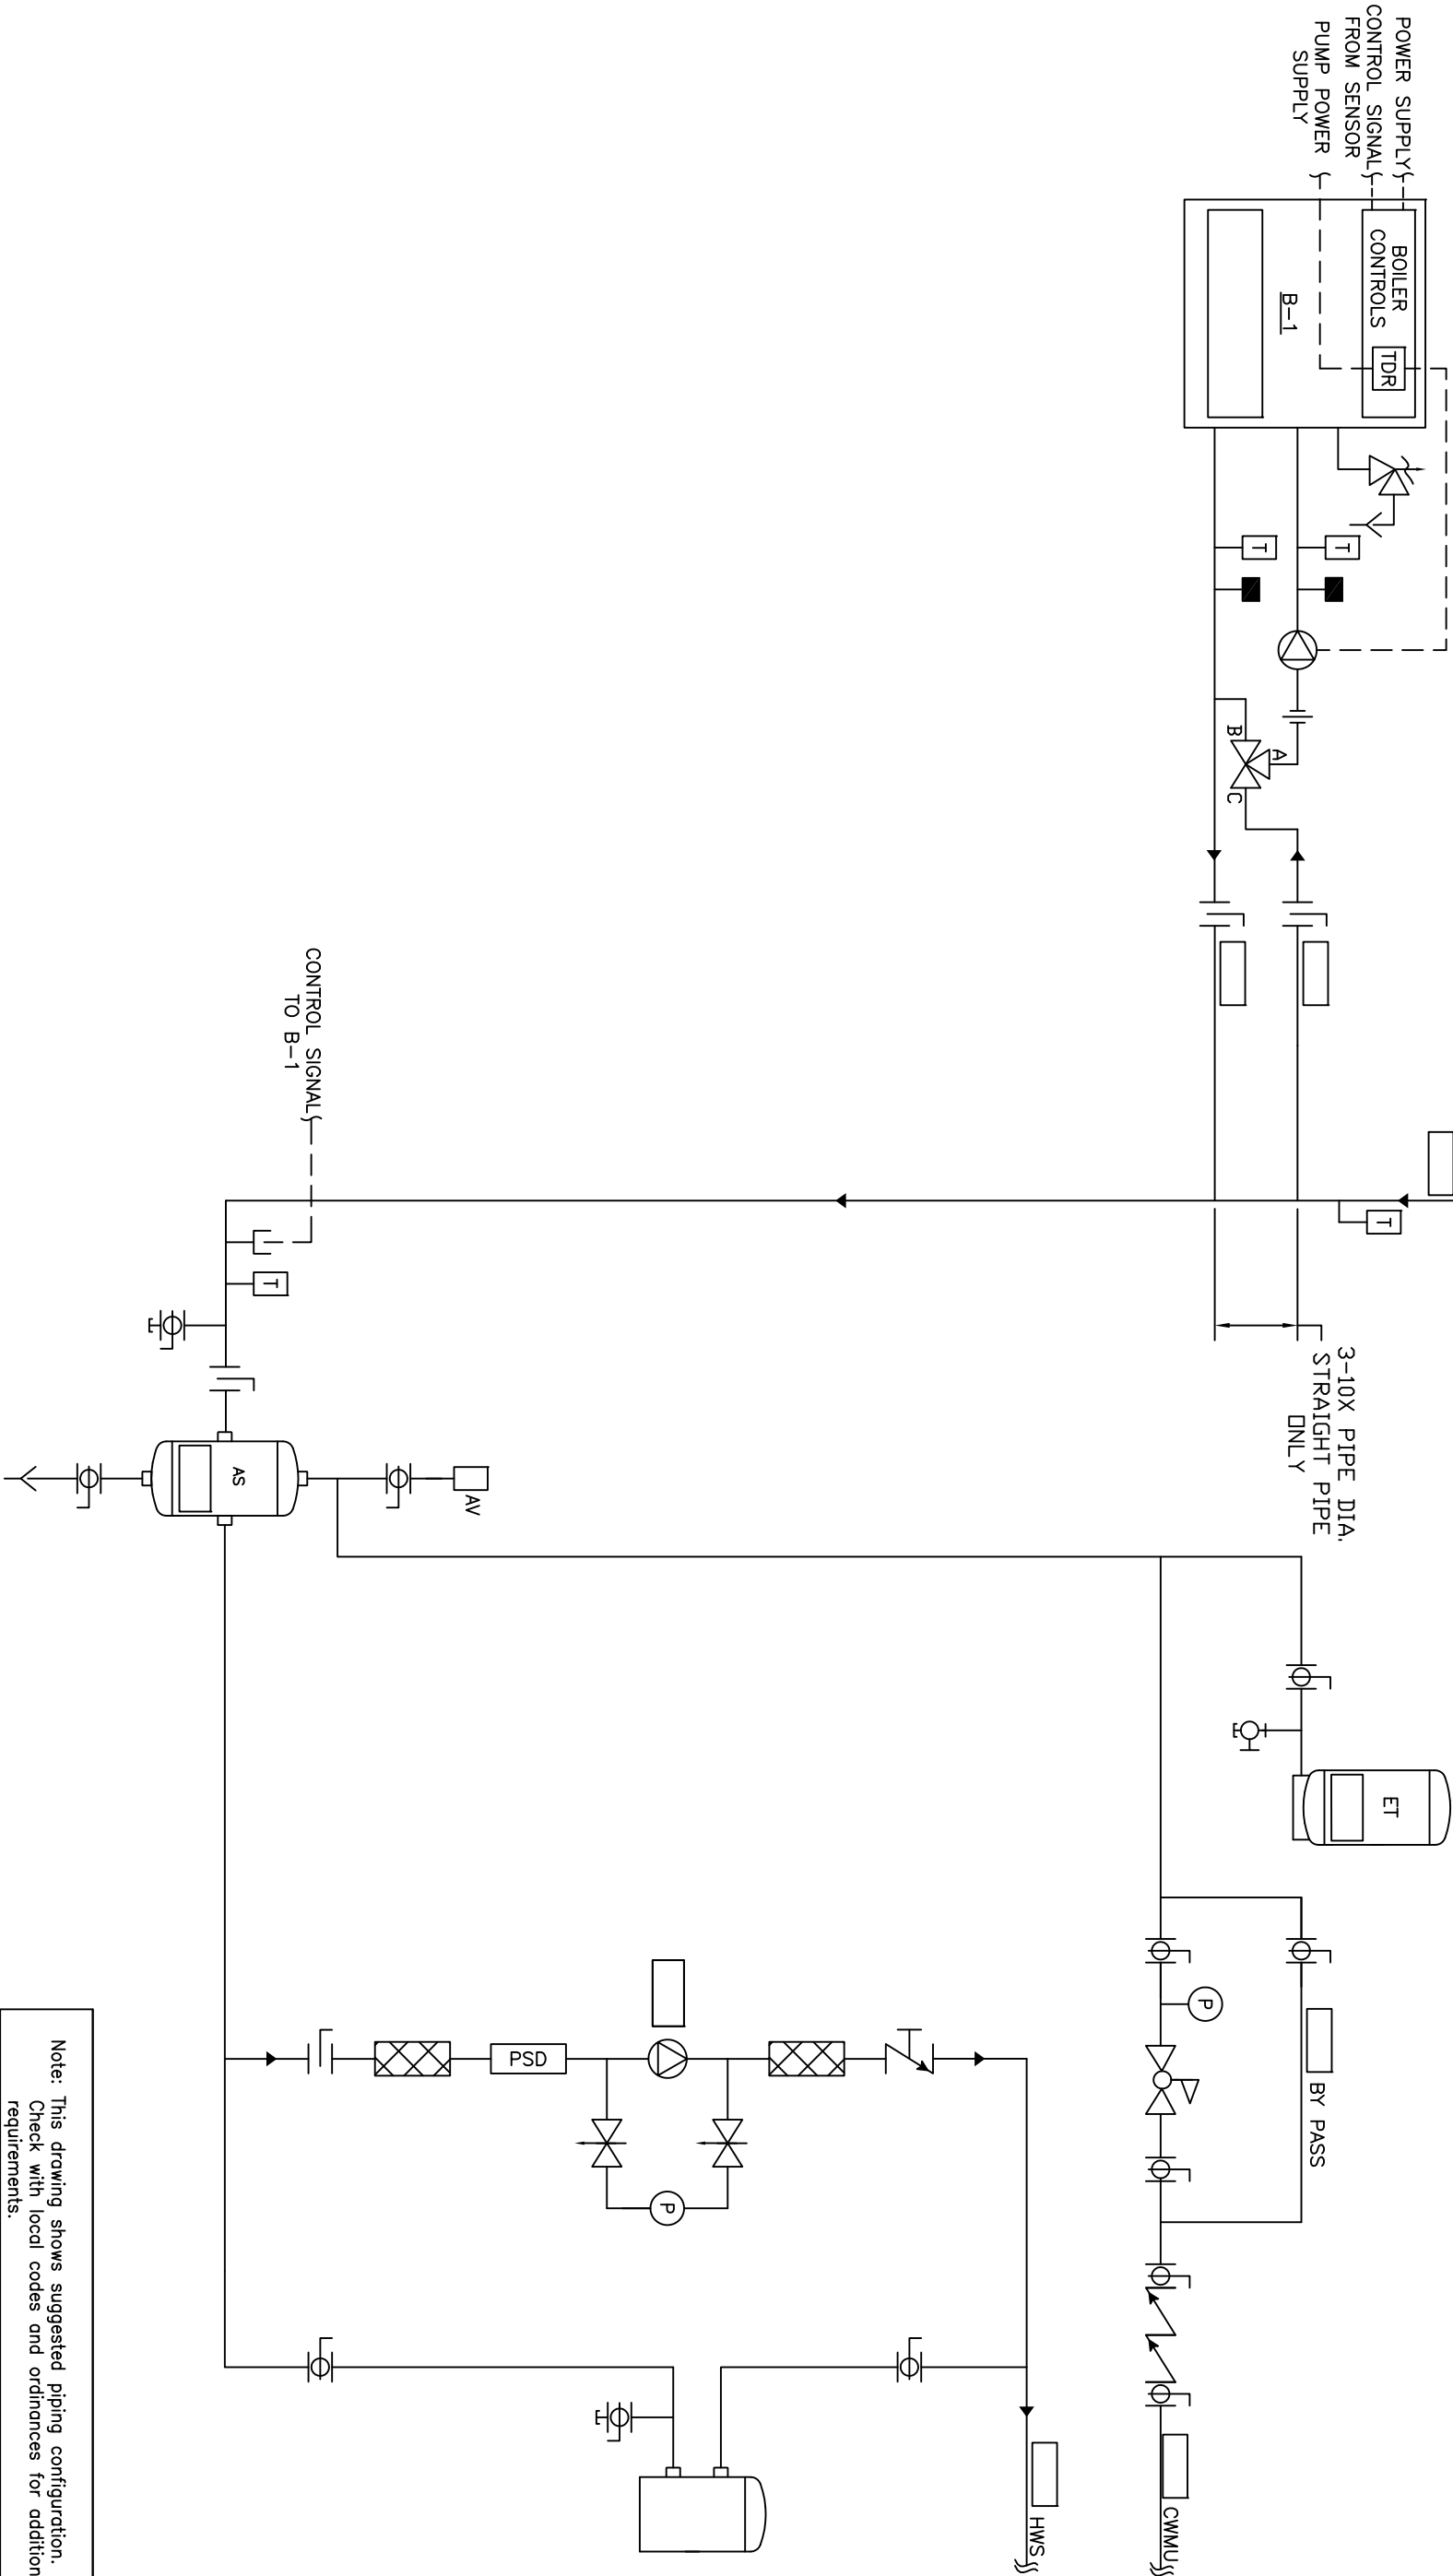

					THIS DRAWING AND THE INFORMATION DERIVED THEREIN IS THE PROPERTY OF PLUMBING SYSTEMS, A DIVISION OF FLOUTEMER INDUSTRIES CORP., AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS INSTALLATION OR SALE OF PRODUCT WITHOUT PRIOR WRITTEN PERMISSION OF CHC.				PROJECT NAME:				DRAWING TITLE:			
									PROJECT LOCATION:				HYDRONIC PRIMARY/SECONDARY – SEALED COMBUSTION BOILER, INDIVIDUAL FPE VALVE WITH SEPARATE PRIMARY PUMP POWER AND SYSTEM PUMP			
									ENGINEER:				DRAWING No. H-PS-201-11F-1			
									CUSTOMER:				TOLFRANCES UNLESS OTHERWISE SPECIFIED DRAWN BY/DATE: 05/23/08 CHECKED: APPROVED DEC: 500" ANGLE 5" SIZE D SCALE NTS			
A	RELEASED			RSG 05/28/08									REV A			
REV				BY DATE												



CALIFORNIA • RENO
800.486.4858
WASHINGTON • OREGON
ALASKA • IDAHO • MONTANA
888.690.0090

Note: This drawing shows suggested piping configuration. Check with local codes and ordinances for additional requirements.