


Recc all piping to be sized per ASHRAE F36



Note: This drawing shows suggested piping configuration. Check with local codes and ordinances for additional requirements.

REV		DESCRIPTION		BY	DATE	<p>THIS DRAWING AND THE INFORMATION OF FLOW/HEAT SYSTEMS, A DIVISION OF CHC, CALIFORNIA HYDRONICS CORP., CONFIDENCE AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS THE BASIS FOR THE MANUFACTURING, INSTALLATION OR SALE OF PRODUCT OR SERVICE WITHOUT THE WRITTEN PERMISSION OF CHC.</p>	PROJECT NAME:	DRAWING TITLE:	REV
A		RELEASED		D.K.	5/23/08		PROJECT LOCATION:	HYDRONIC VARIABLE VOLUME PRIMARY SYSTEM- 3 FULLY CONDENSING BOILERS WITH MOTORIZED VALVES AND SYSTEM PUMP	A
							ENGINEER:	H-1-VP-400-3MV-1	
							CUSTOMER:		
						DESIGNER:	D.K.	5/23/08	SCALE:
						CHECKED:			SIZE:
						APPROVED:			D
									NTS

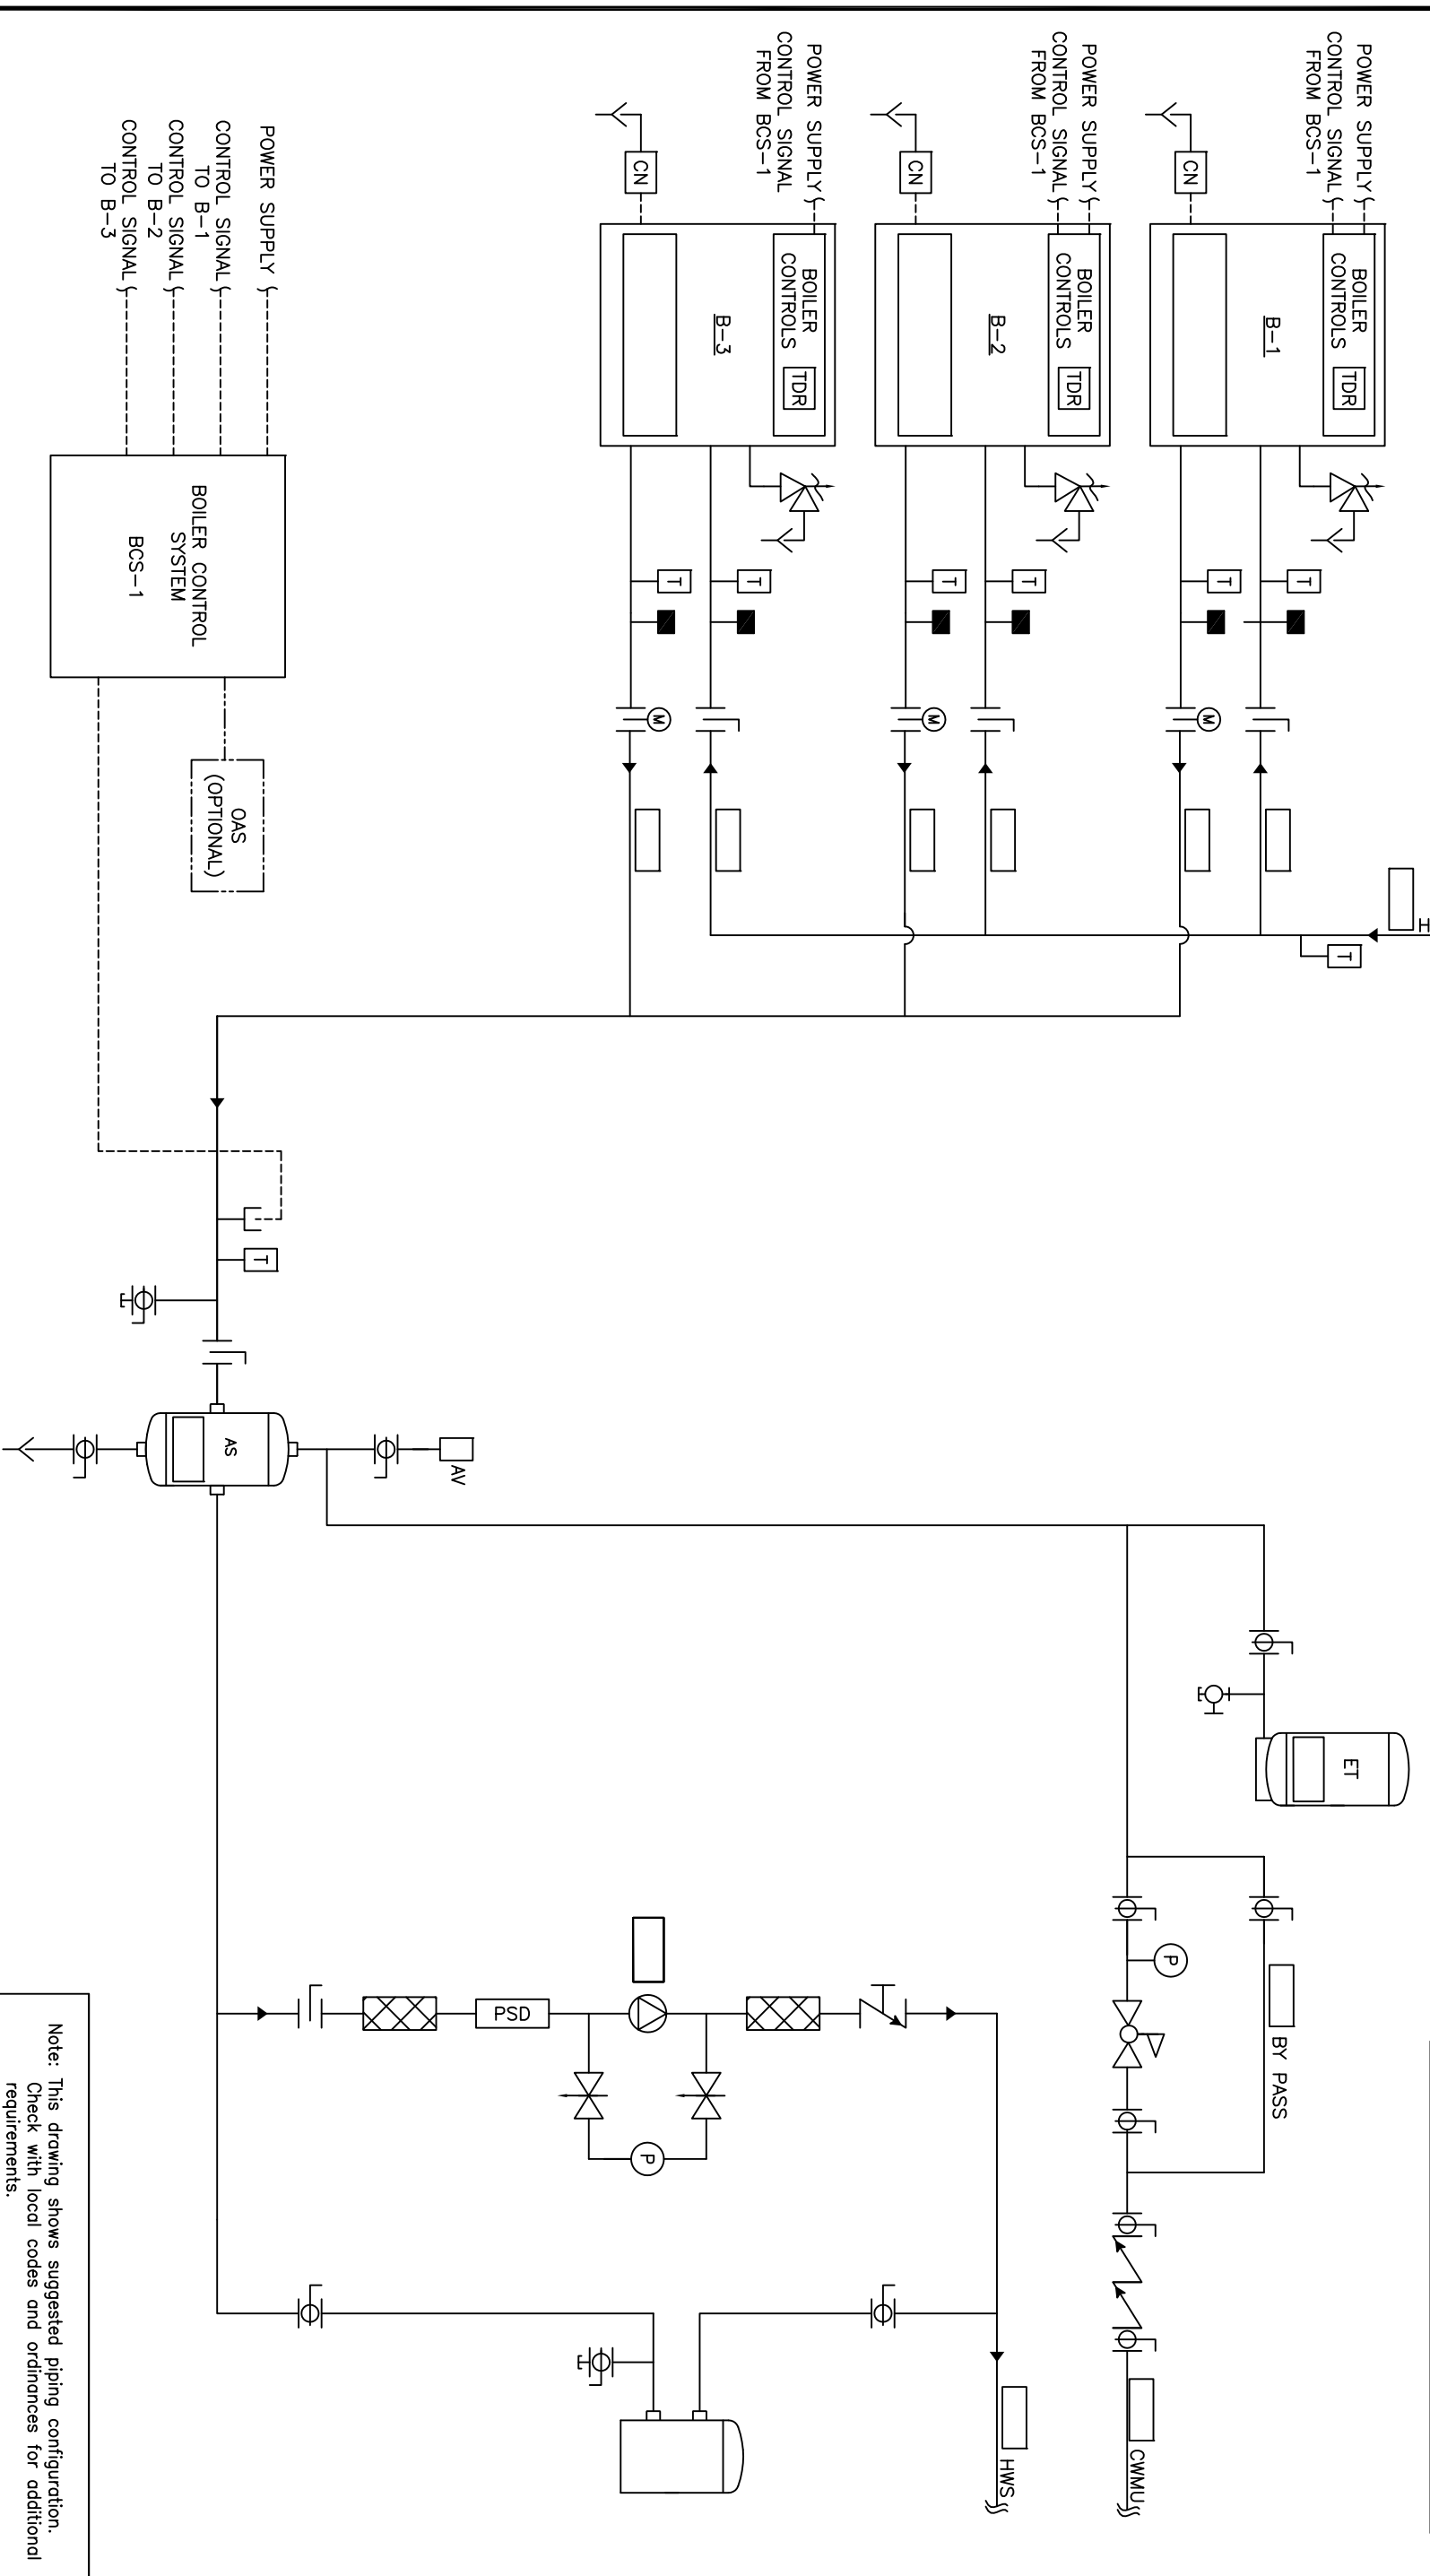