


Recc all piping to be sized per ASHRAE F36.

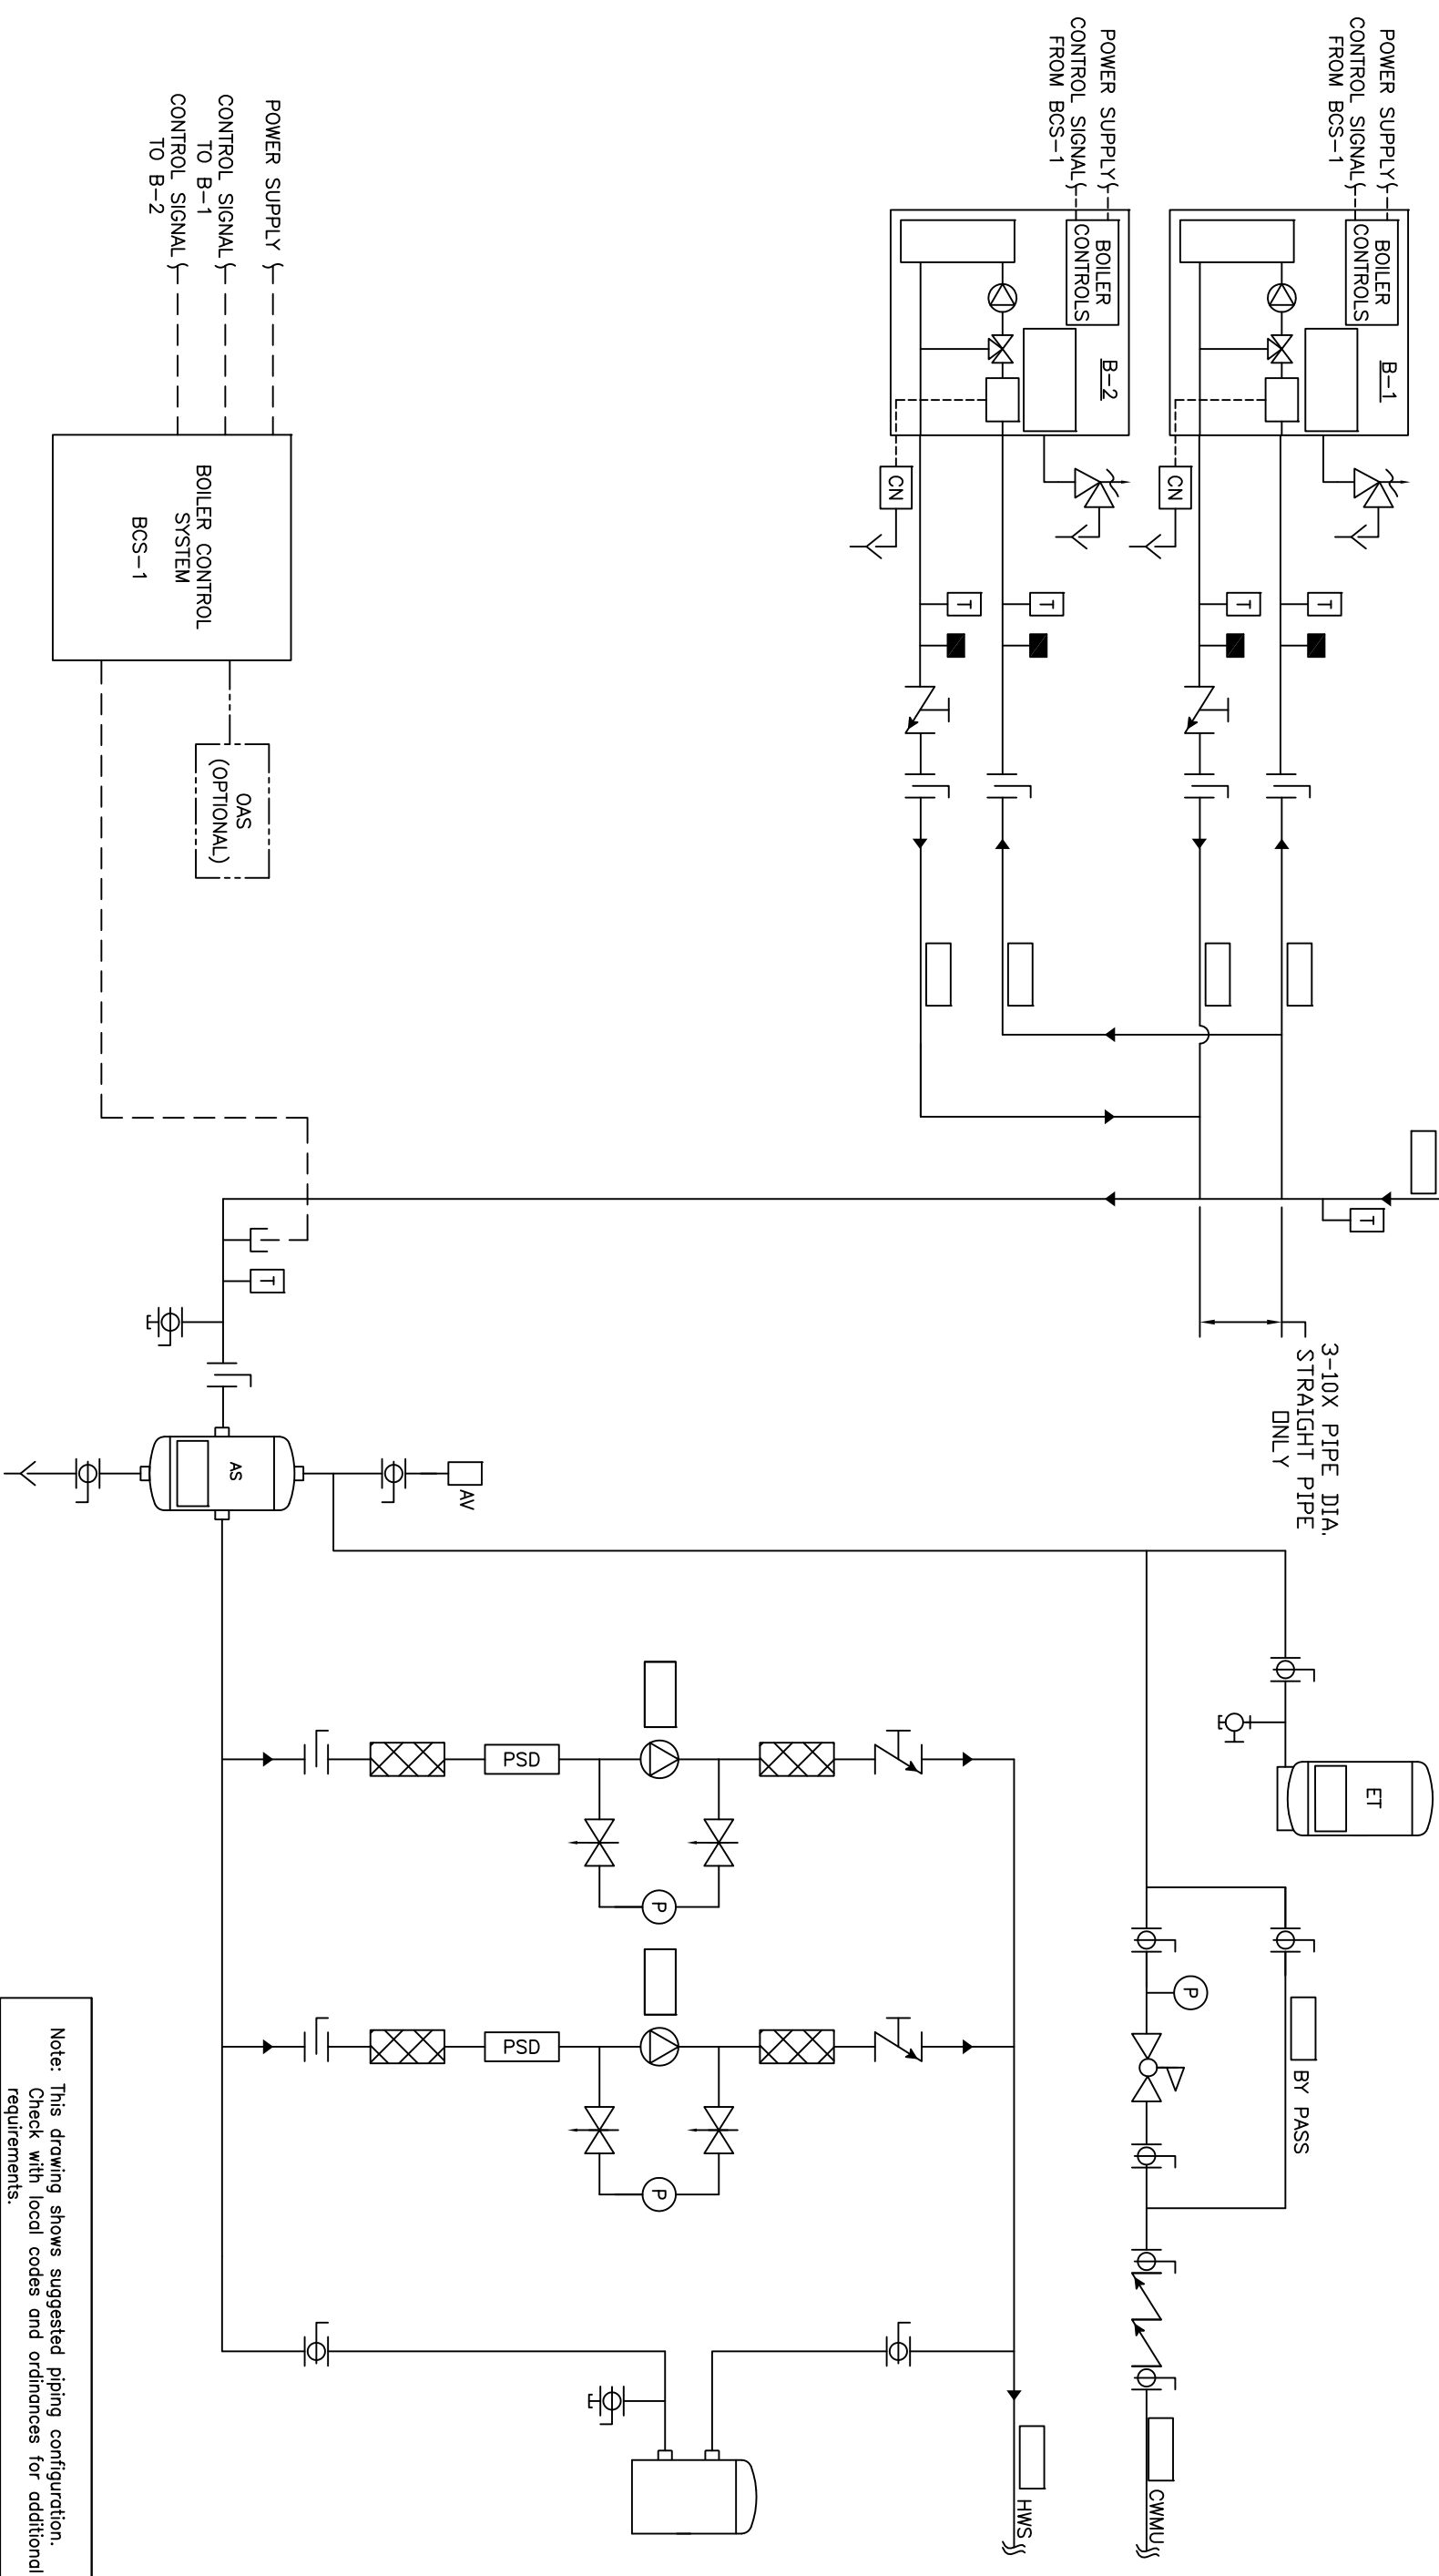

Note: This drawing shows suggested piping configuration. Check with local codes and ordinances for additional requirements.

				THIS DRAWING AND THE INFORMATION DEPICTED THEREIN IS THE PROPERTY OF CHC. IT IS NOT TO BE REPRODUCED OR COPIED IN ANY MANNER WITHOUT PRIOR WRITTEN PERMISSION OF CHC.				PROJECT NAME:				DRAWING TITLE:			
				LIMITED SYSTEMS HAS A DIVISION OF CHC. ALL SYSTEMS ARE DESIGNED TO BE USED IN STRICT CONFORMANCE WITH THE CHC SPECIFICATIONS. COPIES ARE ISSUED IN STRICT CONFORMANCE AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS THE BASIS FOR THE DESIGN, INSTALLATION OR SALE OF PRODUCT, WITHOUT PRIOR WRITTEN PERMISSION OF CHC.				PROJECT LOCATION:				HYDROIC PRIMARY/SECONDARY - 2 ECONOMIZER CONDENSING BOILERS, BUILT IN TEMP PROTECTION WITH 2 SYSTEM PUMPS			
								ENGINEER:				DRAWING No.			
A	RELEASED			RSG 05/26/08				CUSTOMER:				H-PS-300-ZBI-2			
REV				DESCRIPTION				BY				DATE			
												TOLERANCES UNLESS OTHERWISE SPECIFIED			
												DRAWN BY/DWG. 05/23/08			
												CHECKED			
												APPROVED DEC.			
												.300"			
												ANGLE			
												5			
												SIZE			
												D			
												SCALE			
												NTS			
												REV			
												A			

CHC

WASHINGTON • OREGON
ALASKA • IDAHO • MONTANA

888.699.0090

CALIFORNIA • RENO

800.486.4858