


Recc all piping to be sized per ASHRAE F36.

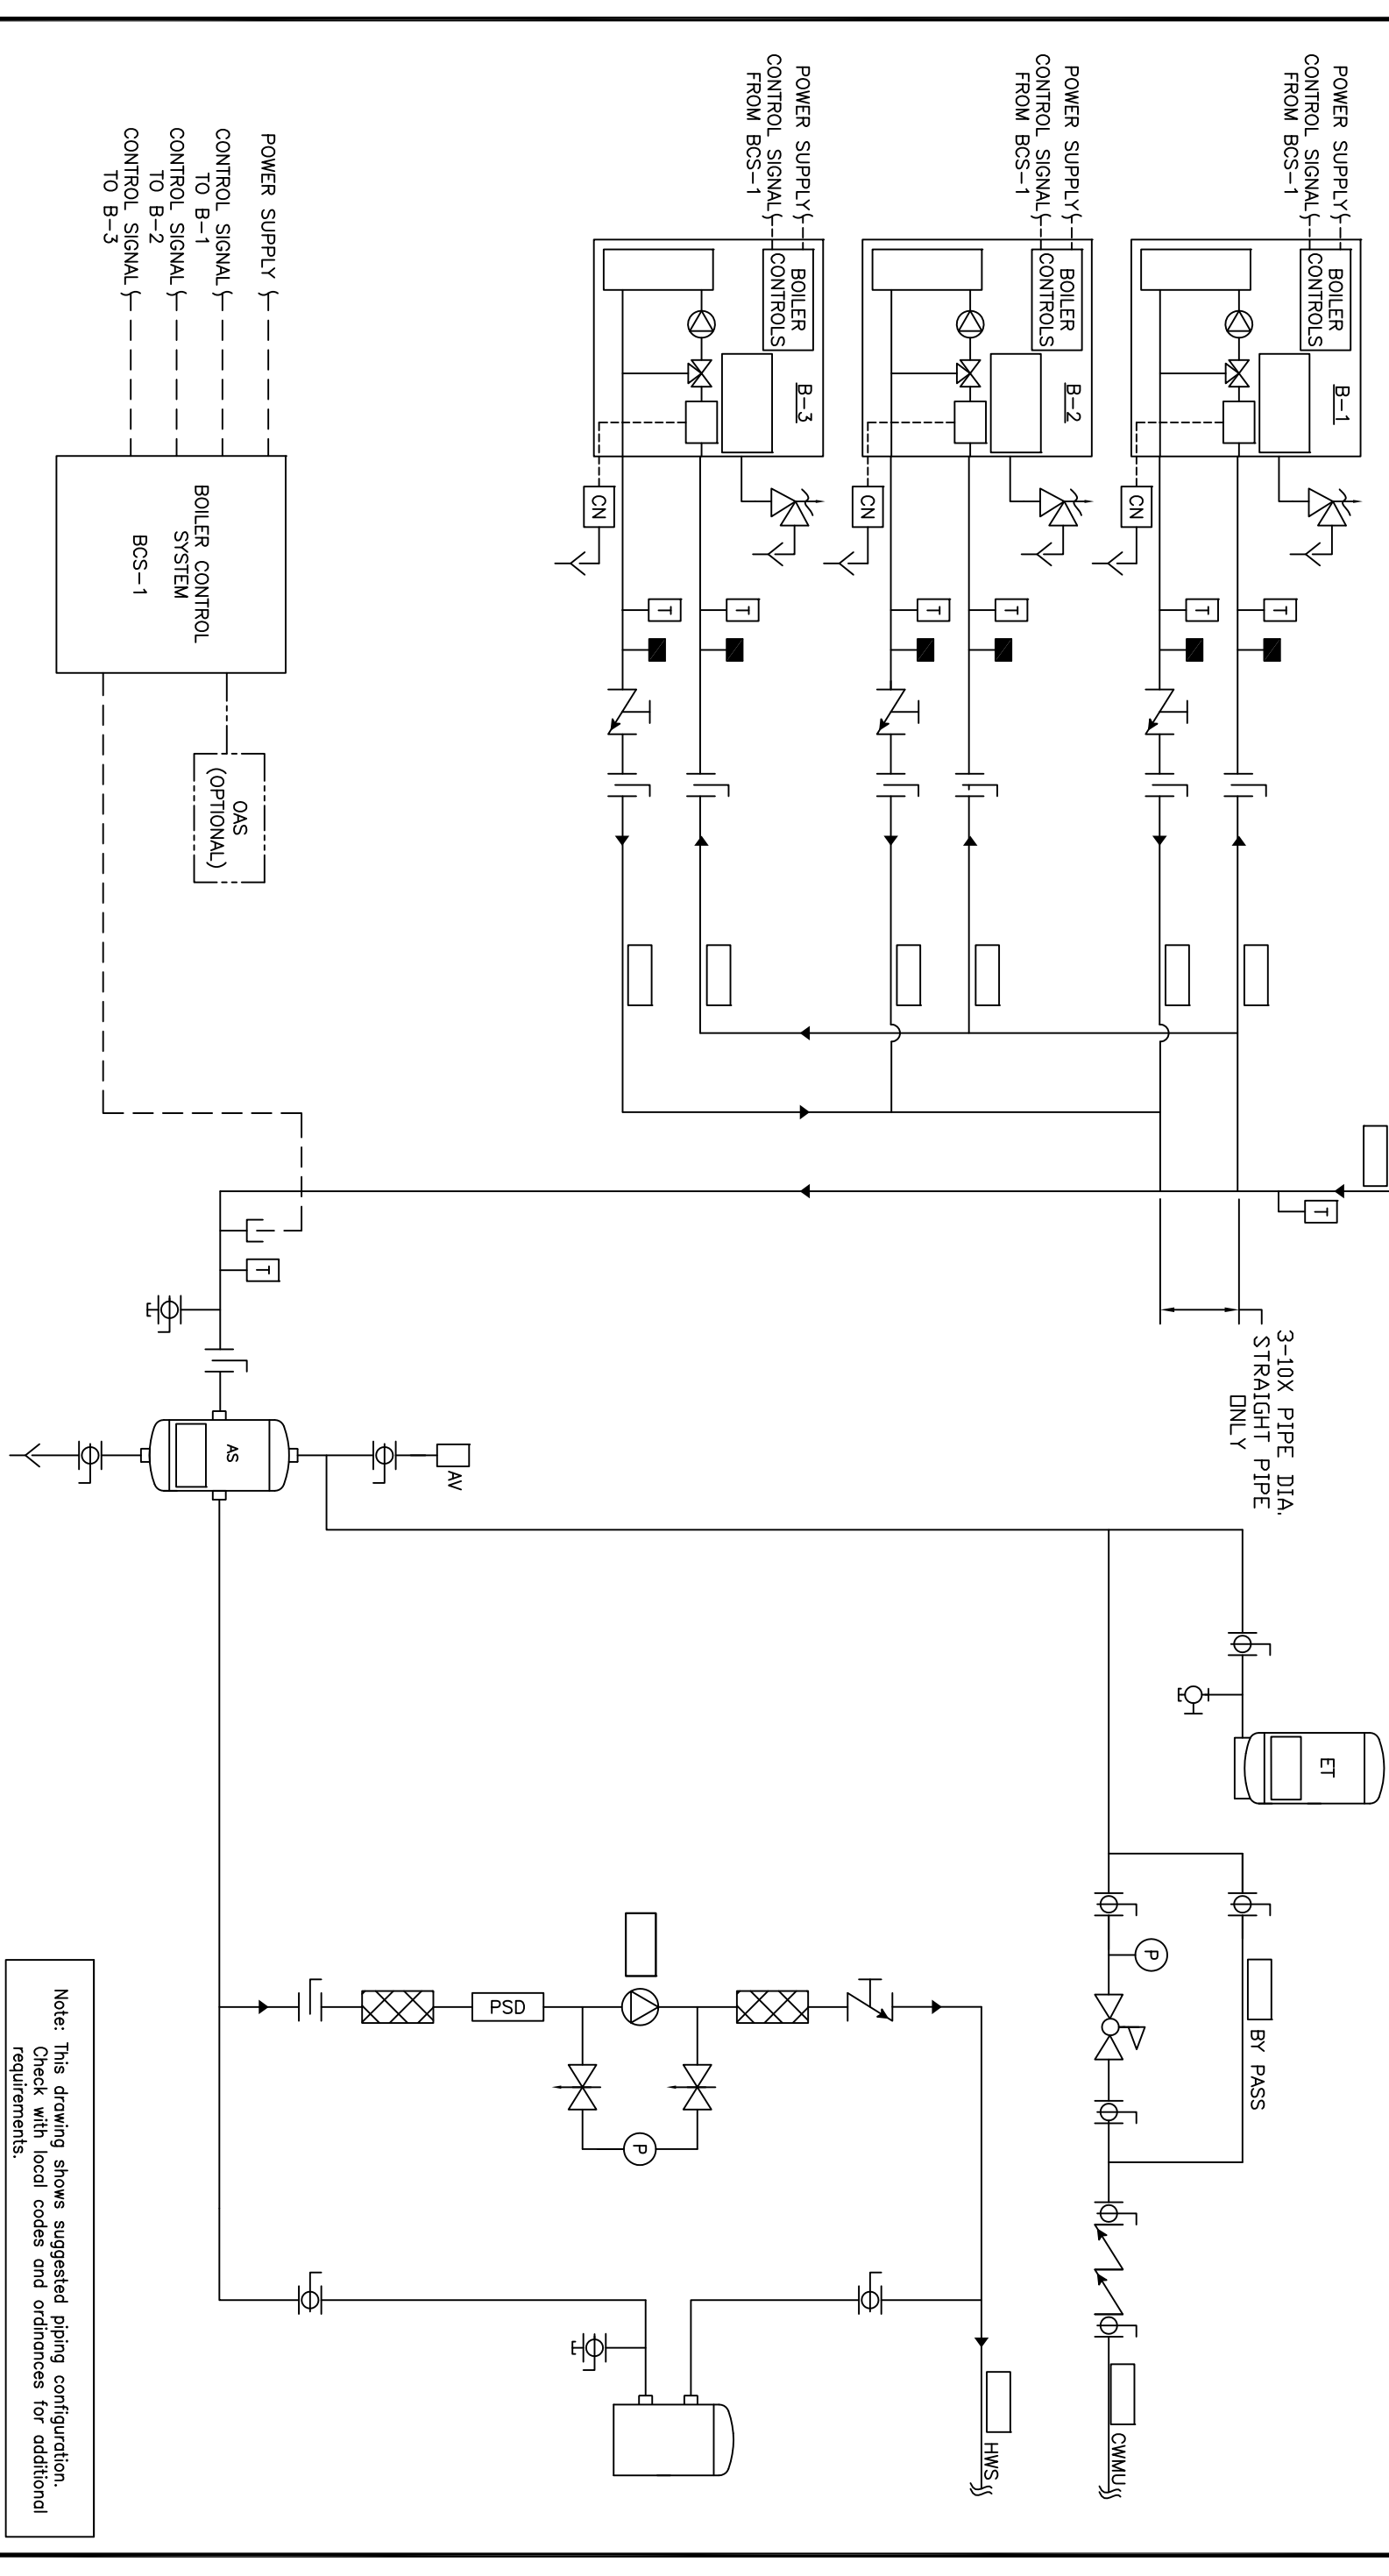

Note: This drawing shows suggested piping configuration. Check with local codes and ordinances for additional requirements.

PROJECT NAME:		DRAWING TITLE:	
PROJECT LOCATION:		HYDRONIC PRIMARY/SECONDARY - 3 ECONOMIZER CONDENSING BOILERS, BUILT IN TEMP PROTECTION WITH SYSTEM PUMP	
ENGINEER:		DRAWN BY/DWG. NO.:	
RSG 05/28/08		H-PS-300-3BI-1	
BY DATE:		CHECKED/DATE:	
DESCRIPTION:		TOLERANCES UNLESS OTHERWISE SPECIFIED:	
A RELEASED		5/8" ± .015"	
REV		ANGLE 5°	
		SIZE D	
		SCALE	
		N.T.S.	

CALIFORNIA • RENO
 800.486.4858
 WASHINGTON • OREGON
 ALASKA • IDAHO • MONTANA
 888.690.0090