


Rec all piping to be sized per ASHRAE F36.

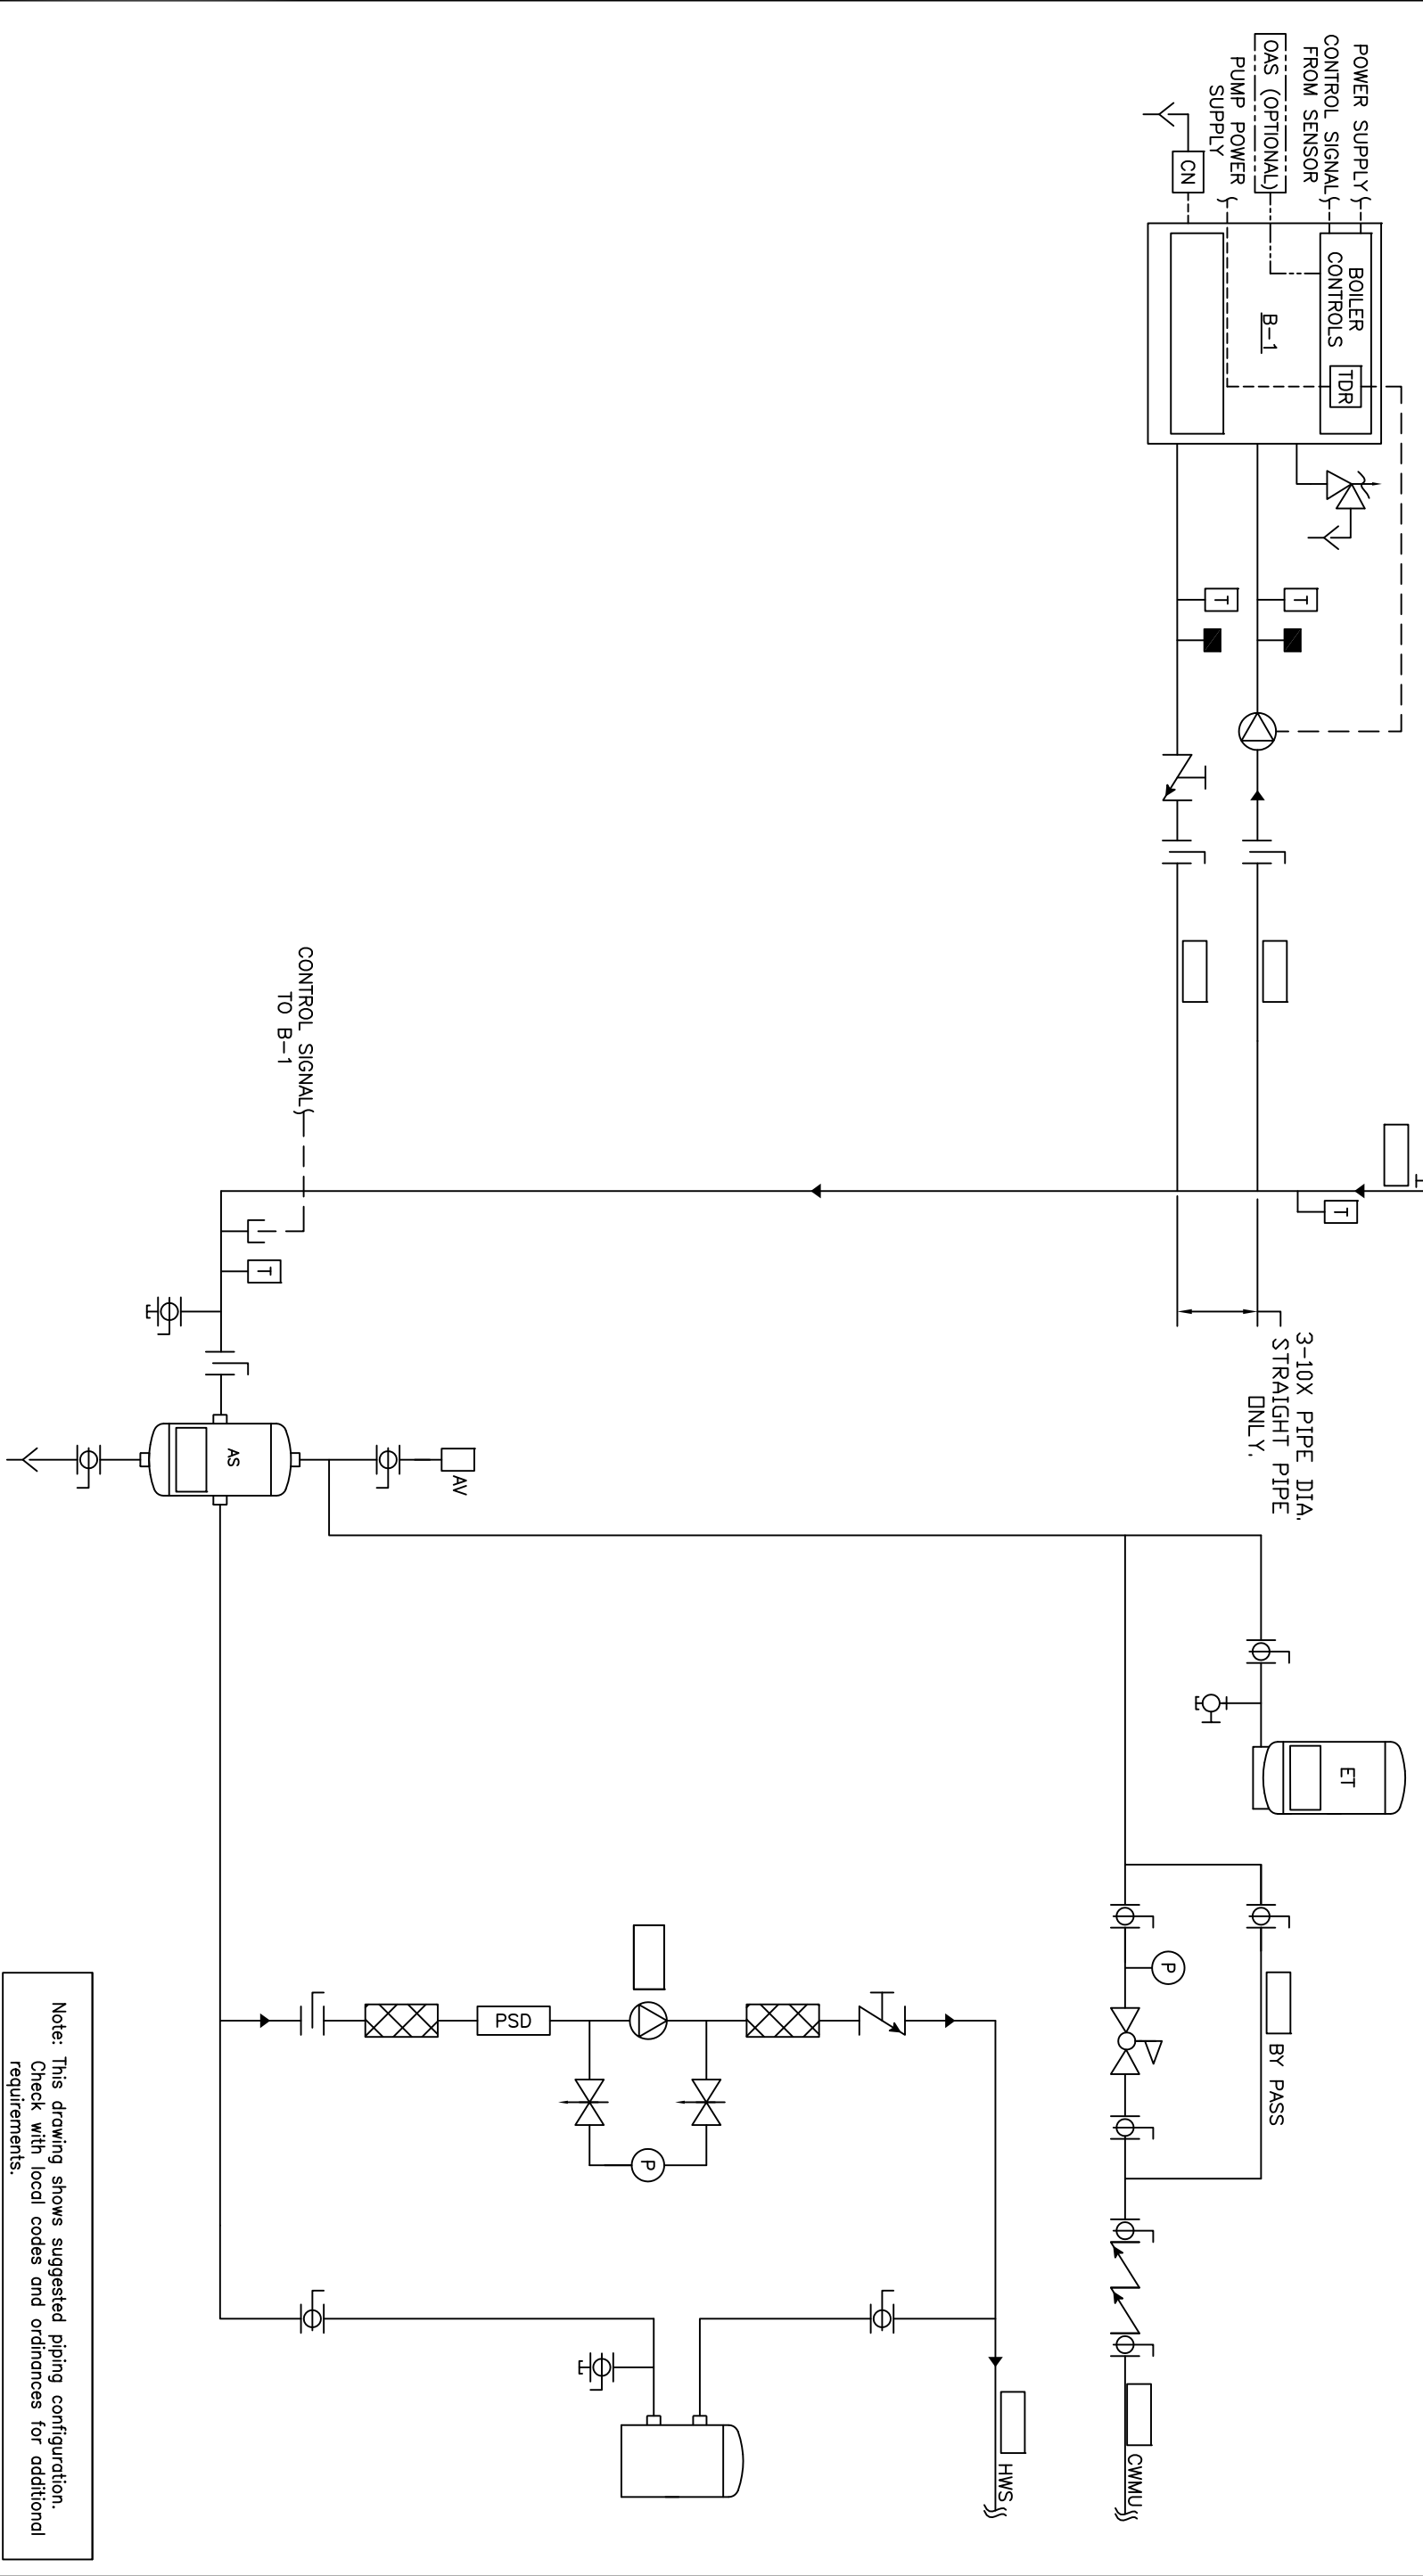

Note: This drawing shows suggested piping configuration. Check with local codes and ordinances for additional requirements.

<p>THIS DRAWING AND THE INFORMATION DERIVED THEREIN IS THE PROPERTY OF CHC. CALIFORNIA HYDRAONICS CORP. COPIES ARE ISSUED IN STRICT CONFIDENCE AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS INSTALLATION OR SALE OF PRODUCT WITHOUT PRIOR WRITTEN PERMISSION OF CHC.</p>		<p>PROJECT NAME: PROJECT LOCATION: ENGINEER: CUSTOMER:</p>		<p>DRAWING TITLE: HYDROIC PRIMARY/SECONDARY - FULLY CONDENSING BOILER BUILT IN TEMP PROTECTION WITH SEPERATE PRIMARY PUMP POWER AND SYSTEM PUMP DRAWING No. H-PS-401-1BI-1 DRAWN BY/DATE: [ ]/05/23/08 CHECKED/DATE: [ ]/05/23/08 TOLERANCES UNLESS OTHERWISE SPECIFIED: ANGLES 5° SCALE: 1"=1'-0"</p>	
<p>REV A RELEASED</p>	<p>BY RSG</p>	<p>DATE 05/28/08</p>	<p>DESCRIPTION</p>	<p>SCALE: A</p>	<p>CHC CALIFORNIA • RENO 800.486.4858 WASHINGTON • OREGON ALASKA • IDAHO • MONTANA 888.690.0090</p>