




Recc all piping to be sized per ASHRAE F36

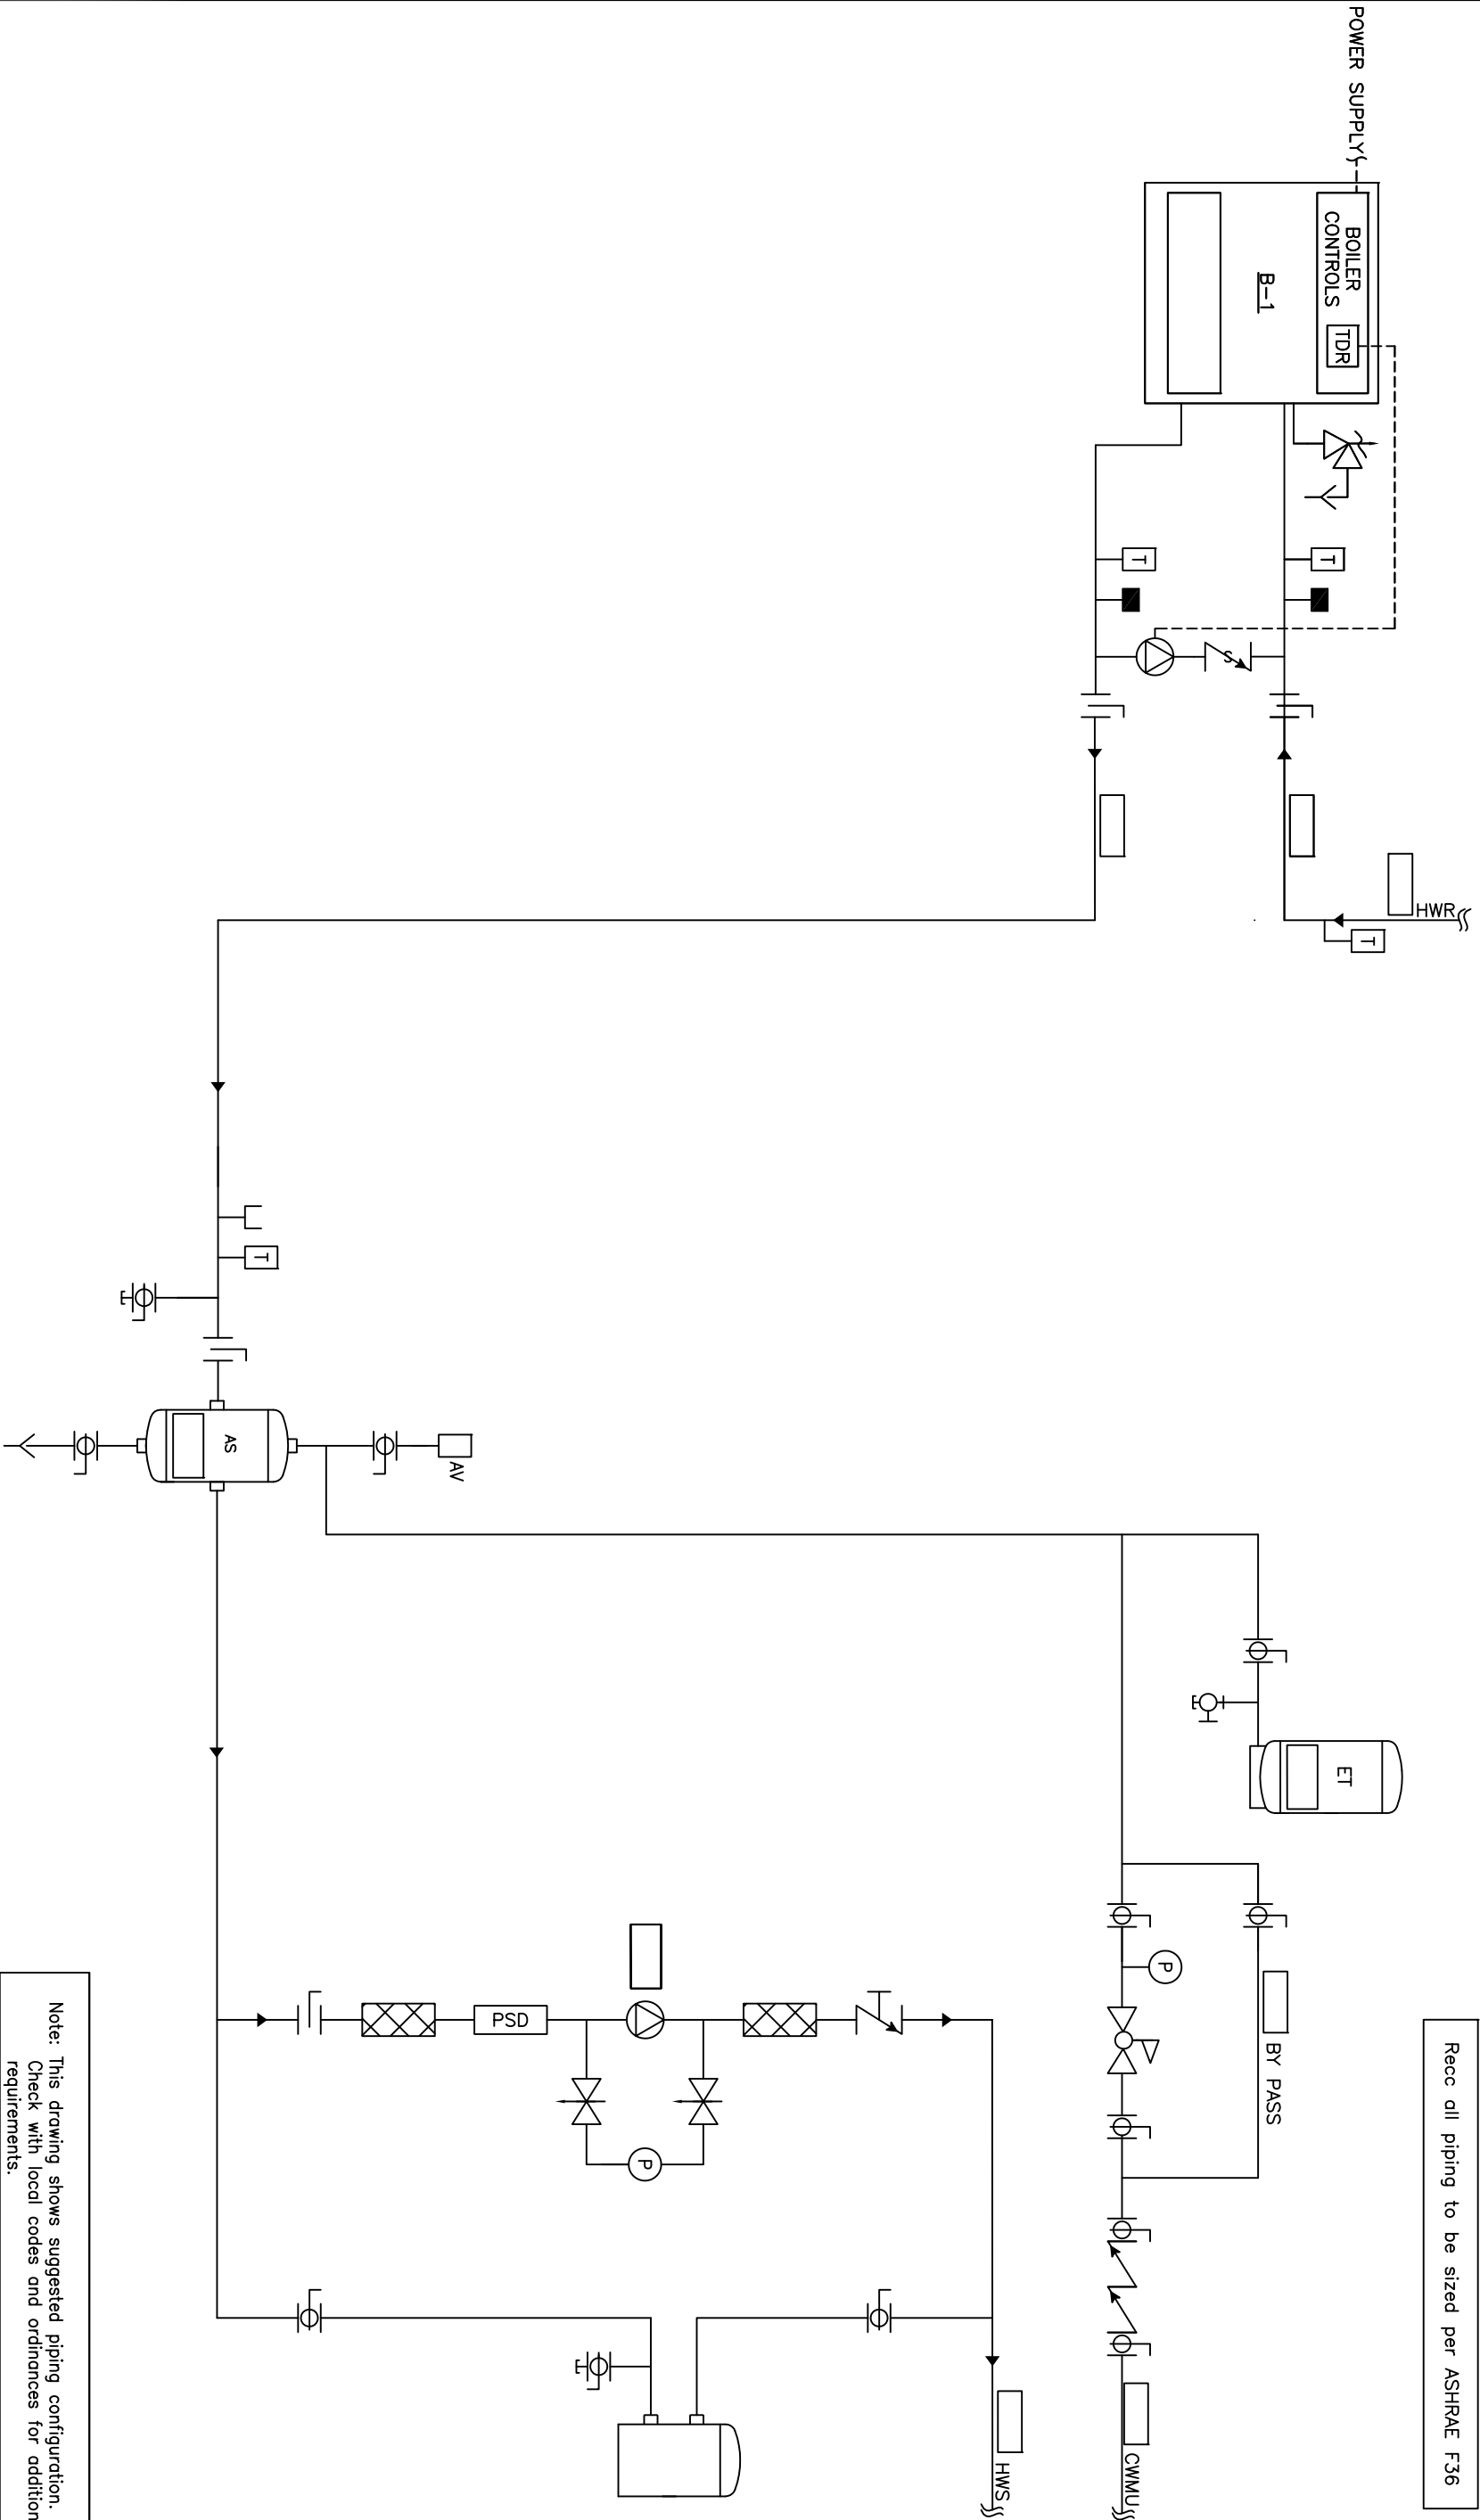

Note: This drawing shows suggested piping configuration.
Check with local codes and ordinances for additional requirements.

PROJECT NAME:		DRAWING TITLE:	
PROJECT LOCATION:		HYDROVIC VARIABLE VOLUME PRIMARY SYSTEM – ATMOSPHERIC BOILER, BLEND PUMP WITH SYSTEM PUMP	
ENGINEER:		DRAWING No. H-VP-100-1BP-1	
CUSTOMER:		REV A	
BY DATE		DRAWN BY DATE 5/23/08	
DESCRIPTION		CHECKED APPROVED	
REV		SCALE	





CALIFORNIA • RENO
800.486.4858
WASHINGTON • OREGON
ALASKA • IDAHO • MONTANA
888.690.0090