


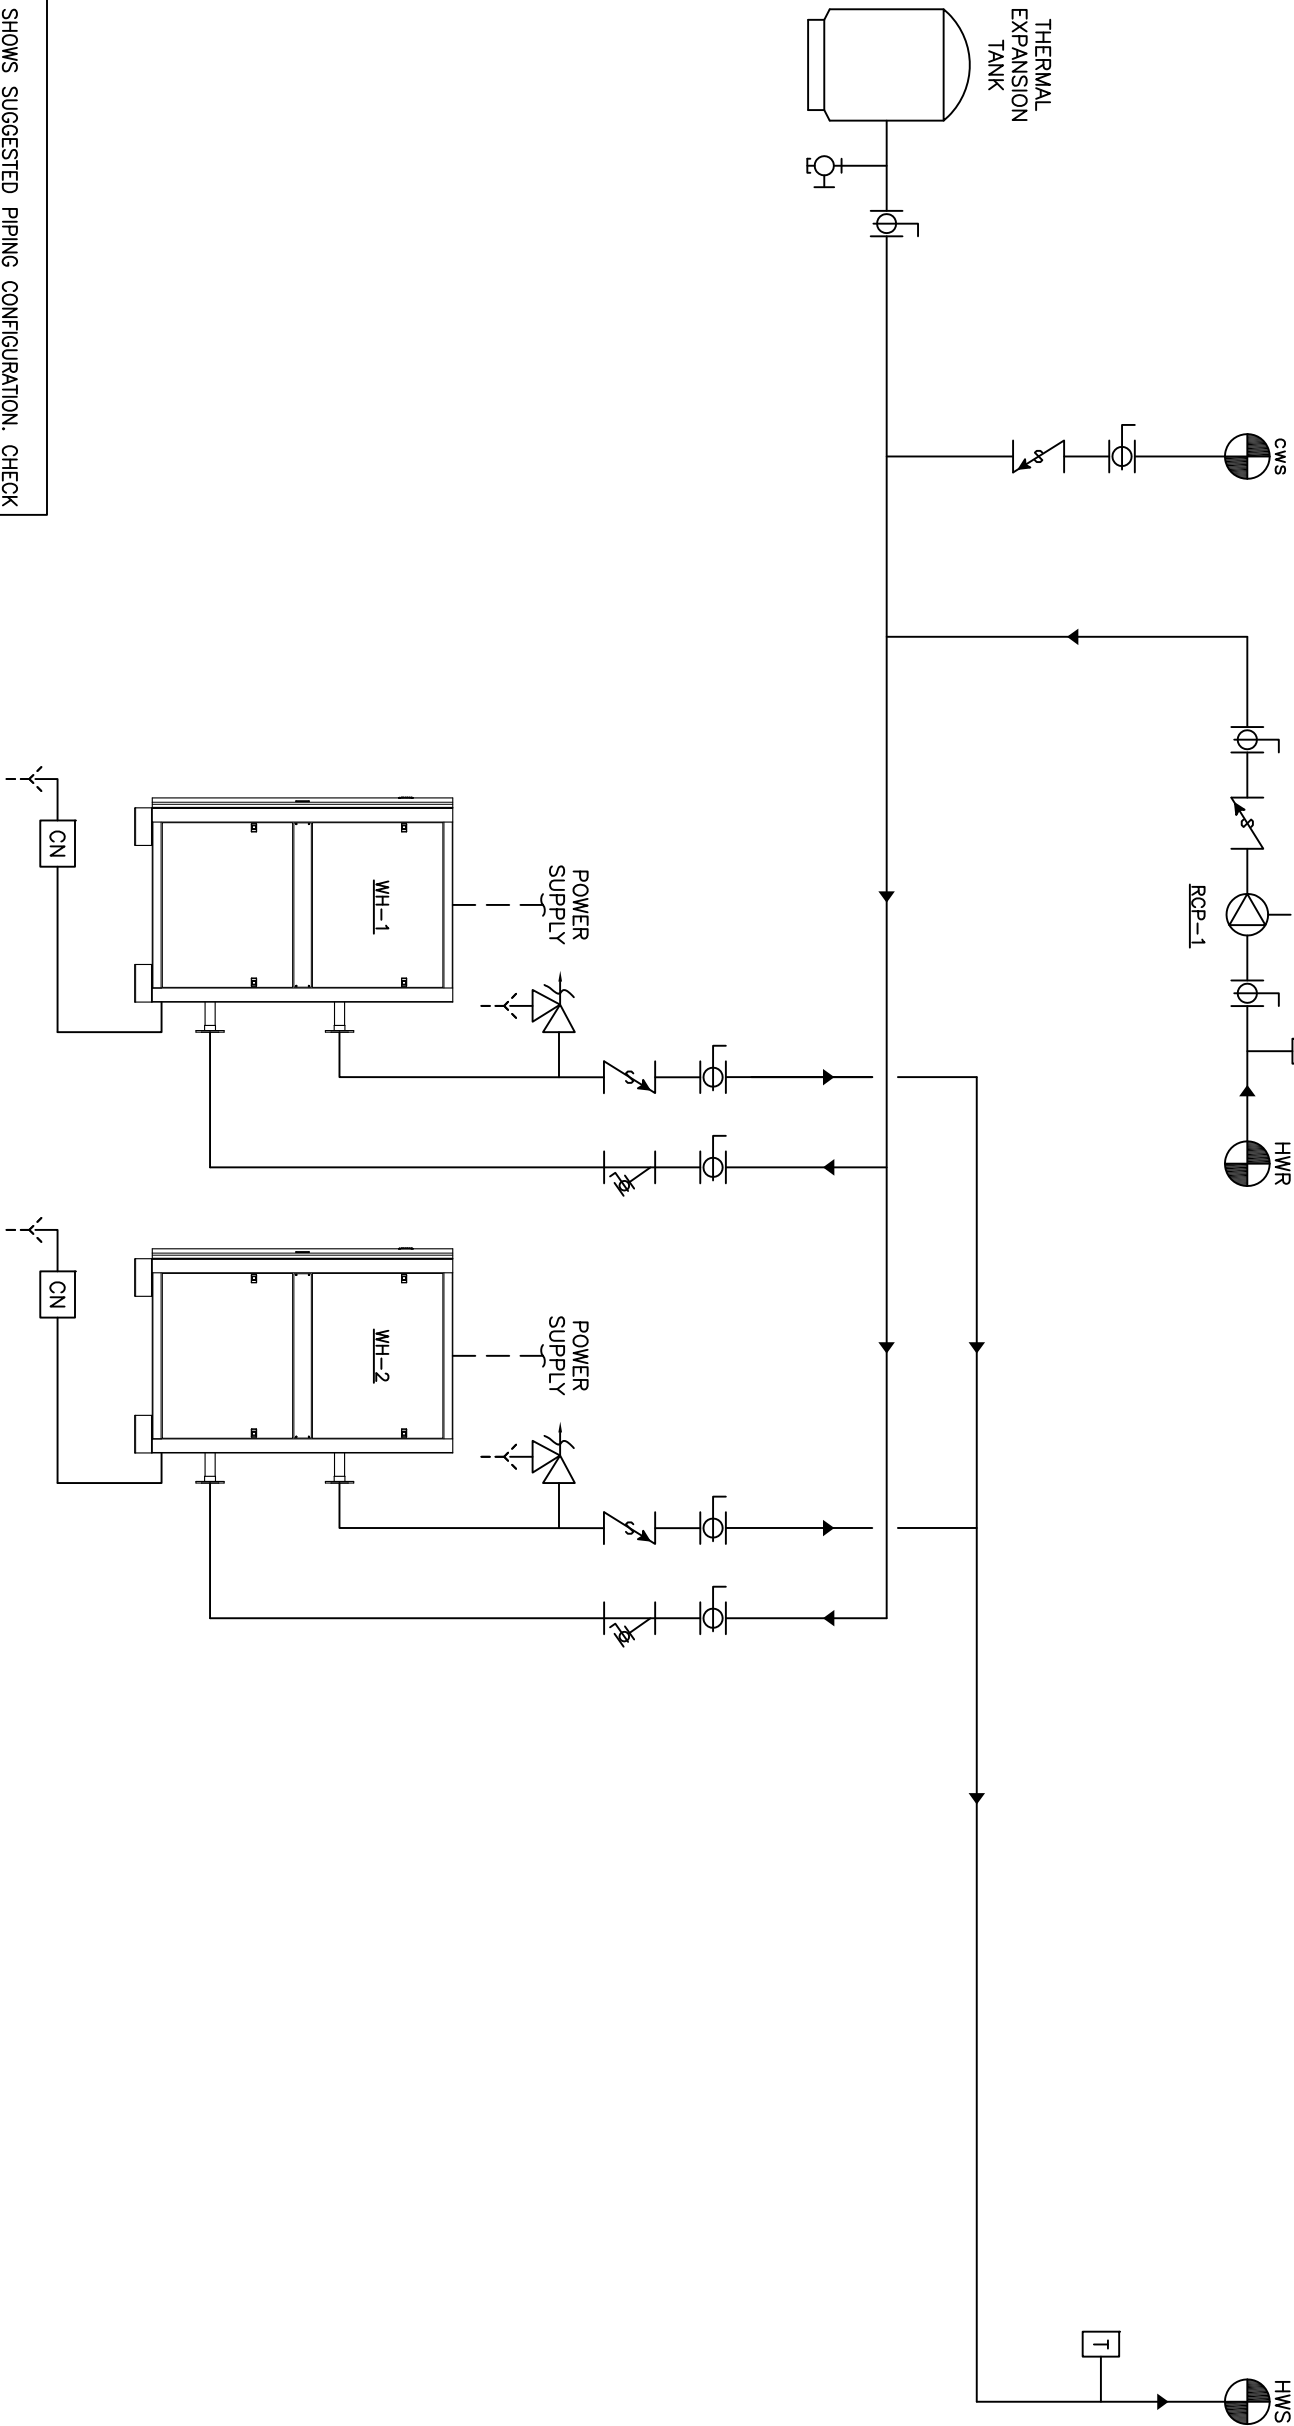

- NOTES:
- THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION. CHECK WITH LOCAL CODES FOR ADDITIONAL REQUIREMENTS
 - REFER TO INTELLIHOT IOM FOR GAS, AIR AND FLUE VENTING REQUIREMENTS

	BUTTERFLY VALVE		CONDENSATE NEUTRALIZER		HOSE BIB
	BALL VALVE		T&P VALVE		Y-STRAINER
	CHECK VALVE		THERMOMETER		

PROJECT NAME:		DRAWING TITLE:	
PROJECT LOCATION:		(2) INTELLIHOT IQ FLOOR HEATER, NO TANK	
ENGINEER:	DRAWING No.	REV	
CUSTOMER:	D-125-160-S-2-650-0	A	
THIS DRAWING AND THE INFORMATION DEPICTED THEREIN IS THE PROPERTY OF CHC. IT IS TO BE USED FOR THE PROJECT AND SITE SPECIFIC ONLY. NO REPRODUCTION OR COPIES ARE ISSUED IN STRICT REPRODUCTION OR COPIED, OR USED AS THE BASIS FOR THE MANUFACTURING, WITHOUT PRIOR WRITTEN PERMISSION OF CHC.		DRAWN BY/DATE: RSG 08/31/17 CHECKED BY/DATE: RSG 08/31/17 APPROVED BY/DATE: RSG 08/31/17 SCALE: NTS	

CALIFORNIA • RENO
800.486.4858
WASHINGTON • OREGON
ALASKA • IDAHO • MONTANA
888.690.0090