


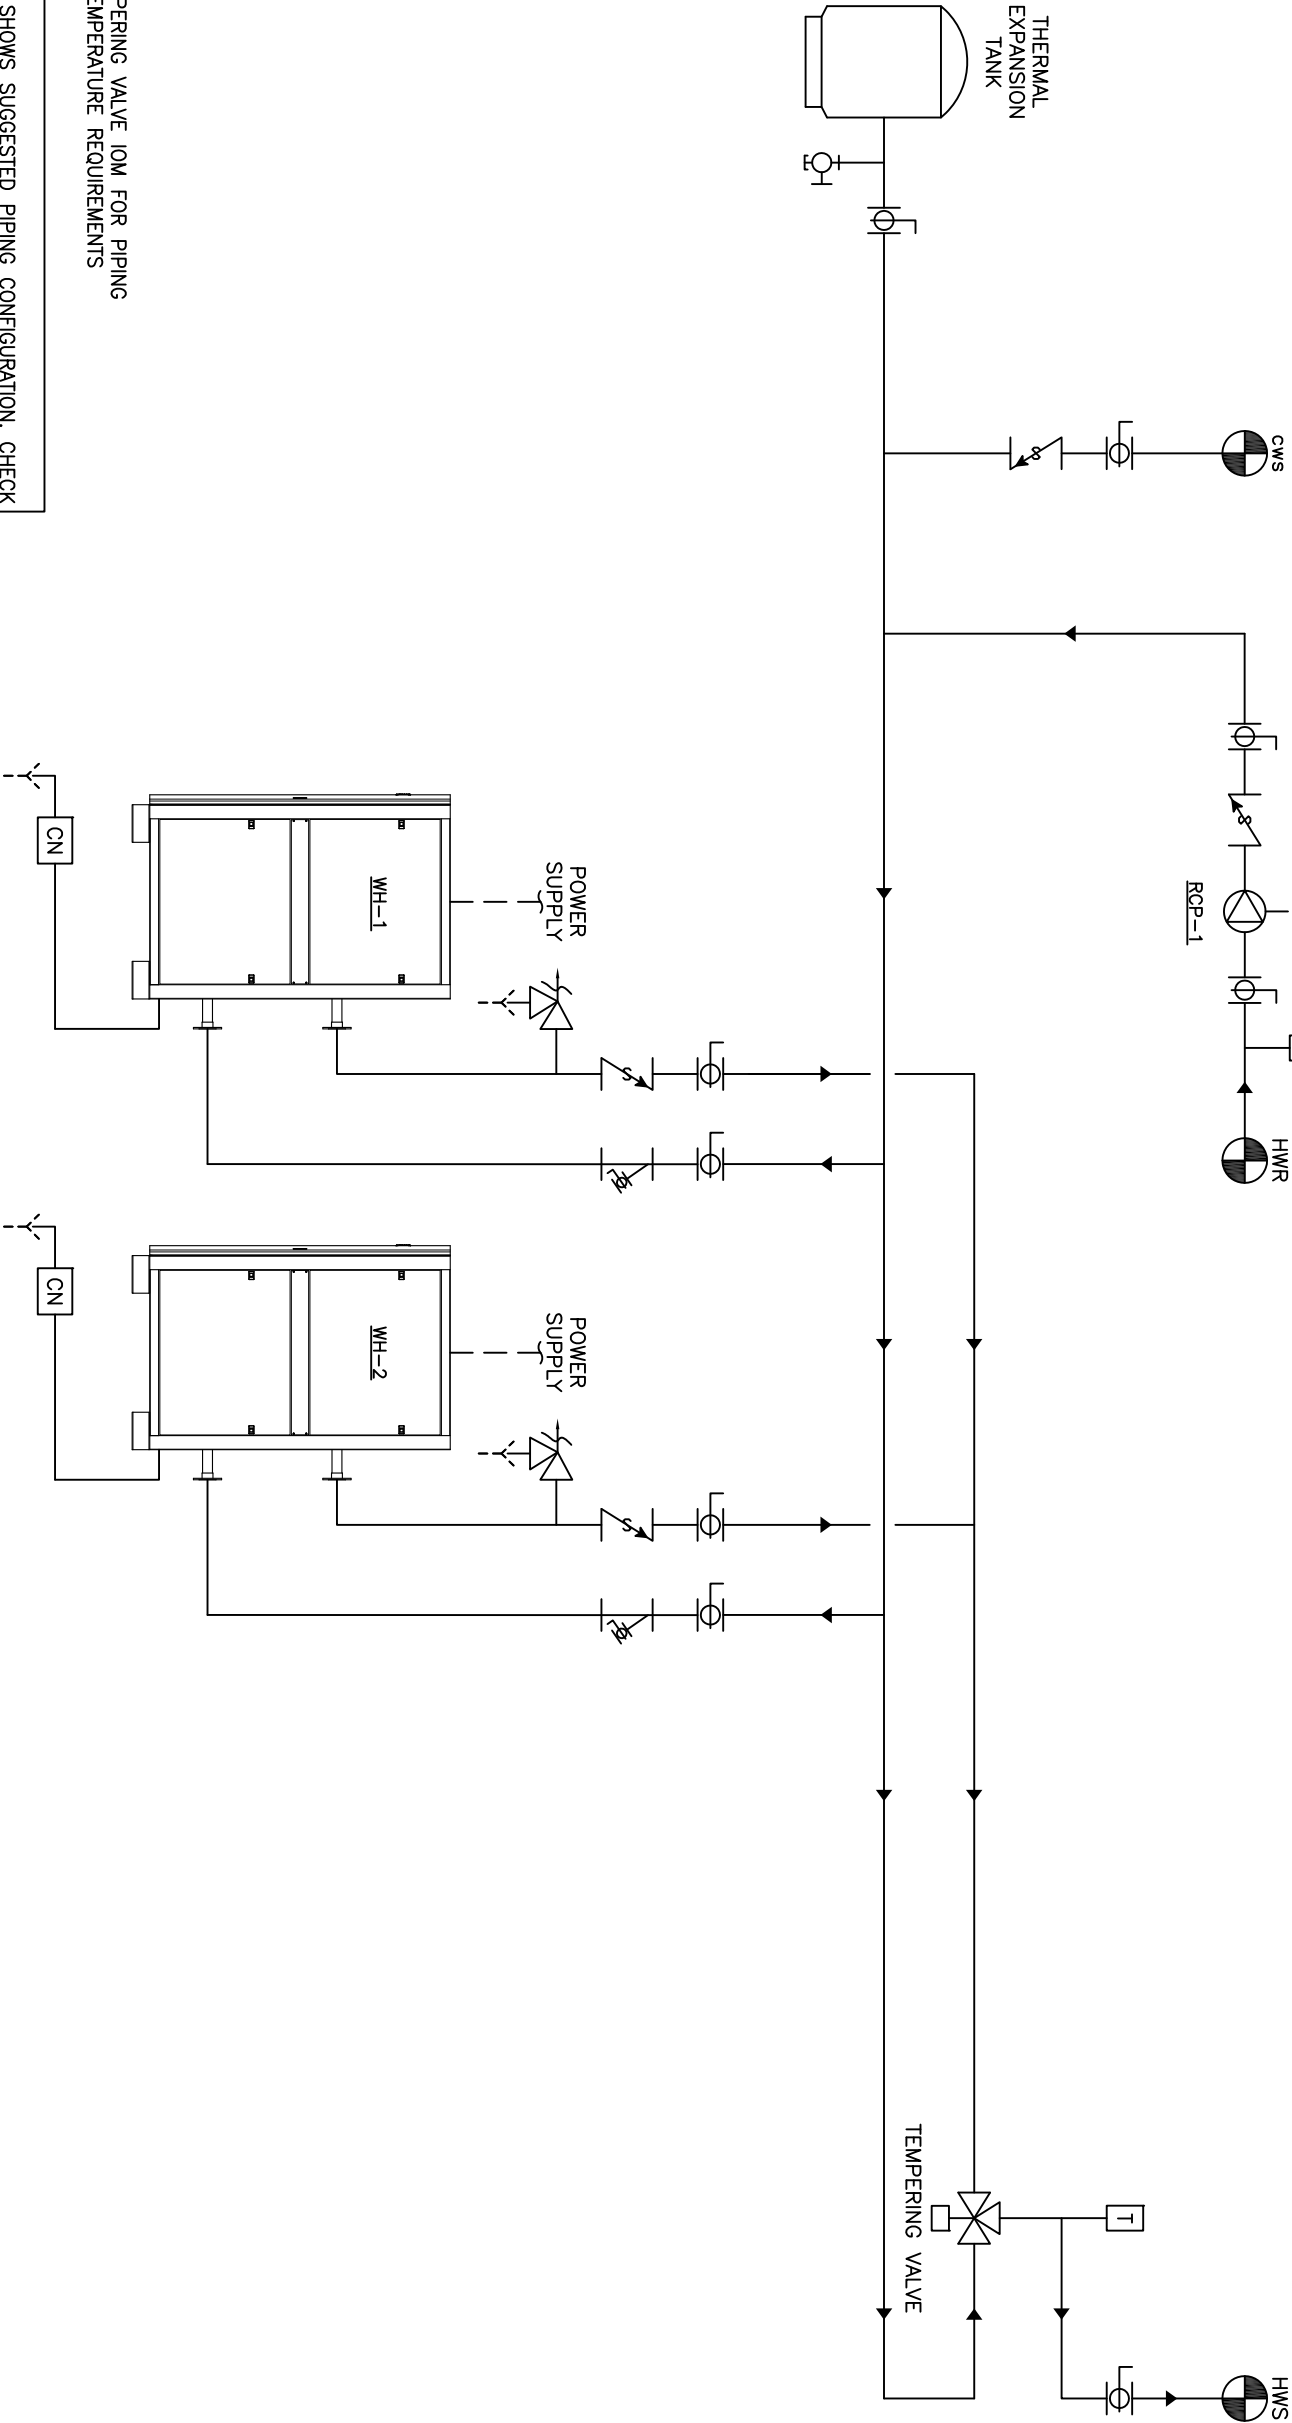

1 REFER TO TEMPERING VALVE IOM FOR PIPING AND RECIRC TEMPERATURE REQUIREMENTS


- NOTES:
- THIS DRAWING SHOWS SUGGESTED PIPING CONFIGURATION. CHECK WITH LOCAL CODES FOR ADDITIONAL REQUIREMENTS
 - REFER TO INTELLIHOT IOM FOR GAS, AIR AND FLUE VENTING REQUIREMENTS

	BUTTERFLY VALVE		CONDENSATE NEUTRALIZER		HOSE BIB
	BALL VALVE		T&P VALVE		Y-STRAINER
	CHECK VALVE		THERMOMETER		

THIS DRAWING AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF CHC, CALIFORNIA HYDRONICS CORP. COPIES ARE ISSUED IN STRICT CONFERENCE AND SHALL NOT BE USED AS THE BASIS FOR THE MANUFACTURING, INSTALLATION OR SALE OF PRODUCT WITHOUT PRIOR WRITTEN PERMISSION OF CHC.

PROJECT NAME:	
PROJECT LOCATION:	
ENGINEER:	
CUSTOMER:	

DRAWING TITLE:	
(2) INTELLIHOT IQ FLOOR HEATER, WITH MIXING VALVE	
DRAWING No.	REV
D-125-160-T-2-650-0	A
TOLERANCES UNLESS OTHERWISE SPECIFIED	
DRAWN BY/DATE	CHECKED/DATE
RSG 08/31/17	
300"	5"
SIZE	SCALE
D	NTS

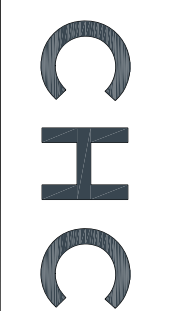

CALIFORNIA • RENO
800.486.4858
WASHINGTON • OREGON
ALASKA • IDAHO • MONTANA
888.690.0090